



BIORETENTION DETAIL FOR STANDARD PROJECTS ONLY

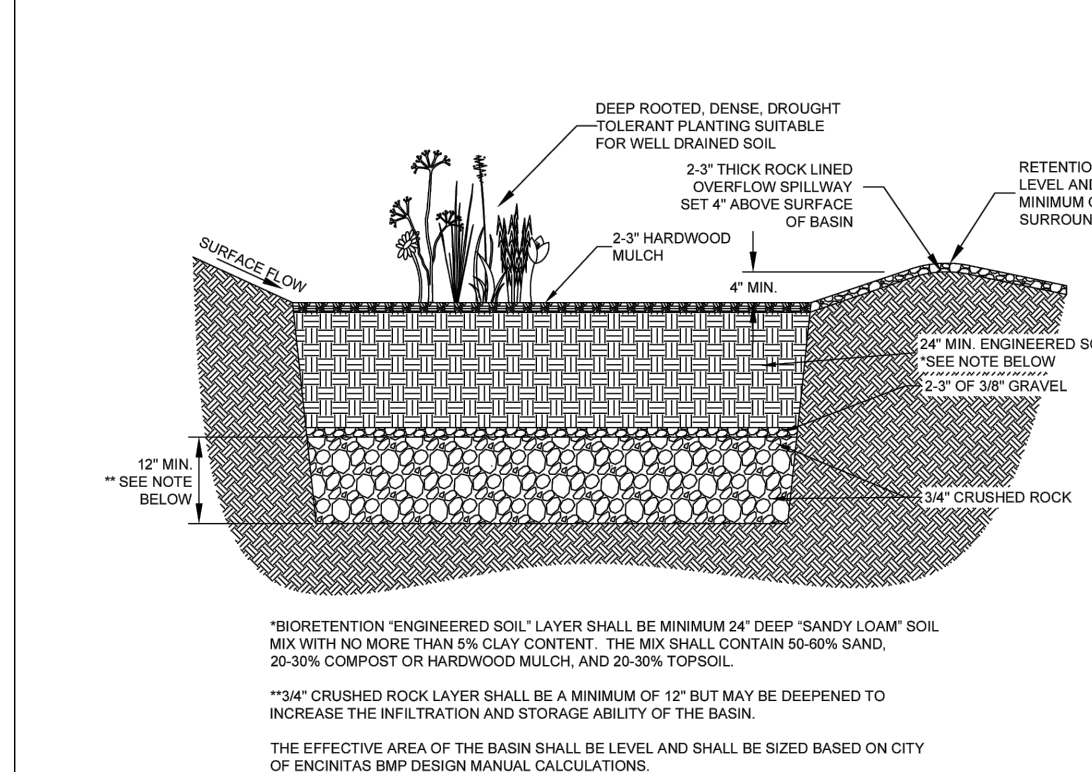

A - SURFACE FLOW WITH SPILL WAY

VEGETATED SWALE

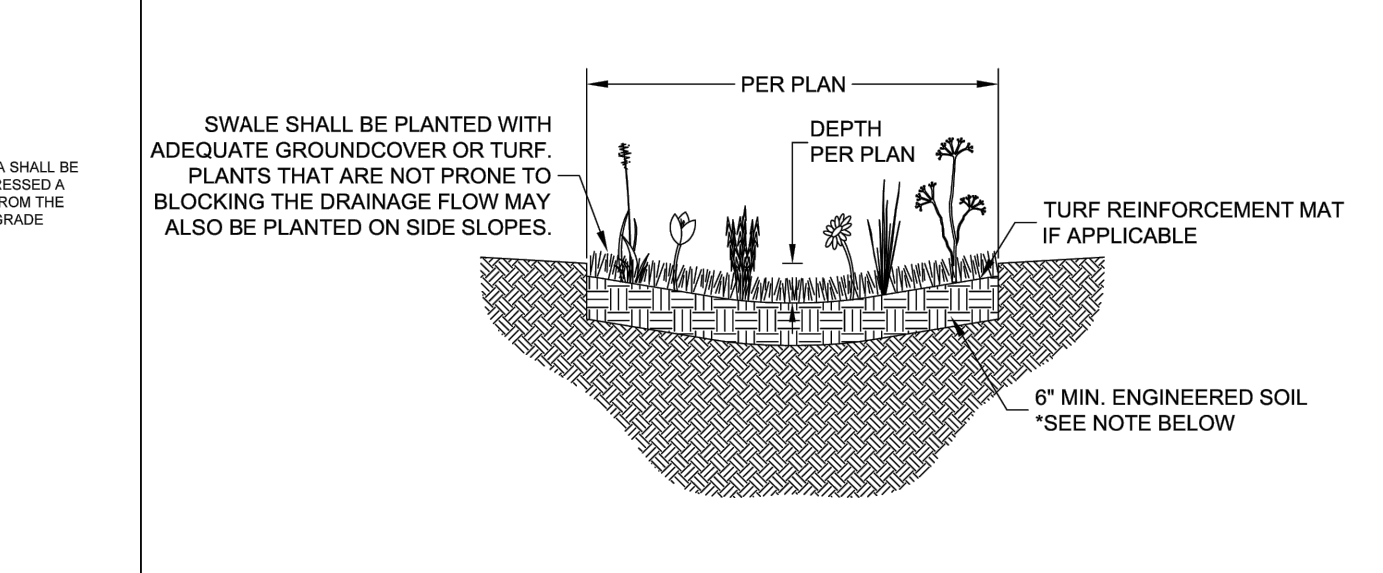

ENGINEERED SOIL LAYER SHALL BE MINIMUM 6" DEEP "SANDY LOAM" SOIL MIX WITH NO MORE THAN 5% CLAY CONTENT...

B - VEGETATED SWALE

THE APPLICANT SHALL IMPLEMENT SITE DESIGN STORMWATER BEST MANAGEMENT PRACTICES (BMP) AND LOW IMPACT DEVELOPMENT (LID) CONCEPTS...

C - SITE DESIGN + LID CONCEPTS

department notes:

- B1 SURFACE WATER WILL DRAIN AWAY FROM BUILDING... B2 COMPLIANCE WITH THE DOCUMENTATION REQUIREMENTS... E1 OWNER IS TO OBTAIN A CONSTRUCTION PERMIT... F1 ADDRESS NUMBERS: STREET NUMBERS: APPROVED NUMBERS AND/OR ADDRESSES SHALL BE PLACED ON ALL NEW AND EXISTING BUILDINGS...

site plan notes:

- 1. THE APPLICANT SHALL PROVIDE A DIMENSIONED SITE PLAN DRAWN TO SCALE... 2. IF A GRADING PLAN IS REQUIRED... 3. SITE PLAN SHALL PROVIDE DIMENSIONS SHOWING REQUIRED FIRE APPARATUS ACCESS ROADS... 4. AN ADJACENT CLOSER THAN 5' TO PROPERTY LINES IS REQUIRED TO PROVIDE A BOUNDARY SURVEY REPORT...

stormwater notes:

- CONCRETE WASHOUT SW1 CONTRACTOR SHALL ESTABLISH AND USE AN ADEQUATELY SIZED CONCRETE WASHOUT AREA... CONSTRUCTION SITE ACCESS SW2 A STABILIZED CONSTRUCTION SITE ACCESS SHALL BE PROVIDED FOR VEHICLES AND PERSONNEL... CONSTRUCTION VEHICLES SW3 A SPECIFIC AREA AWAY FROM CUTTERS AND STORMDRAIN SHALL BE DESIGNATED FOR CONSTRUCTION VEHICLES PARKING...

site plan information:


- ✓ CHECKLIST TO BE INCLUDED ON SITE PLAN: ALL EXTERIOR SITE BOUNDARIES CORRECTLY SCALED & DIMENSIONED, NORTH ARROW, SCALE OF PLAN, GRAPHIC & WRITTEN, LEGEND OF SYMBOLS, LINES, ABBREVIATIONS, ETC. USED ON PLAN, SITE CONTOURS, GRADE ELEVATIONS & OTHER TOPOGRAPHIC FEATURES...

swimming pool notes:



- IF THE PROPERTY WHERE THE ADU IS TO BE LOCATED HAS A SWIMMING POOL, THE POOL MUST MEET THE RULES BELOW: SWIMMING POOL SAFETY SHALL COMPLY WITH SECTION 3109.4 CBC... * POOL SHALL BE COMPLETELY ENCLOSED BY A BARRIER COMPLYING WITH SECTIONS 3109.4.1 THRU 3109.4.3...

site plan notes:

- THE APPLICANT SHALL PROVIDE A DIMENSIONED SITE PLAN DRAWN TO SCALE SHOWING THE FOLLOWING: NORTH ARROW, PROPERTY LINES, EASEMENTS, STREETS, EXISTING AND PROPOSED BUILDINGS, AND STRUCTURES... THE APPLICANT SHALL PROVIDE A DIMENSIONED SITE PLAN DRAWN TO SCALE SHOWING THE FOLLOWING: NORTH ARROW, PROPERTY LINES, EASEMENTS, STREETS, EXISTING AND PROPOSED BUILDINGS, AND STRUCTURES...

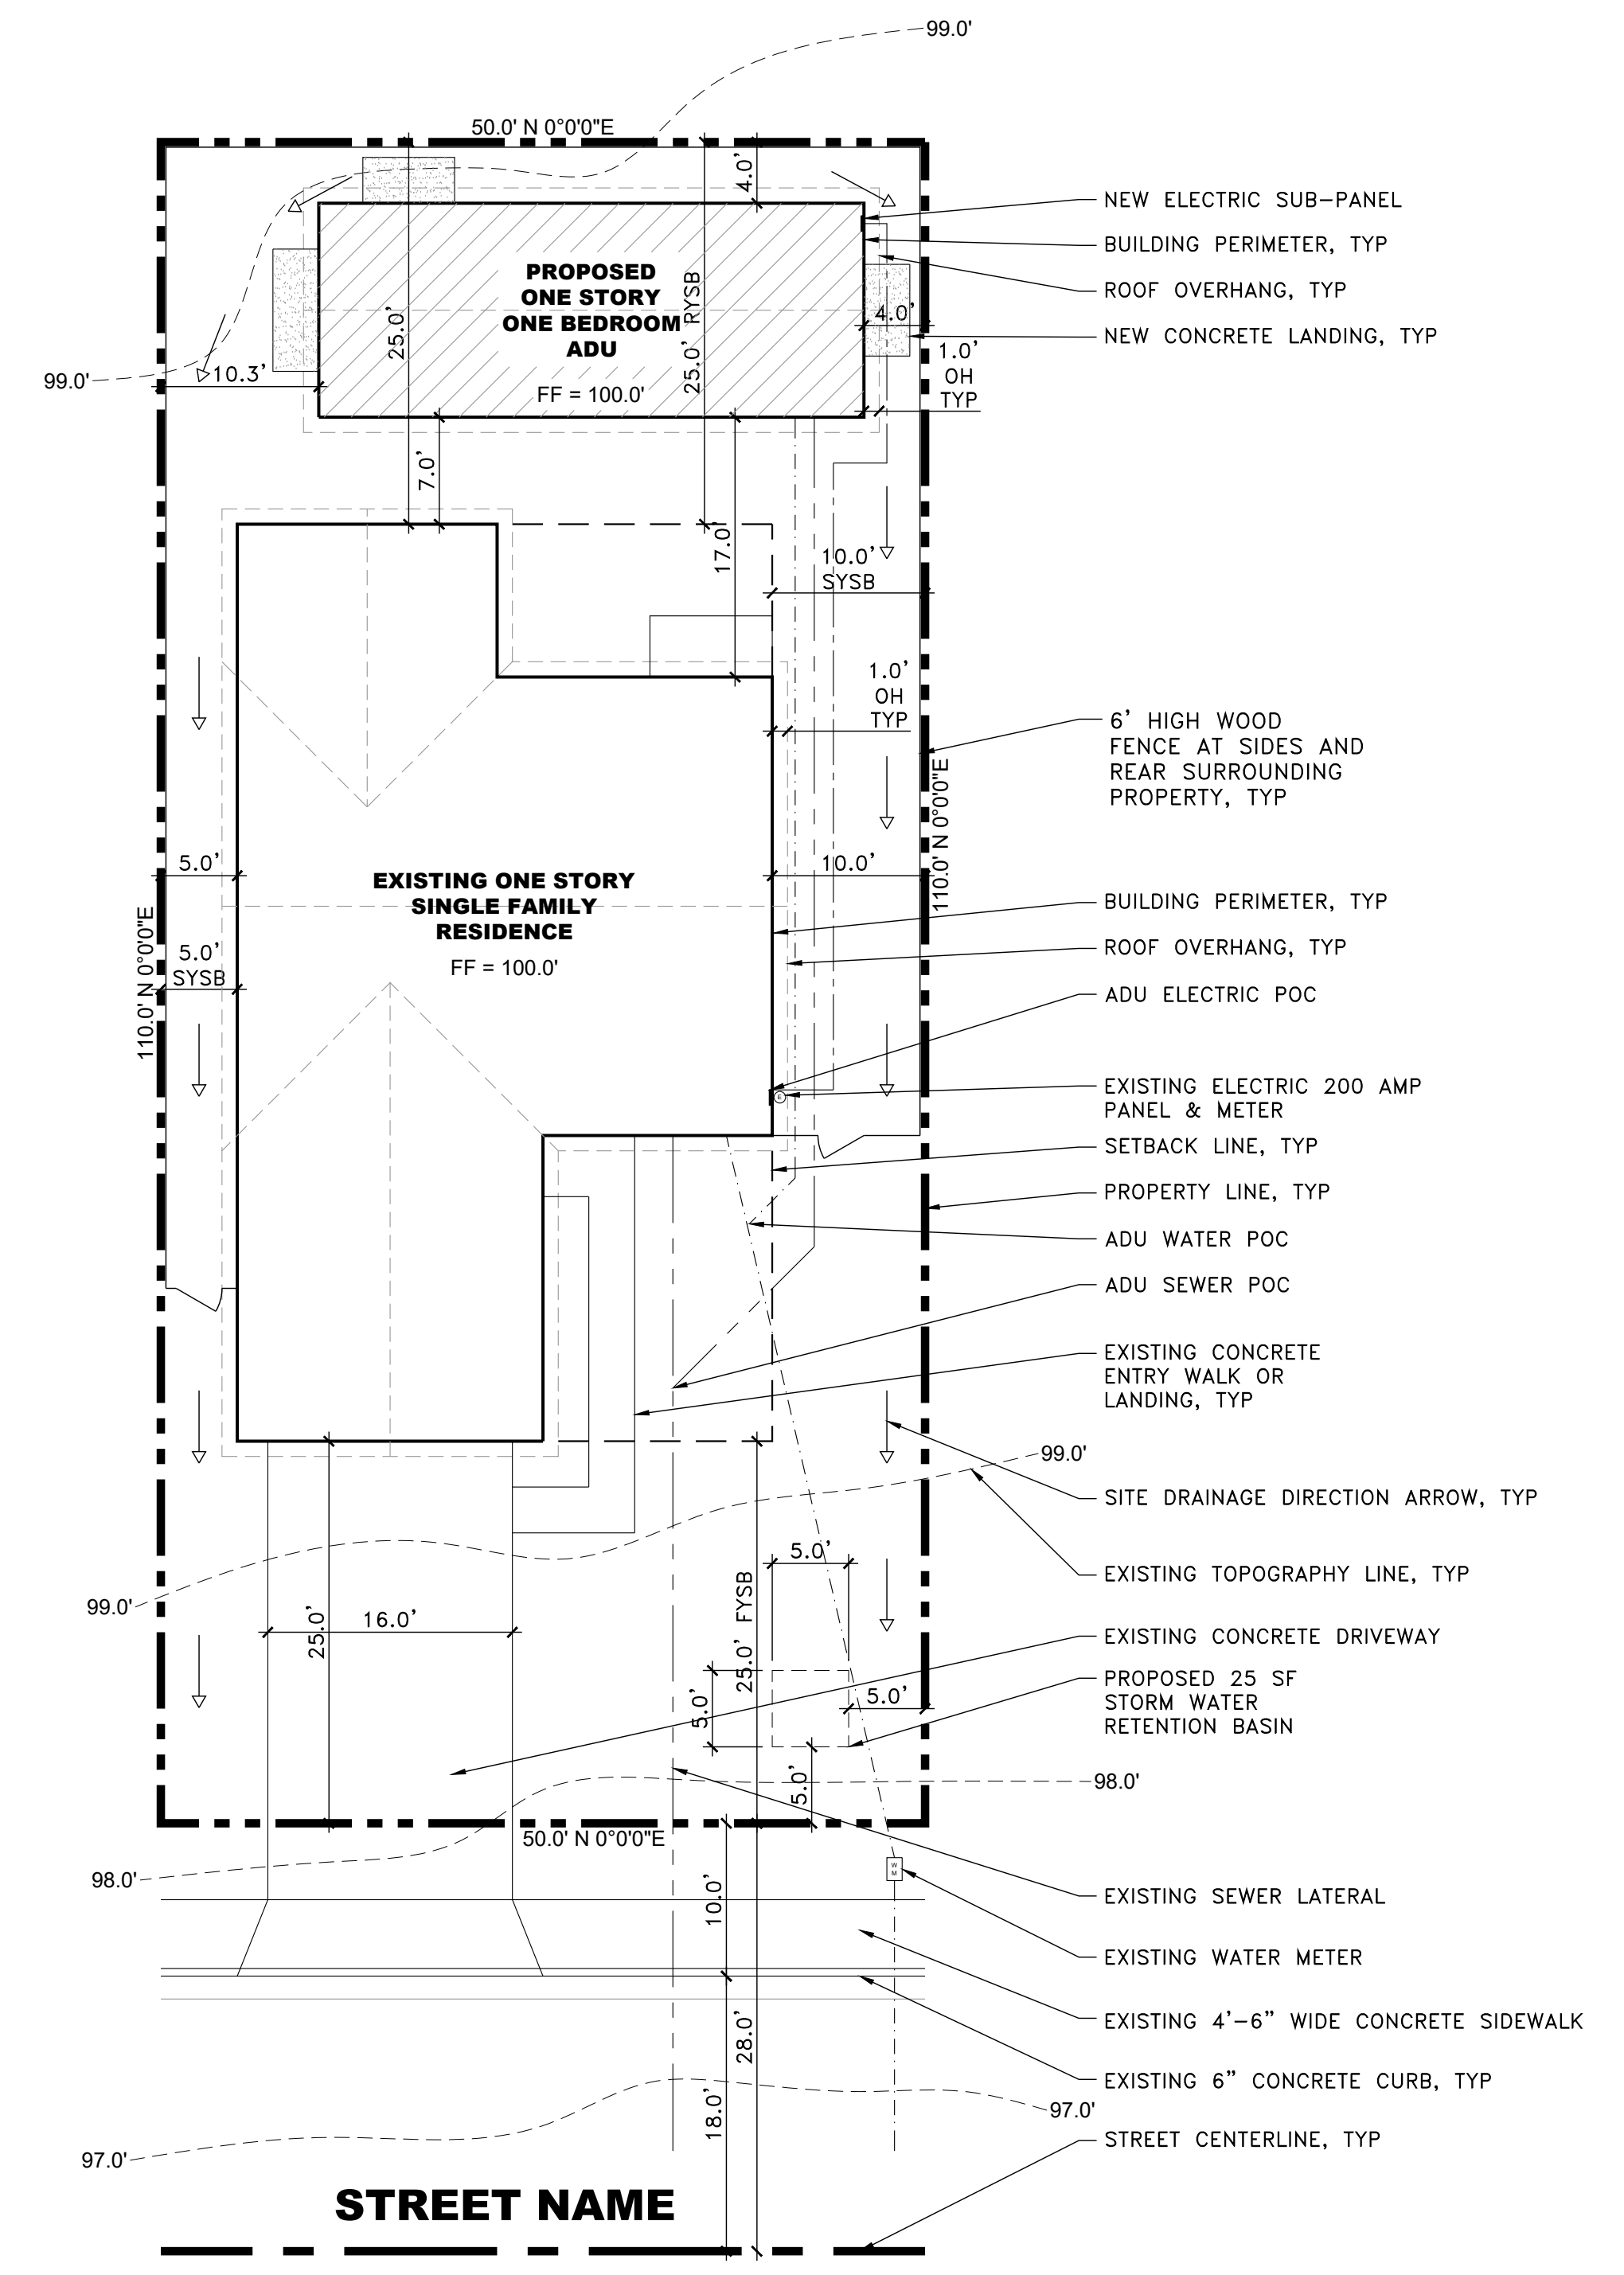

1 sample site plan SCALE: 1"=10'-0"

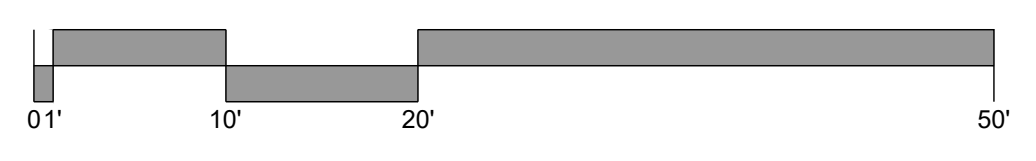

1 BEDROOM PRADU CITY: ANAHEIM JOB: 202409R

SITE PLAN + NOTES

a0.4


average lot slope calcs:

A.	LENGTH LOT SLOPE RUN LINE A =	FT
	LOT SLOPE RUN LINE A ELEVATION AT POINT 1 =	FT
	LOT SLOPE RUN LINE A ELEVATION AT POINT 2 =	FT
	POINT 1 (FT) - POINT 2 (FT) / LENGTH (FT) =	% SLOPE AT RUN LINE A
B.	LENGTH LOT SLOPE RUN LINE B =	FT
	LOT SLOPE RUN LINE B ELEVATION AT POINT 1 =	FT
	LOT SLOPE RUN LINE B ELEVATION AT POINT 2 =	FT
	POINT 1 (FT) - POINT 2 (FT) / LENGTH (FT) =	% SLOPE AT RUN LINE B
C.	LENGTH LOT SLOPE RUN LINE C =	FT
	LOT SLOPE RUN LINE A ELEVATION AT POINT 1 =	FT
	LOT SLOPE RUN LINE A ELEVATION AT POINT 2 =	FT
	POINT 1 (FT) - POINT 2 (FT) / LENGTH (FT) =	% SLOPE AT RUN LINE C
T.	RUN LINE A % + RUN LINE B % + RUN LINE C % / 3 =	% TOTAL
	AVERAGE LOT SLOPE IS	%

NOTES:

- SEE SAMPLE AVERAGE LOT SLOPE EXHIBIT ON SHEET a0.5
- FOR LOTS THAT EXCEED AN AVERAGE LOT SLOPE OF 10% ADDITIONAL HEIGHT RESTRICTIONS WILL APPLY AS PER EMC 30.16

FOR CITY STAMPS

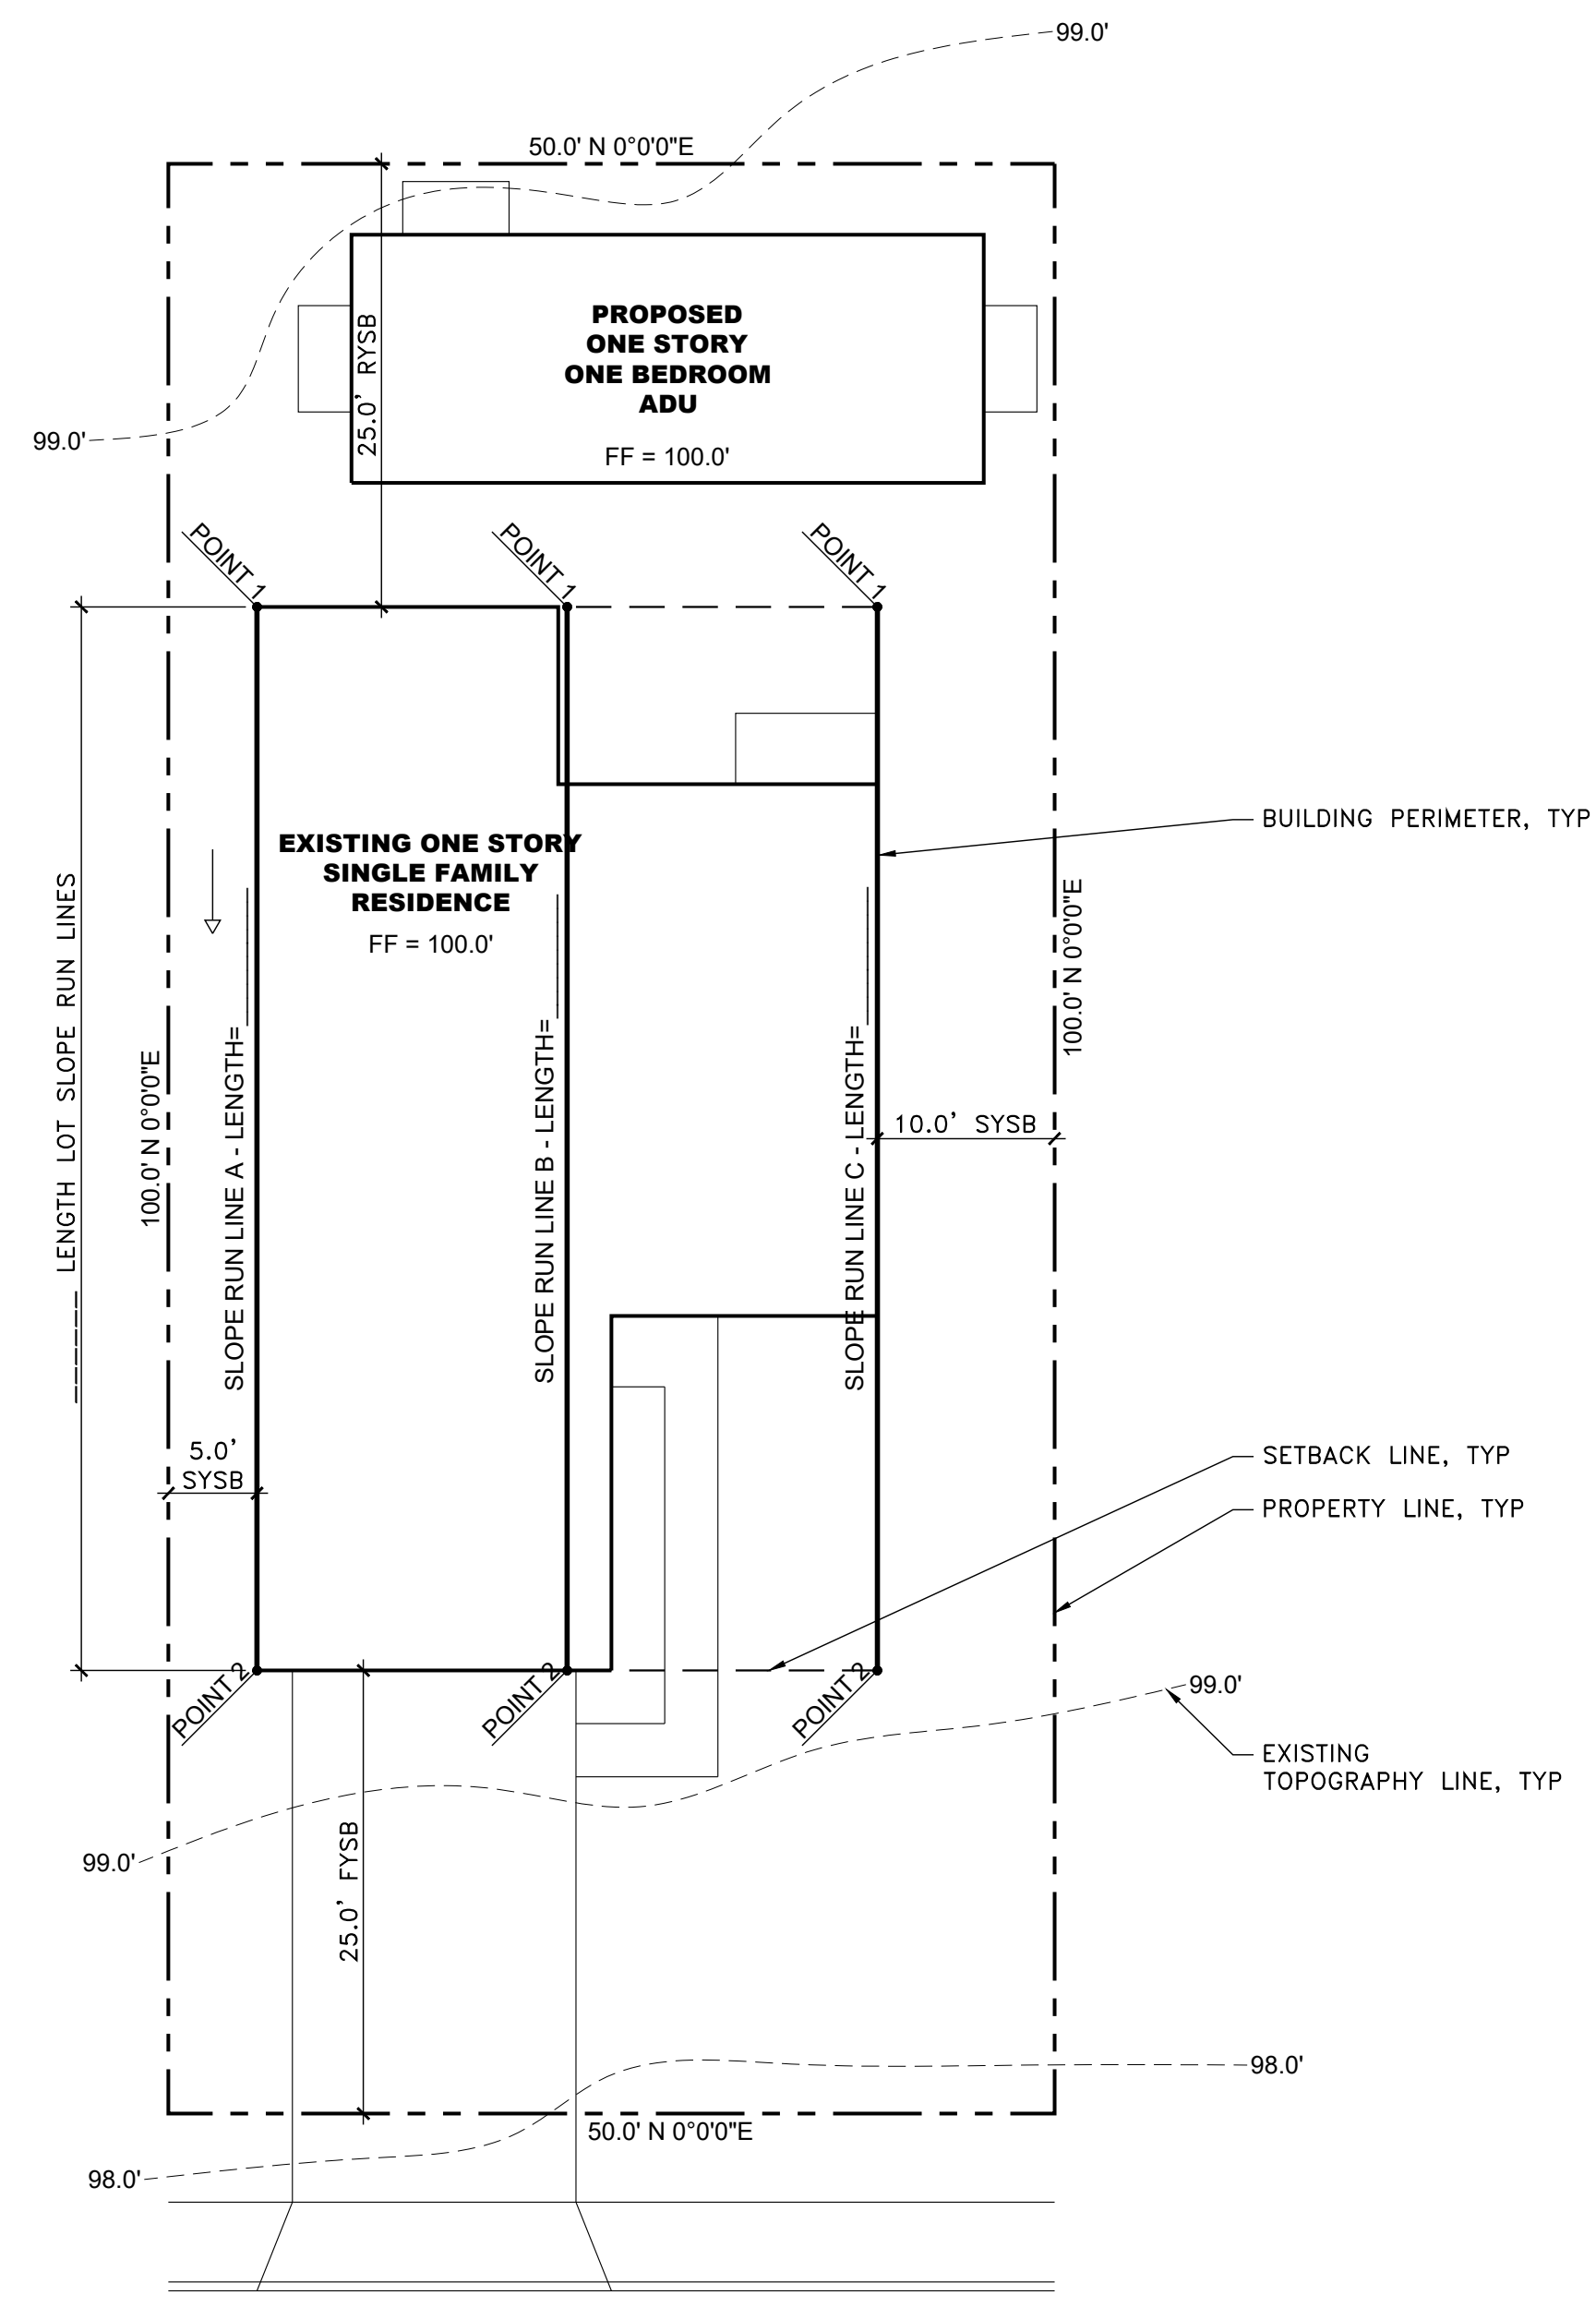

1 sample average lot slope diagram
 SCALE: 1"=10'-0"

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
 682 SECOND ST
 ENCINITAS, CA
 (760) 753 2464
 DZNPARTNERS.COM



1 BEDROOM PRADU

CITY: ANAHEIM

JOB: 202409R

AVERAGE LOT SLOPE DIAGRAM

a0.5

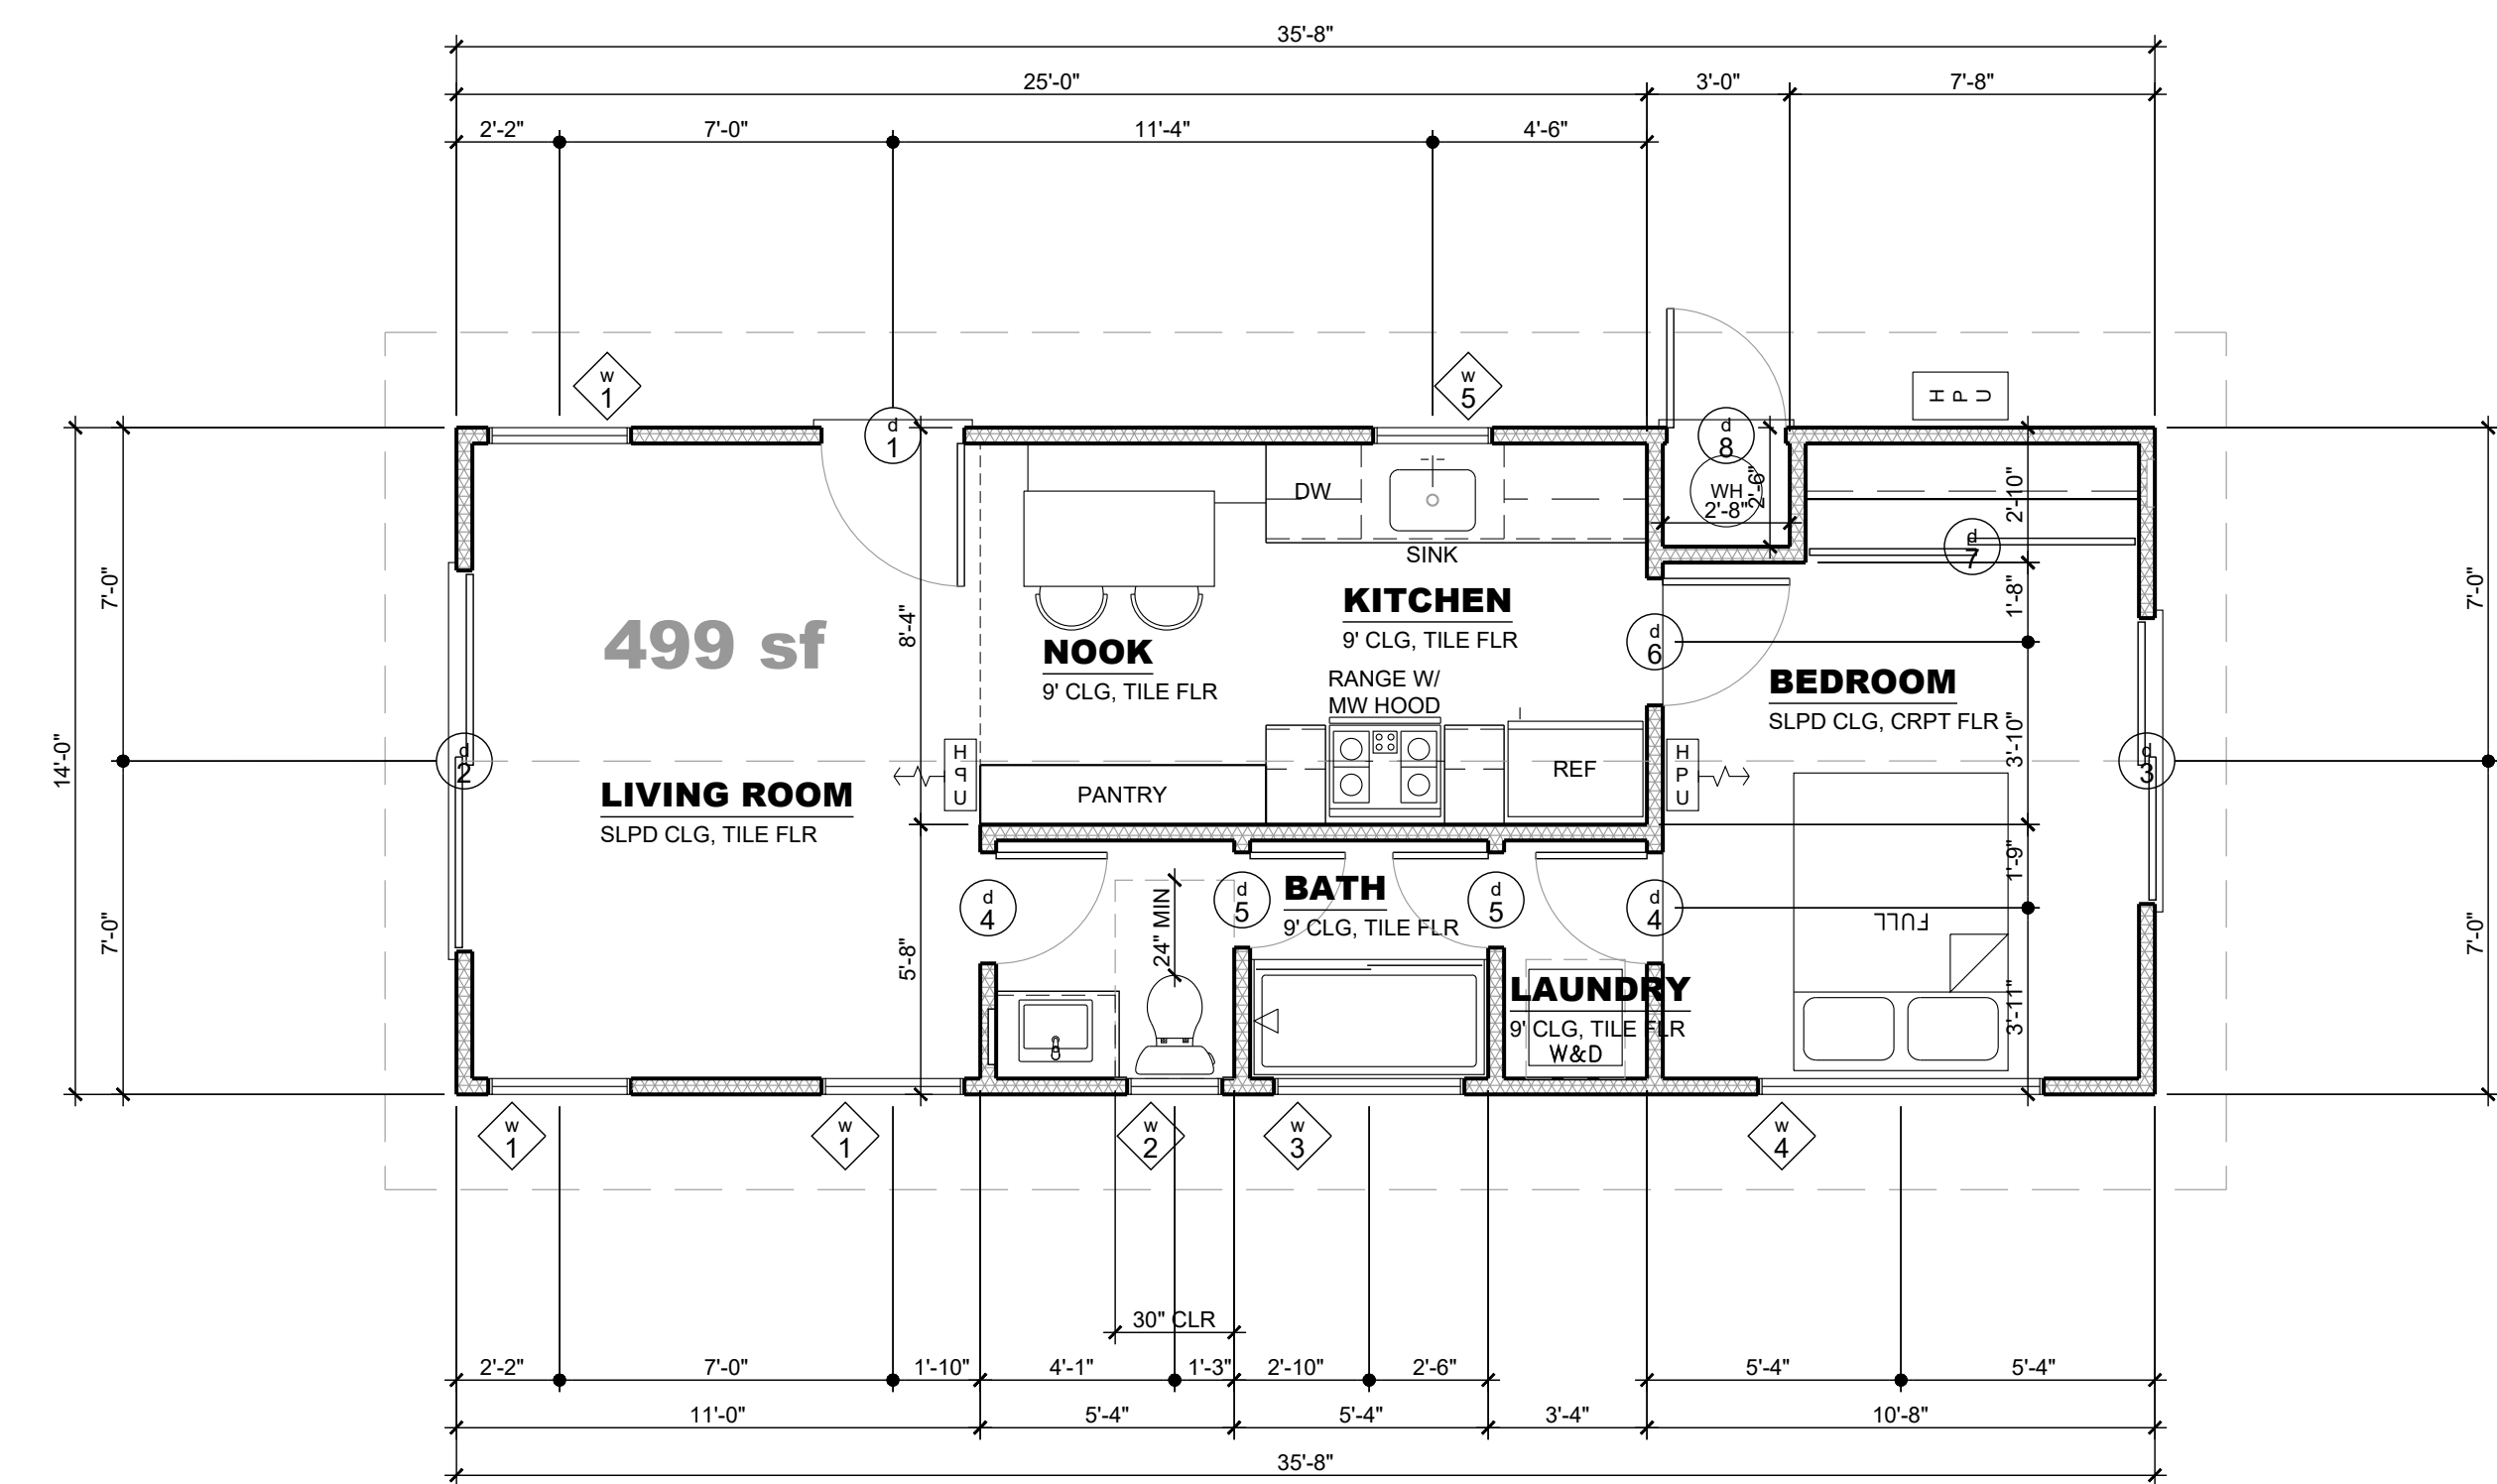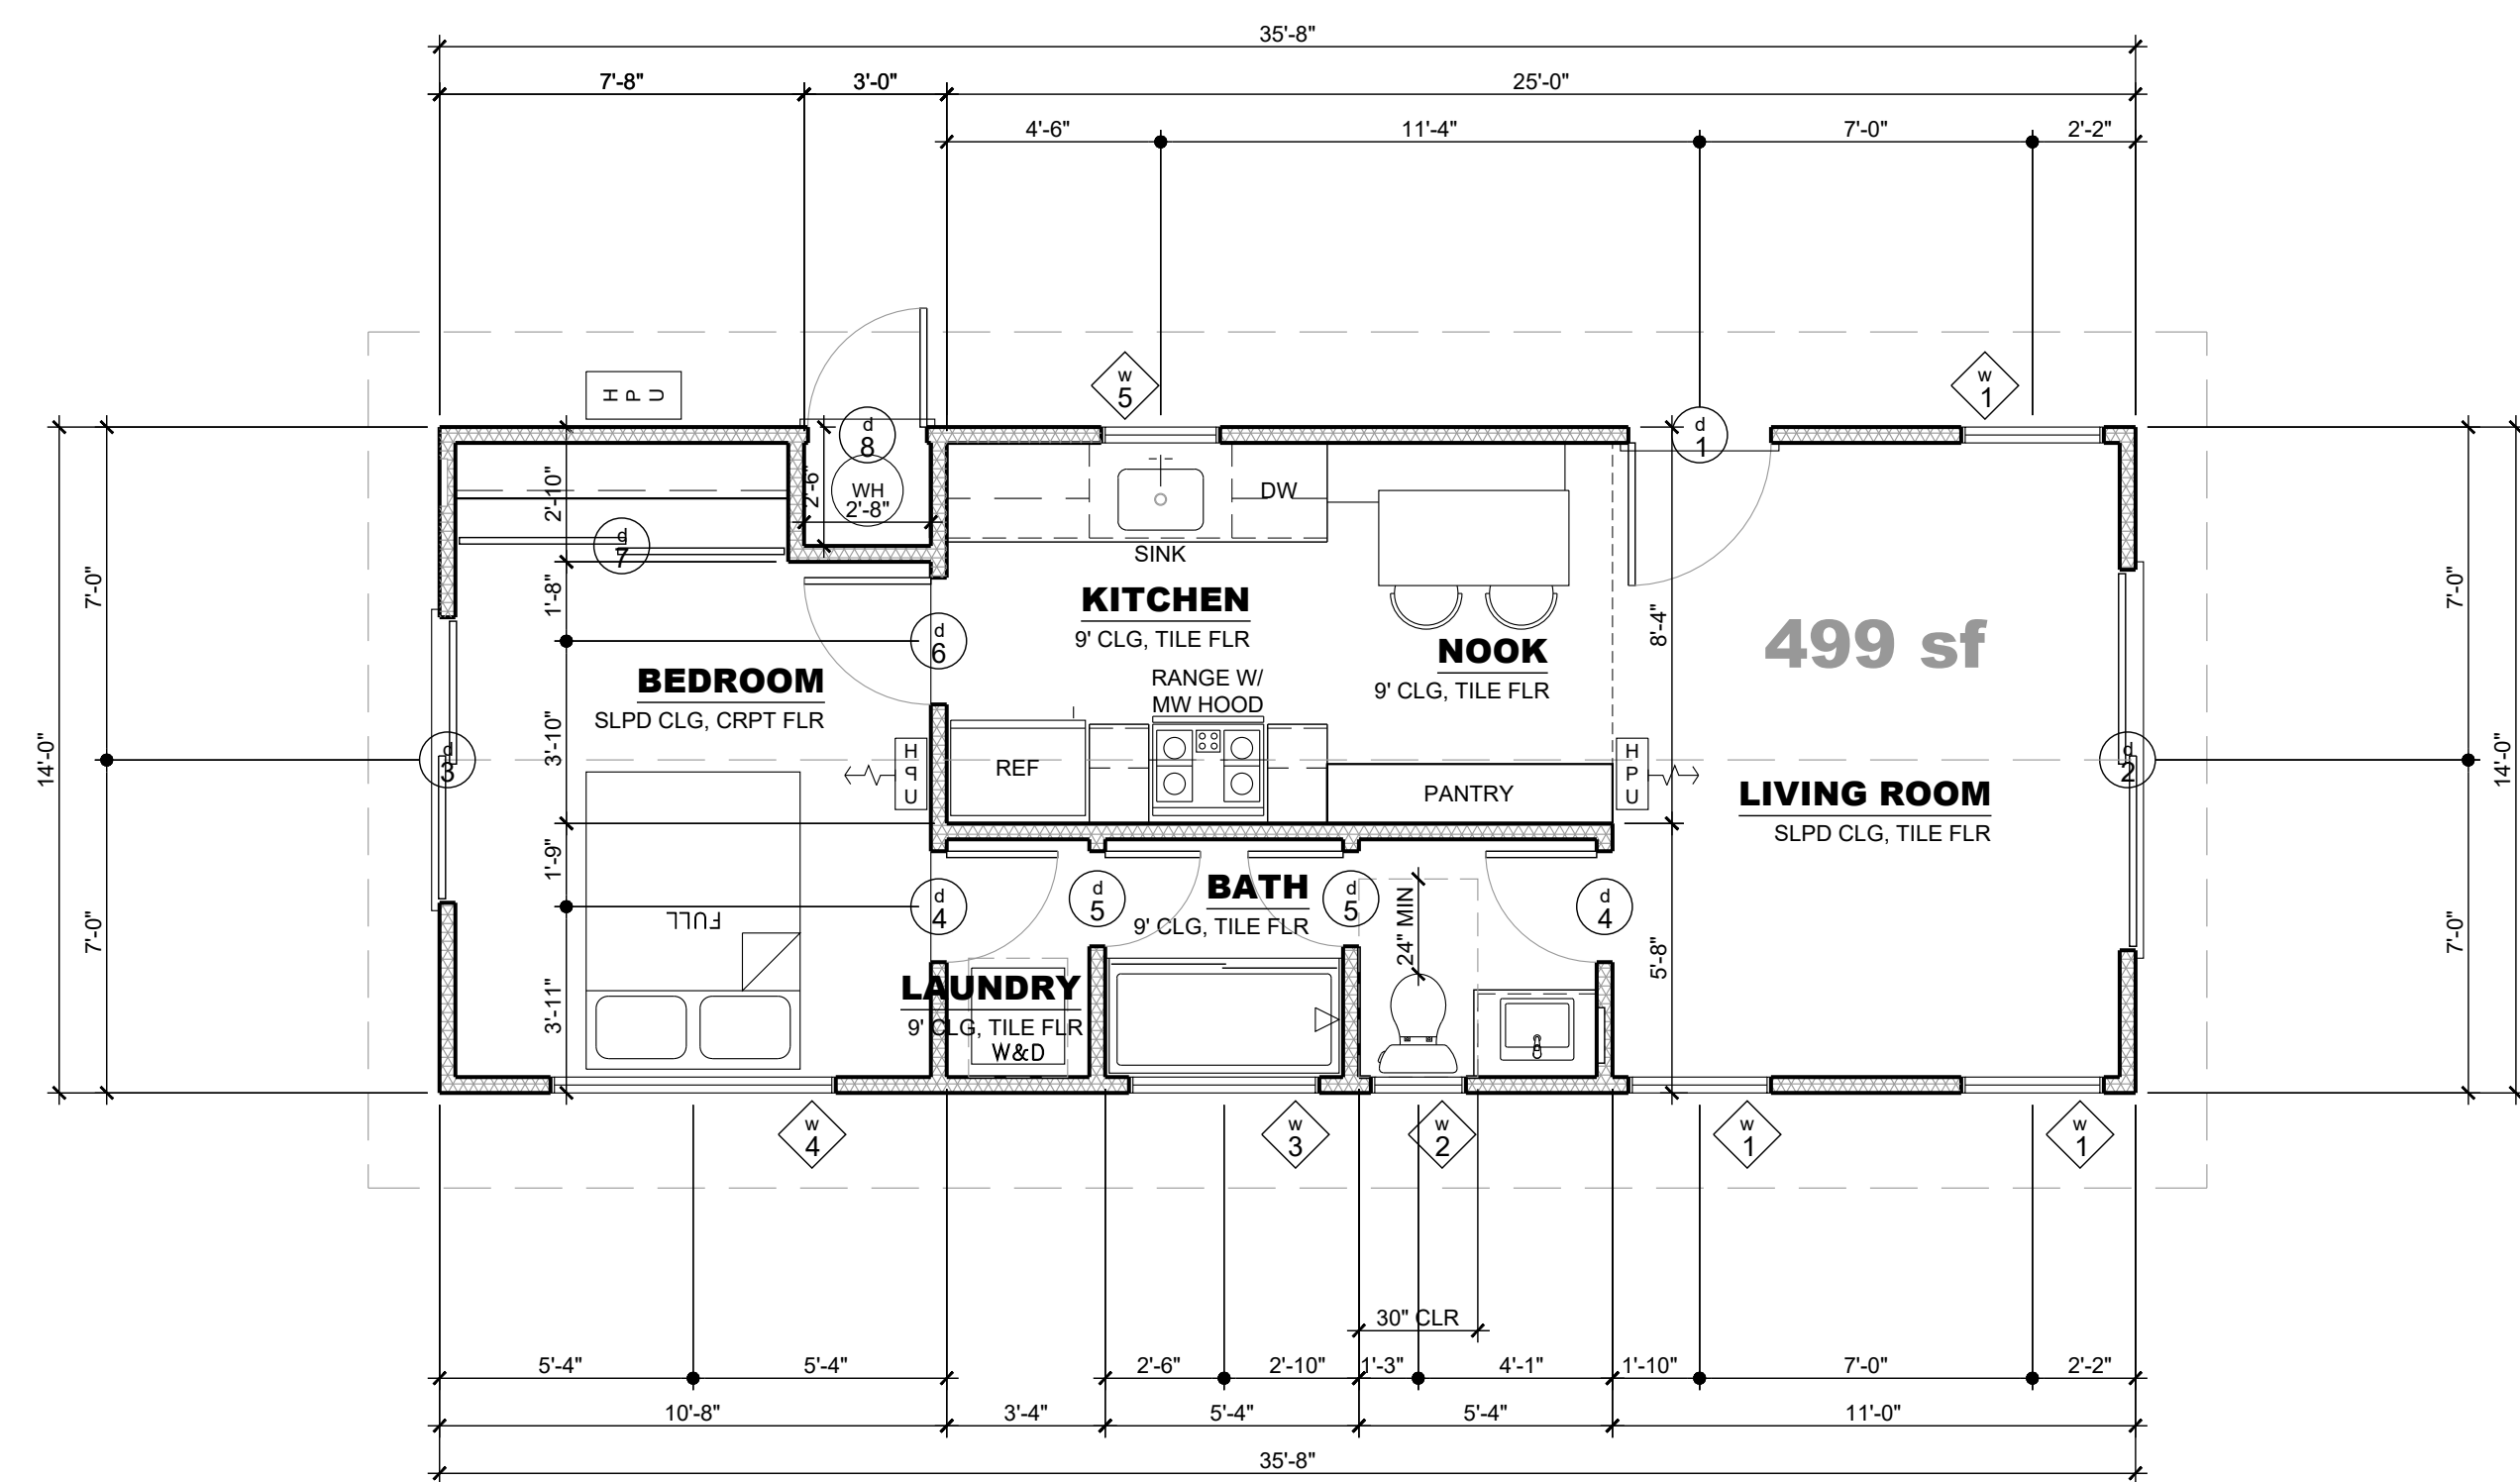


1 reverse floor plan a
SCALE: 1/4" = 1'-0"

2 floor plan a
SCALE: 1/4" = 1'-0"

drawing:		drawing:		drawing:		drawing:	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
(N)	NEW		EXISTING FOOTING		BUILDING SECTION LETTER SHEET NUMBER		SHEAR PANEL LETTER SHEAR PANEL LENGTH
(E)	EXISTING		NEW FOOTING		WALL SECTION LETTER SHEET NUMBER		TRUSS NUMBER
	EXISTING WALL REMOVED		NORTH ARROW		DETAIL NUMBER SHEET NUMBER		STRUCTURAL GRID LINE
	EXISTING WALL TO REMAIN	+ 100.0	NEW POINT ELEVATION		INTERIOR ELEVATION		SHEAR DRAG LINE
	NEW 4" WALL	+ 100.0	EXISTING POINT ELEVATION		LEVEL CHANGE		PAD FOOTING
	NEW 6" WALL	100.0	NEW CONTOUR		ROOM OR SPACE NUMBER		POST
	NEW 8" WALL	100.0	EXISTING CONTOUR	ROOM 9' CLG. FLOORING	ROOM NAME CEILING HEIGHT, FLOORING		HOLD DOWN
	NEW 8" CMU WALL		PROPERTY LINE		WINDOW NUMBER		FACTORY BUILT SHEAR PANEL
	NEW DWELLING UNIT SEPARATION WALL		CENTER LINE		DOOR NUMBER		FLOOR JOISTS
	BEARING WALL		SET BACK LINE		REVISION NUMBER		CEILING JOISTS
	NON-BEARING WALL AT FRAMING PLANS		FLOOR MATERIAL CHANGE		KEYNOTE NUMBER		RAFTER OR TRUSS

- floor plan notes:**
- SEE LEGENDS TO THE LEFT FOR SYMBOLS RELATING TO THE FLOOR PLAN.
 - SEE SHEET #0.1 FOR SCHEDULES RELATING TO THE FLOOR PLAN.
 - THE KITCHEN SHALL HAVE UPPER CABINETS, BASE CABINETS, AND COUNTERTOPS AS DEPICTED ON THIS FLOOR PLAN AND IN THE INTERIOR ELEVATIONS.
 - LAVATORIES:
 - SHALL BE PLACED IN A VANITY BASE CABINET WITH A COUNTERTOP.
 - SHALL HAVE A MIRROR AT THE WALL BEHIND THE LAVATORY.
 - SHALL HAVE A MIRROR MEDICINE CABINET AT THE SIDE WHEN DEPICTED WITH A RECTANGLE IN THE WALL.
 - TOILETS:
 - SHALL BE FLUSH TANK.
 - SHALL BE PLACED IN A SPACE WITH 30" CLEAR WIDTH.
 - SHALL HAVE 24" CLEAR IN FRONT OF THE FIXTURE.
 - BATHTUB/SOWER COMBINATIONS
 - BATHTUB SHALL BE PORCELAIN OVER CAST IRON.
 - PROVIDE FULL HEIGHT TILE WAINSCOT ON WALLS WITHIN TUB AREA.
 - PROVIDE SLIDING CLEAR TEMPERED GLASS TUB/SOWER ENCLOSURE OR EQUAL.
 - SHOWERS
 - FLOOR TO BE TILE OVER ASPHALTIC WATERPROOF MEMBRANE LINER, TYPICAL.
 - DRAIN TO BE LINEAR OR ROUND AS DEPICTED ON THE FLOOR PLAN.
 - ENTRY CURB SHALL BE 4" WIDE AND TALL WITH TILE FINISH, TYP.
 - SHALL HAVE A CLEAR TEMPERED GLASS SHOWER ENCLOSURE WITH OPENING AS SHOWN ON THE FLOOR PLAN OR EQUAL.
 - WALLS IN SHOWER AREA WILL HAVE A FULL HEIGHT TILE WAINSCOT.
 - SEATS SHOWN IN SHOWERS SHALL BE 16" HIGH AND WILL BE TILED TO MATCH THE WALLS.
 - EACH SHOWER SHALL HAVE A 12" WIDE X 16" HIGH NICHE FOR SOAP AND SHAMPOO BOTTLES IN A WAINSCOT WALL.
 - CLOSETS SHALL HAVE A SHELF AND POLE AS SHOWN ON THE FLOOR PLAN.

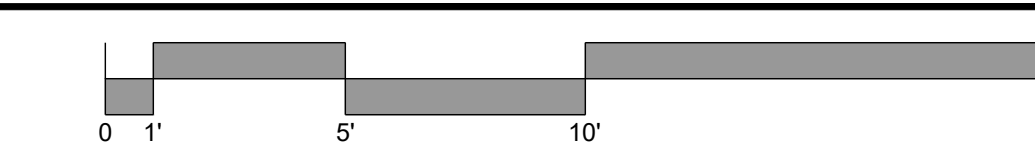

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM

1 BEDROOM PRADU
CITY: ANAHEIM

JOB: 202409R

FLOOR PLAN A + REVERSE A

a1.0

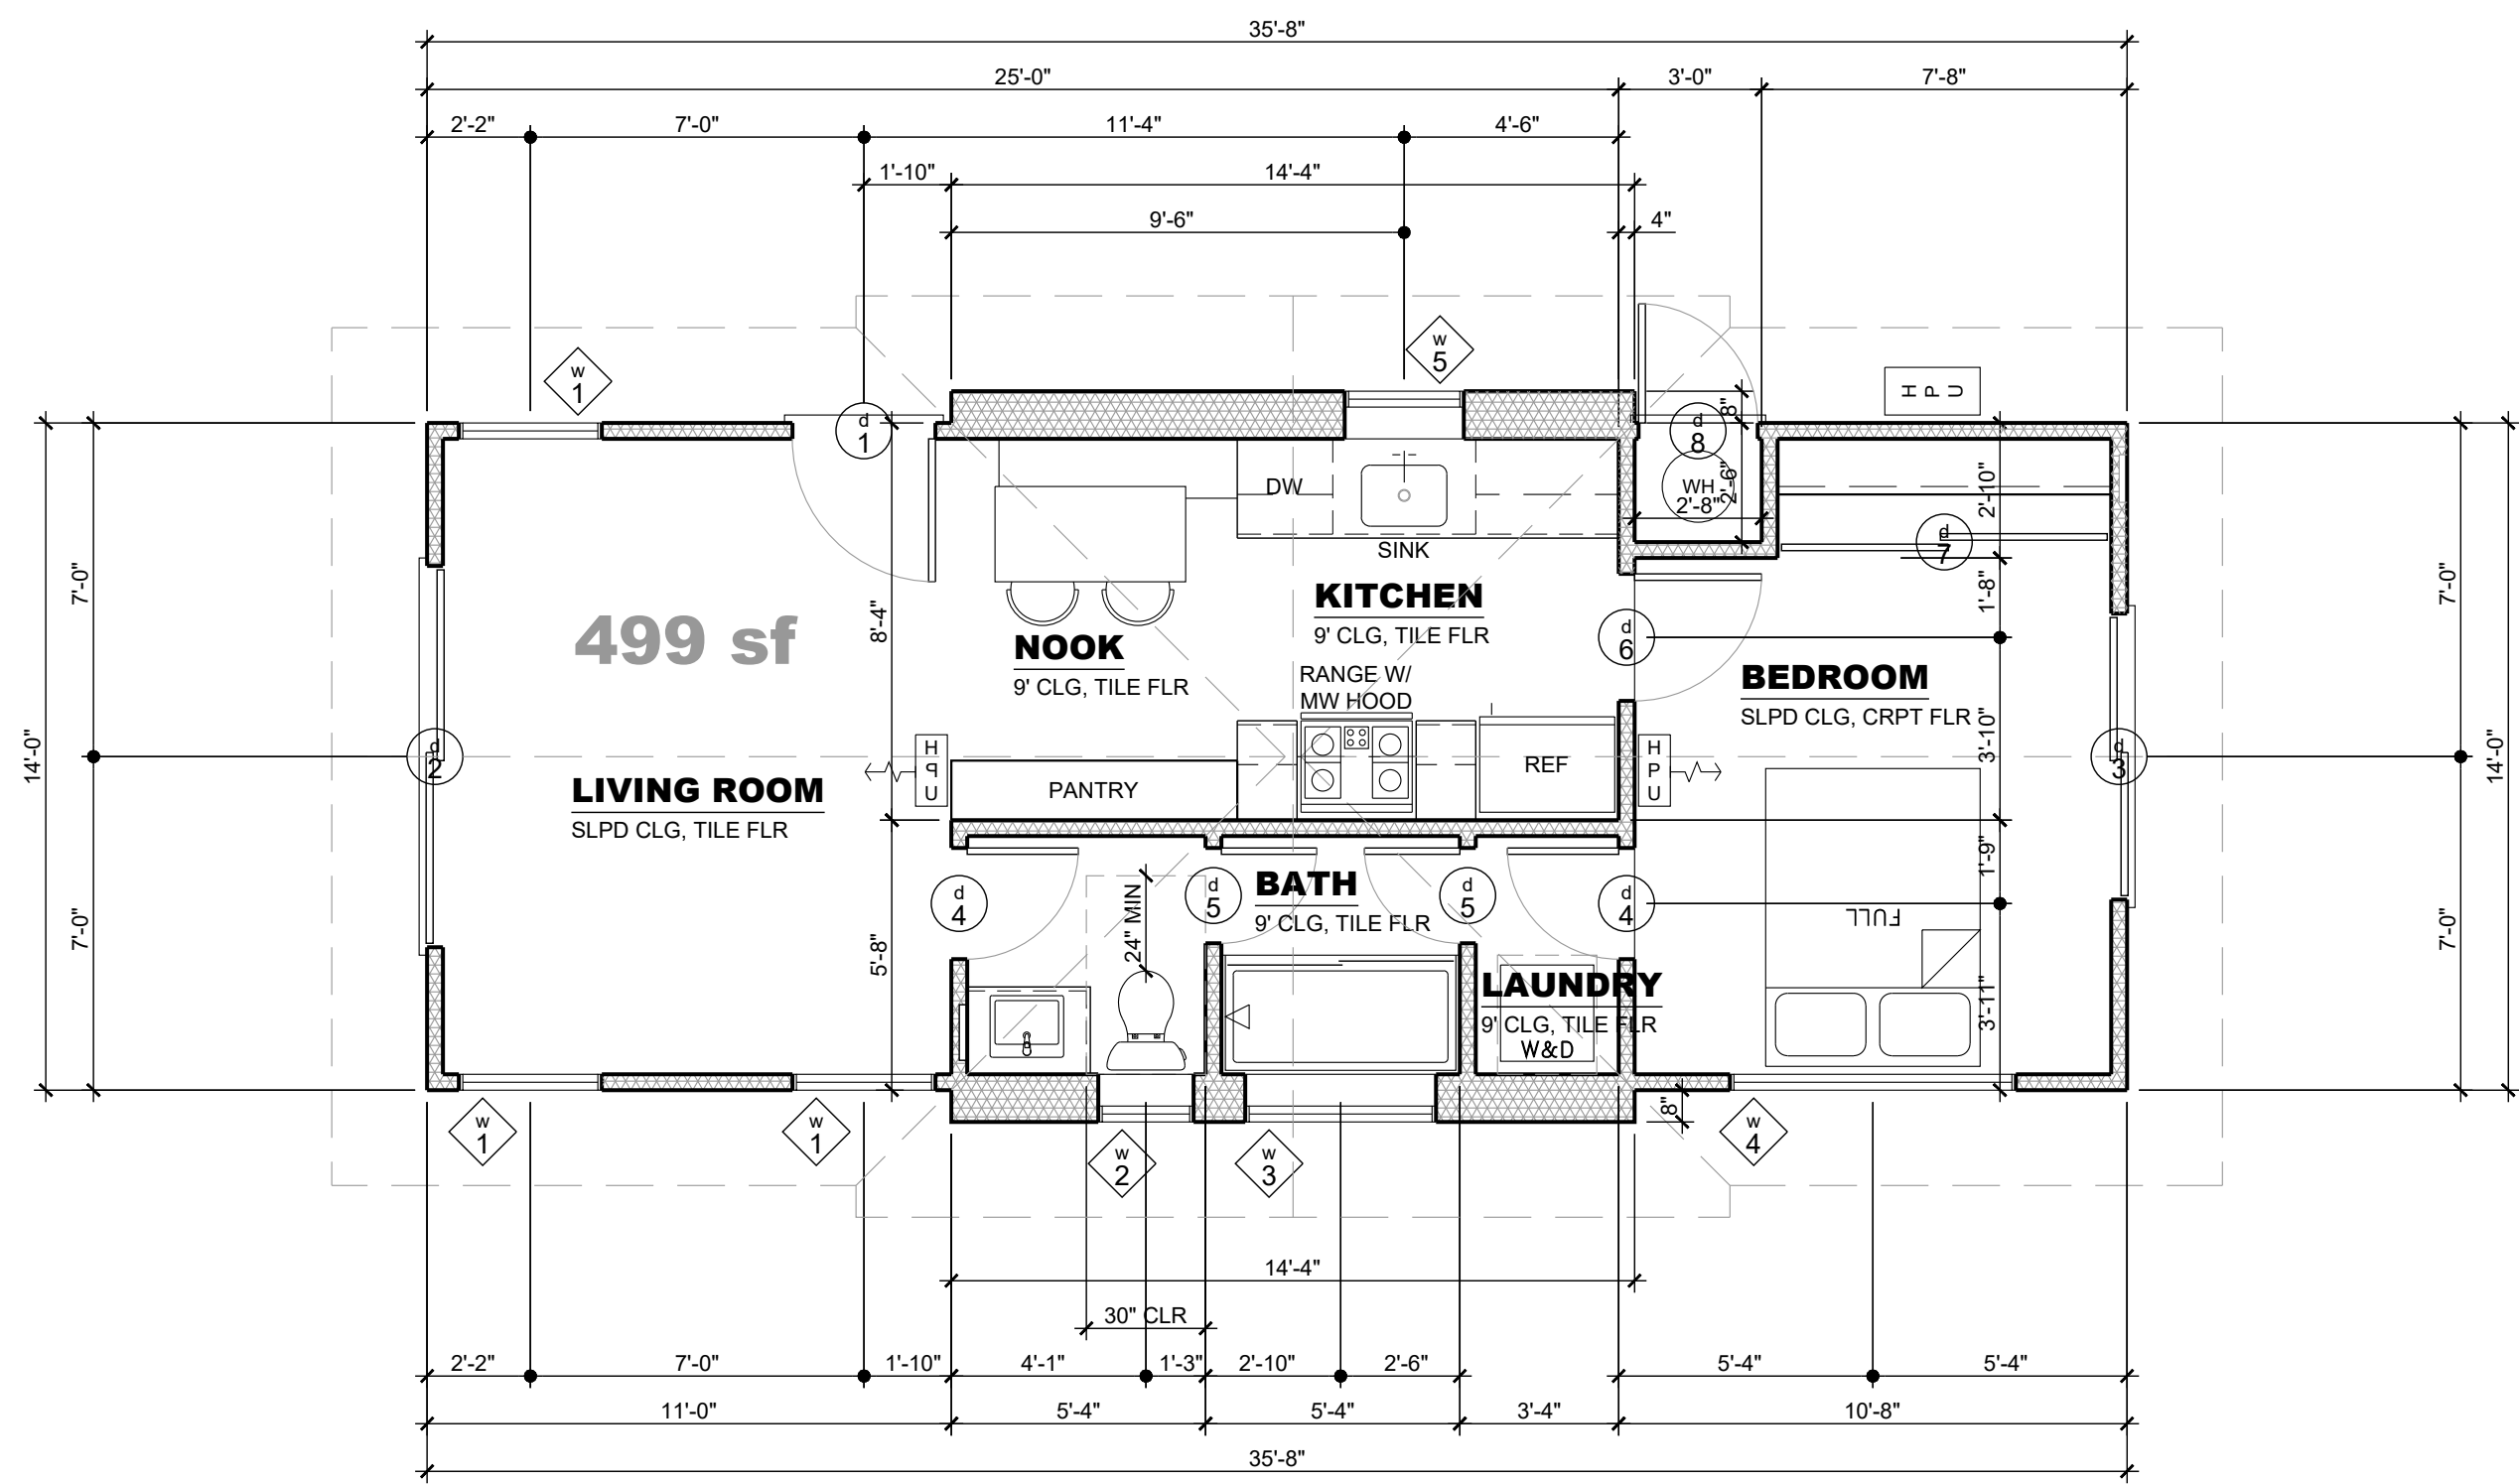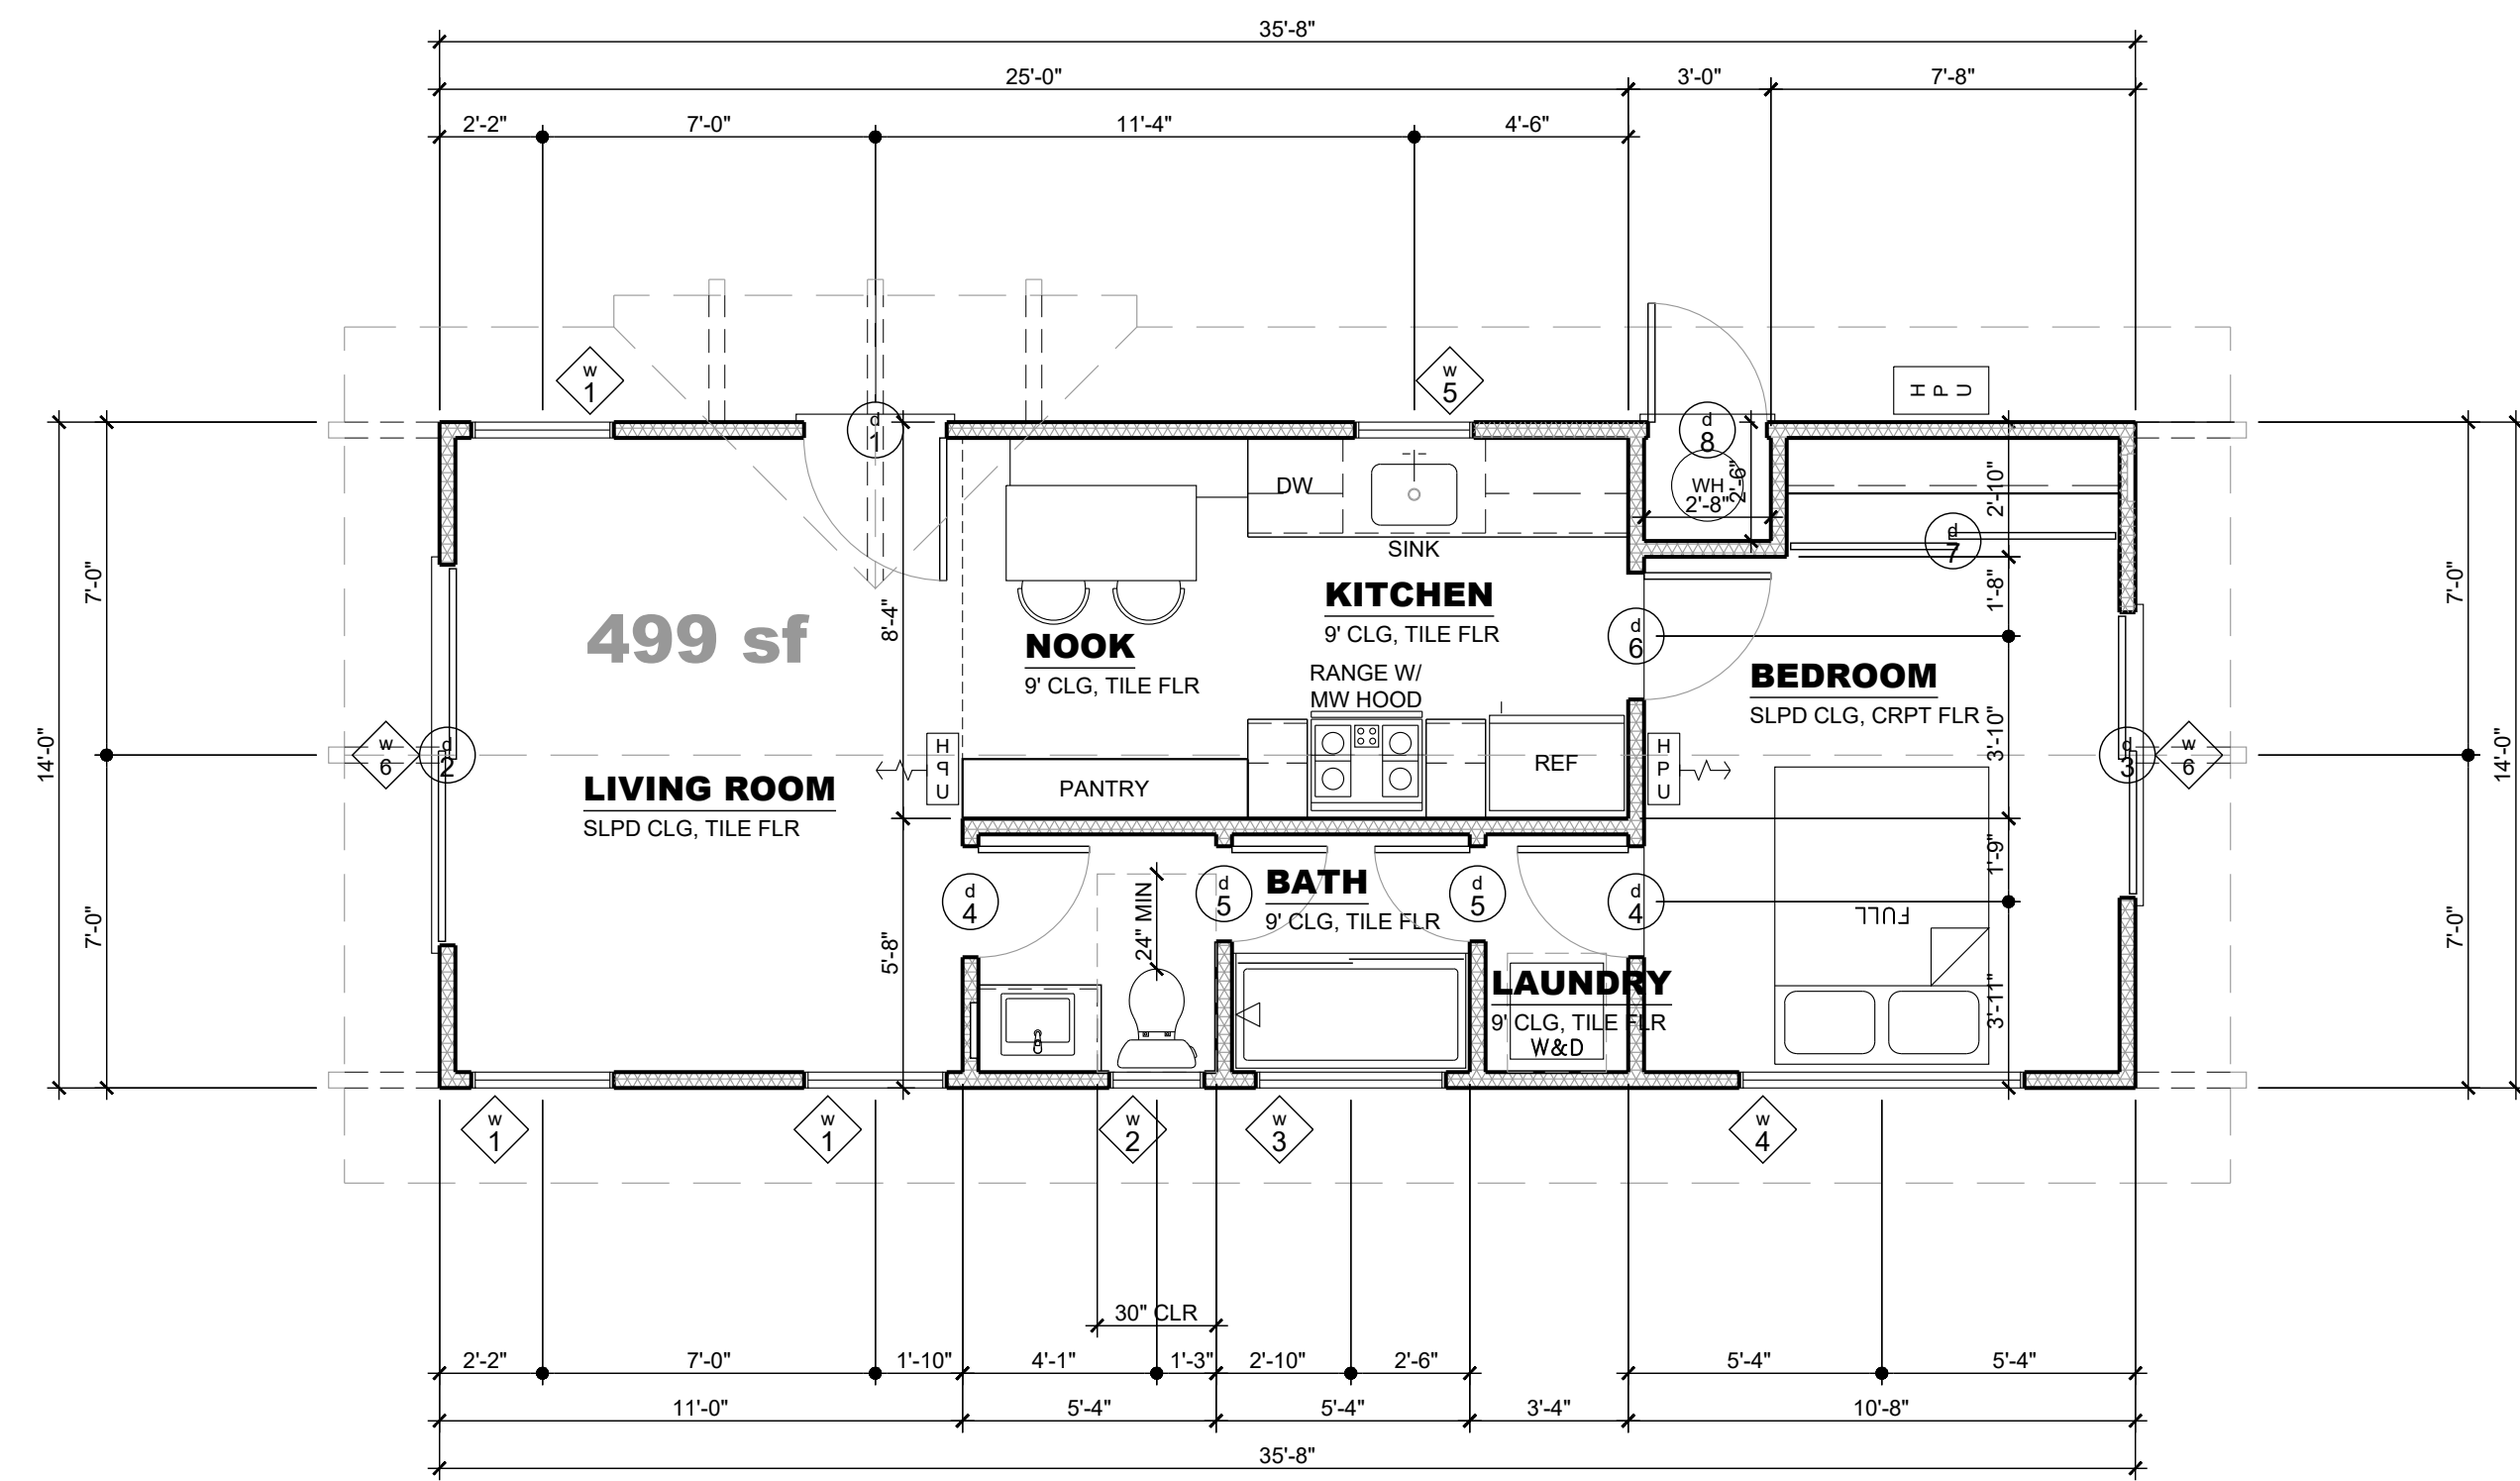


1 floor plan c
SCALE: 1/4" = 1'-0"

2 floor plan b
SCALE: 1/4" = 1'-0"

drawing:		drawing:		drawing:		drawing:	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
(N)	NEW		EXISTING FOOTING		BUILDING SECTION LETTER SHEET NUMBER		SHEAR PANEL LETTER SHEAR PANEL LENGTH
(E)	EXISTING		NEW FOOTING		WALL SECTION LETTER SHEET NUMBER		TRUSS NUMBER
	EXISTING WALL REMOVED		NORTH ARROW		DETAIL NUMBER SHEET NUMBER		STRUCTURAL GRID LINE
	EXISTING WALL TO REMAIN	+ 100.0	NEW POINT ELEVATION		INTERIOR ELEVATION		SHEAR DRAG LINE
	NEW 4" WALL	+ 100.0	EXISTING POINT ELEVATION		LEVEL CHANGE		PAD FOOTING
	NEW 6" WALL	--- 100.0	NEW CONTOUR		ROOM OR SPACE NUMBER		POST
	NEW 8" WALL	--- 100.0	EXISTING CONTOUR	ROOM 9' CLG. FLOORING	ROOM NAME CEILING HEIGHT, FLOORING		HOLD DOWN
	NEW 8" CMU WALL	---	PROPERTY LINE		WINDOW NUMBER		FACTORY BUILT SHEAR PANEL
	NEW DWELLING UNIT SEPARATION WALL	---	CENTER LINE		DOOR NUMBER		FLOOR JOISTS
	BEARING WALL	---	SET BACK LINE		REVISION NUMBER		CEILING JOISTS
	NON-BEARING WALL AT FRAMING PLANS		FLOOR MATERIAL CHANGE		KEYNOTE NUMBER		RAFTER OR TRUSS

floor plan notes:

- SEE LEGENDS TO THE LEFT FOR SYMBOLS RELATING TO THE FLOOR PLAN.
- SEE SHEET #0.1 FOR SCHEDULES RELATING TO THE FLOOR PLAN.
- THE KITCHEN SHALL HAVE UPPER CABINETS, BASE CABINETS, AND COUNTERTOPS AS DEPICTED ON THIS FLOOR PLAN AND IN THE INTERIOR ELEVATIONS.
 - LAVATORIES:
 - SHALL BE PLACED IN A VANITY BASE CABINET WITH A COUNTERTOP.
 - SHALL HAVE A MIRROR AT THE WALL BEHIND THE LAVATORY.
 - SHALL HAVE A MIRRORED MEDICINE CABINET AT THE SIDE WHEN DEPICTED WITH A RECTANGLE IN THE WALL.
 - TOILETS:
 - SHALL BE FLUSH TANK.
 - SHALL BE PLACED IN A SPACE WITH 30" CLEAR WIDTH.
 - SHALL HAVE 24" CLEAR IN FRONT OF THE FIXTURE.
 - BATHTUB/SOWER COMBINATIONS
 - BATHTUB SHALL BE PORCELAIN OVER CAST IRON.
 - PROVIDE FULL HEIGHT TILE WAINSCOT ON WALLS WITHIN TUB AREA.
 - PROVIDE SLIDING CLEAR TEMPERED GLASS TUB/SOWER ENCLOSURE OR EQUAL.
 - SHOWERS
 - FLOOR TO BE TILE OVER ASPHALTIC WATERPROOF MEMBRANE LINER, TYPICAL.
 - DRAIN TO BE LINEAR OR ROUND AS DEPICTED ON THE FLOOR PLAN.
 - ENTRY CURB SHALL BE 4" WIDE AND TALL WITH TILE FINISH, TYP.
 - SHALL HAVE A CLEAR TEMPERED GLASS SHOWER ENCLOSURE WITH OPENING AS SHOWN ON THE FLOOR PLAN OR EQUAL.
 - WALLS IN SHOWER AREA WILL HAVE A FULL HEIGHT TILE WAINSCOT.
 - SEATS SHOWN IN SHOWERS SHALL BE 16" HIGH AND WILL BE TILED TO MATCH THE WALLS.
 - EACH SHOWER SHALL HAVE A 12" WIDE X 16" HIGH NICHE FOR SOAP AND SHAMPOO BOTTLES IN A WAINSCOT WALL.
- CLOSETS SHALL HAVE A SHELF AND POLE AS SHOWN ON THE FLOOR PLAN.

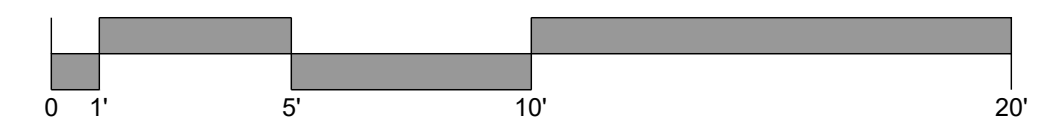

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM

1 BEDROOM PRADU

CITY: ANAHEIM

JOB: 202409R

FLOOR PLAN B + FLOOR PLAN C

a1.1

photovoltaic requirements:

2022 CALIFORNIA ENERGY CODE SECTION 150.1(c)14:
 ALL LOW-RISE RESIDENTIAL BUILDINGS SHALL HAVE A PHOTOVOLTAIC (PV) SYSTEM MEETING THE MINIMUM QUALIFICATION REQUIREMENTS AS SPECIFIED IN JOINT APPENDIX JA11, WITH ANNUAL ELECTRICAL OUTPUT EQUAL TO OR GREATER THAN THE DWELLING'S ANNUAL ELECTRICAL USAGE AS DETERMINED BY EQUATION 150.1-C:

$$EQUATION 150.1-C$$

$$ANNUAL PHOTOVOLTAIC ELECTRICAL OUTPUT$$

$$kW_{pv} = (CFA \times A) / 1000 + (ND_{well} \times X \times B)$$

WHERE:
 kW_{pv} = KWDC SIZE OF THE PV SYSTEM
 CFA = CONDITIONED FLOOR AREA
 ND_{well} = NUMBER OF DWELLING UNITS
 A = ADJUSTMENT FACTOR FROM TABLE 150.1-C
 B = DWELLING ADJUSTMENT FACTOR FROM TABLE 150.1-C

EXCEPTION 1 TO SECTION 150.1(C)14:
 NO PV SYSTEM IS REQUIRED IF THE EFFECTIVE ANNUAL SOLAR ACCESS IS RESTRICTED TO LESS THAN 80 CONTIGUOUS SQUARE FEET BY SHADING FROM EXISTING PERMANENT NATURAL OR MANMADE BARRIERS EXTERNAL TO THE DWELLING, INCLUDING BUT NOT LIMITED TO TREES, HILLS, AND ADJACENT STRUCTURES. THE EFFECTIVE ANNUAL SOLAR ACCESS SHALL BE 70 PERCENT OR GREATER OF THE OUTPUT OF AN UNSHADED PV ARRAY ON AN ANNUAL BASIS.

EXCEPTION 2 TO SECTION 150.1(C)14:
 IN CLIMATE ZONE 15, THE PV SYSTEM SIZE SHALL BE THE SMALLER OF A SIZE THAT CAN BE ACCOMMODATED BY THE EFFECTIVE ANNUAL SOLAR ACCESS OR A PV SYSTEM SIZE REQUIRED BY THE EQUATION 150.1-C, BUT NO LESS THAN 1.5 WATT DC PER SQUARE FOOT OF CONDITIONED FLOOR AREA.

EXCEPTION 3 TO SECTION 150.1(C)14:
 IN ALL CLIMATE ZONES, FOR DWELLING UNITS WITH TWO HABITABLE STORIES, THE PV SYSTEM SIZE SHALL BE THE SMALLER OF A SIZE THAT CAN BE ACCOMMODATED BY THE EFFECTIVE ANNUAL SOLAR ACCESS OR A PV SYSTEM SIZE REQUIRED BY THE EQUATION 150.1-C, BUT NO LESS THAN 1.0 WATT DC PER SQUARE FOOT OF CONDITIONED FLOOR AREA.

EXCEPTION 4 TO SECTION 150.1(C)14:
 IN ALL CLIMATE ZONES, FOR LOW-RISE RESIDENTIAL DWELLINGS WITH THREE HABITABLE STORIES AND SINGLE-FAMILY DWELLINGS WITH THREE OR MORE HABITABLE STORIES, THE PV SYSTEM SIZE SHALL BE THE SMALLER OF A SIZE THAT CAN BE ACCOMMODATED BY THE EFFECTIVE ANNUAL SOLAR ACCESS OR A PV SYSTEM SIZE REQUIRED BY THE EQUATION 150.1-C, BUT NO LESS THAN 0.8 WATT DC PER SQUARE FOOT OF CONDITIONED FLOOR AREA.

EXCEPTION 5 TO SECTION 150.1(C)14:
 FOR A DWELLING UNIT PLAN THAT IS APPROVED BY THE PLANNING DEPARTMENT PRIOR TO JANUARY 1, 2020 WITH AVAILABLE SOLAR READY ZONE BETWEEN 90 AND 200 SQUARE FEET, THE PV SYSTEM SIZE IS LIMITED TO THE LESSER OF THE SIZE THAT CAN BE ACCOMMODATED BY THE EFFECTIVE ANNUAL SOLAR ACCESS OR A SIZE THAT IS REQUIRED BY THE EQUATION 150.1-C.

EXCEPTION 6 TO SECTION 150.1(C)14:
 PV SYSTEM SIZES FROM EQUATION 150.1-C MAY BE REDUCED BY 25 PERCENT IF INSTALLED IN CONJUNCTION WITH A BATTERY STORAGE SYSTEM. THE BATTERY STORAGE SYSTEM SHALL MEET THE QUALIFICATION REQUIREMENTS SPECIFIED IN JOINT APPENDIX JA12 AND HAVE A MINIMUM CAPACITY OF 7.5 KWH.

residential ventilation requirements:

- KITCHENS REQUIRE EXHAUST FANS WITH A MINIMUM 100 CFM DUCTED TO THE EXTERIOR. DETAIL COMPLIANCE BY INCLUDING A COMPLYING EXHAUST FAN OR A DUCTED RANGE HOOD TO THE EXTERIOR. 3 SONES MAXIMUM.
- EACH BATHROOM CONTAINING A BATHTUB, SHOWER OR TUB/SHOWER COMBINATION SHALL BE MECHANICALLY VENTILATED FOR PURPOSES OF HUMIDITY CONTROL IN ACCORDANCE WITH THE CALIFORNIA MECHANICAL CODE, CHAPTER 4; AND THE CALIFORNIA GREEN BUILDING STANDARDS CODE, CHAPTER 4, DIVISION 4.5.
- BATHROOMS REQUIRE EXHAUST FANS (MINIMUM 50 CFM SWITCHED OR 20 CM CONTINUOUS) TO BE DUCTED TO THE EXTERIOR. A BATHROOM IS DEFINED AS A ROOM WITH A BATHTUB, SHOWER, OR SPA OR SOME SIMILAR SOURCE OF MOISTURE.
- RESIDENTIAL BATHROOM EXHAUST FANS SHALL BE ENERGY STAR RATED AND SHALL BE CONTROL BY A HUMIDISTAT CAPABLE OF AN ADJUSTMENT BETWEEN 50 AND 80% HUMIDITY. CALGREEN 4.506.1. EXCEPTION: CONTROL BY A HUMIDISTAT IS NOT REQUIRED IF THE BATHROOM EXHAUST FAN IS ALSO THE DWELLING WHOLE HOUSE VENTILATION. A) ALL FANS INSTALLED TO MEET ALL OF THE PRECEDING VENTILATION REQUIREMENTS MUST BE SPECIFIED AT A NOISE RATING OF A MAXIMUM 1 "SONE" (CONTINUOUS USE) OR 3 "SONE" (INTERMITTENT).
- EXHAUST DUCT SIZE, LENGTH AND OUTLET LOCATION FOR FANS AND HOODS TO BE NOTED ON THE PLANS.

electric:


- ✓ SELECTION
- NEW METER WITH _____ AMP PANEL
- SUBPANEL _____ AMP TO EXISTING _____ AMP MAIN PANEL
- DISTANCE TO CONNECTION = _____ FEET

CONTACT SDG&E REGARDING ELECTRIC SERVICE TO THIS DETACHED ADU. ANY EXISTING SERVICE UPGRADE OR NEW SERVICE FOR THE ADU WILL REQUIRE A SEPARATE PERMIT FROM THE CITY OF ENCINITAS.

SINGLE FAMILY DWELLING ELECTRICAL SERVICE LOAD CALCULATION	
OPTIONAL METHOD NEC 220-30	
As an alternative method, the STANDARD METHOD, found in ARTICLE 220 of the National Electric Code, may be used	
1. GENERAL LIGHTING LOADS	Dwelling 499 sq. ft. x 3 VA = 1500 VA Small appliance loads - 220-16(b) 1500 VA x 2 circuits = 3000 VA Laundry load - 220-16(b) 1500 VA x 1 circuit = 1500 VA General Lighting Total 6000 VA
2. COOKING EQUIPMENT LOADS - Nameplate Value	Range 5000 VA = 5000 VA Cooktop 5000 VA = 5000 VA Ovens 5000 VA = 5000 VA Cooking Equipment Total 15000 VA
3. ELECTRIC DRYER 220-18 (Nameplate, 5000 VA minimum)	Dryer 5000 VA = 5000 VA Dryer Total 5000 VA
4. FIXED APPLIANCE LOADS 230-30(b)	Dishwasher 1500 VA Disposal 1000 VA Compactor 1000 VA Water Heater 4500 VA Hydromassage Bathtub 1500 VA Microwave Oven 1500 VA Built-in Vacuum 1500 VA Fixed Appliances Total 12500 VA
5. OPTIONAL SUBTOTAL (Add all of the above totals)	Dryer 5000 VA Subtotal 24500 VA
6. APPLYING DEMAND FACTORS - TABLE 220-30	Optional Subtotal (from line 5) First 10,000 VA x 100% = 10,000 VA Remaining 14,500 VA x 40% = 5800 VA Total 15,800 VA
7. HEATING OR AC LOAD - TABLE 220-30	Larger of the Heating or AC Load = 8000 VA
8. OPTIONAL LOADS TOTAL (Add totals from lines 6 and 7)	15,800 VA + 8,000 VA = 23,800 VA
9. MINIMUM SERVICE SIZE = $\frac{Optional\ Loads\ Total}{0.8}$	23,800 VA / 0.8 = 29,750 VA 99 Ampere

utility plan notes:

- SEE LEGENDS BELOW FOR SYMBOLS RELATING TO THE UTILITY PLAN.
- SEE SHEET #0.1 FOR SCHEDULES RELATING TO THE UTILITY PLAN.
- RECEPTACLE OUTLET LOCATION PER NEC ARTICLE 210.52.
- GFCI PROTECTED OUTLETS FOR LOCATIONS DESCRIBED IN NEC 210.8(A): LAUNDRY AREAS, KITCHEN DISHWASHERS, KITCHENS, GARAGES, BATH ROOMS, OUTDOORS, WITHIN 6' OF A SINK, ETC. RECEPTACLE OUTLET LOCATION PER NEC ARTICLE 210.52.
- BATH RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 20 AMP CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS CIRCUIT MAY SERVE MULTIPLE BATHS (NEC ART. 210-52(D)).
- TAMPER RESISTANT RECEPTACLES ARE REQUIRED FOR ALL LOCATIONS DESCRIBED IN 210.52 (IE ALL RECEPTACLES IN A DWELLING).
- WEATHER RESISTANT TYPE FOR RECEPTACLES INSTALLED IN DAMP OR WET LOCATIONS.
- ARC-FAULT PROTECTION FOR ALL OUTLETS (NOT JUST RECEPTACLES) LOCATED IN ROOMS DESCRIBED IN NEC 210.12(A): KITCHENS, LAUNDRY AREAS, FAMILY, LIVING BEDROOMS, DINING, HALLS, ETC.
- OUTLETS MUST BE WITHIN 6FT OF ANY OPENING AND NOT TO EXCEED 12FT APART. ANY ISOLATED WALL 2FT OR WIDER TO HAVE OUTLET(S).
- ALL EXTERIOR LIGHTING SHALL BE HIGH EFFICACY, OAE
- RECESSED LIGHTS SHOWN IN SLOPED CEILINGS SHALL BE A MODEL DESIGNED TO PROVIDE A PERPENDICULAR LIGHT SOURCE IN A SLOPED CEILING.
- PROVIDE UFER GROUND AT ELECTRIC SERVICE LOCATION IN FOUNDATION. GROUND SHALL BE A 20' LONG #4 REINFORCING BAR, OAE.
- PROVIDE SMOKE DETECTORS IN EACH SLEEPING ROOM AND AT A POINT CENTRALLY LOCATED IN AN AREA GIVING ACCESS TO EACH SEPARATE SLEEPING AREA. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND SHALL BE EQUIPPED WITH A BATTERY BACKUP. SMOKE DETECTORS MAYBE SOLELY BATTERY POWERED WHEN INSTALLED IN EXISTING BUILDINGS. (CRC §R314.6)
- WHERE MORE THAN ONE COMBINATION SMOKE/CARBON MONOXIDE DETECTOR IS REQUIRED, THE ALARM SHALL BE INTERCONNECTED IN A MANNER THAT ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL THE ALARMS IN THE RESIDENCE.
- CONTROL VALVES IN BATHTUBS, WHIRLPOOL BATHTUBS, SHOWERS AND TUB-SHOWER COMBINATIONS MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES. CPC SECTION 414.5 AND 418.0.
- ALL HOT WATER PIPING SIZED 3/4" OR LARGER IS REQUIRED TO BE INSULATED AS FOLLOWS: 1" PIPE SIZE OR LESS: 1" THICK INSULATION; LARGER PIPE SIZES REQUIRE 1 1/2" THICK INSULATION. NOTE: IN ADDITION, THE 1/2" SIZE HOT WATER PIPE TO THE KITCHEN SINK IS REQUIRED TO BE INSULATED. ES 150.0(J)2
- SEE T24 DOCUMENTATION SHEET FOR MORE INFORMATION ON WATER HEATING, SPACE HEATING, AND COOLING EQUIPMENT SPECIFICATIONS.
- SHOW THE LOCATIONS OR PROVIDE NOTES OF ALL CARBON MONOXIDE ALARMS TO MEET THE REQUIREMENTS OF CALIFORNIA RESIDENTIAL CODE SECTION R315.
 - INSTALLED IN DWELLING UNITS AND IN SLEEPING UNITS WITHIN WHICH FUEL-BURNING APPLIANCES ARE INSTALLED AND IN DWELLING UNITS THAT HAVE ATTACHED GARAGES.
 - WHERE MORE THAN ONE CARBON MONOXIDE ALARM IS REQUIRED TO BE INSTALLED THE ALARM SHALL BE INTERCONNECTED IN A MANNER THAT ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL THE ALARMS IN THE INDIVIDUAL UNIT.
 - WHERE AREAS OF NO CONSTRUCTION IS TAKING PLACE CARBON MONOXIDE DETECTORS CAN BE SOLELY BATTERY POWERED
- CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING IS SERVED FROM A COMMERCIAL SOURCE AND, WHERE PRIMARY POWER IS INTERRUPTED, SHALL RECEIVE POWER FROM A BATTERY. WIRING SHALL BE PERMANENT AND WITHOUT A DISCONNECTING SWITCH OTHER THAN THOSE REQUIRED FOR OVER-CURRENT PROTECTION.
- SHOW THE LOCATIONS OR PROVIDE NOTES OF ALL SMOKE ALARMS MEETING THE REQUIREMENTS OF CRC SECTION R314.
 - ON THE CEILING OR WALL OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF BED ROOMS.
 - IN EACH ROOM USED FOR SLEEPING PURPOSES.
 - IN EACH STORY WITHIN A DWELLING UNIT, INCLUDING BASEMENTS.
 - IN DWELLING UNITS WITH SPLIT LEVELS AND WITHOUT AN INTERVENING DOOR BETWEEN THE ADJACENT LEVELS. A SMOKE ALARM INSTALLED ON THE UPPER LEVEL SHALL SUFFICE FOR THE ADJACENT LOWER LEVEL PROVIDED THAT THE LOWER LEVEL IS LESS THAN ONE FULL STORY BELOW THE UPPER LEVEL.
 - WHERE AREAS OF NO CONSTRUCTION IS TAKING PLACE SMOKE DETECTORS CAN BE SOLELY BATTERY POWERED ONLY.

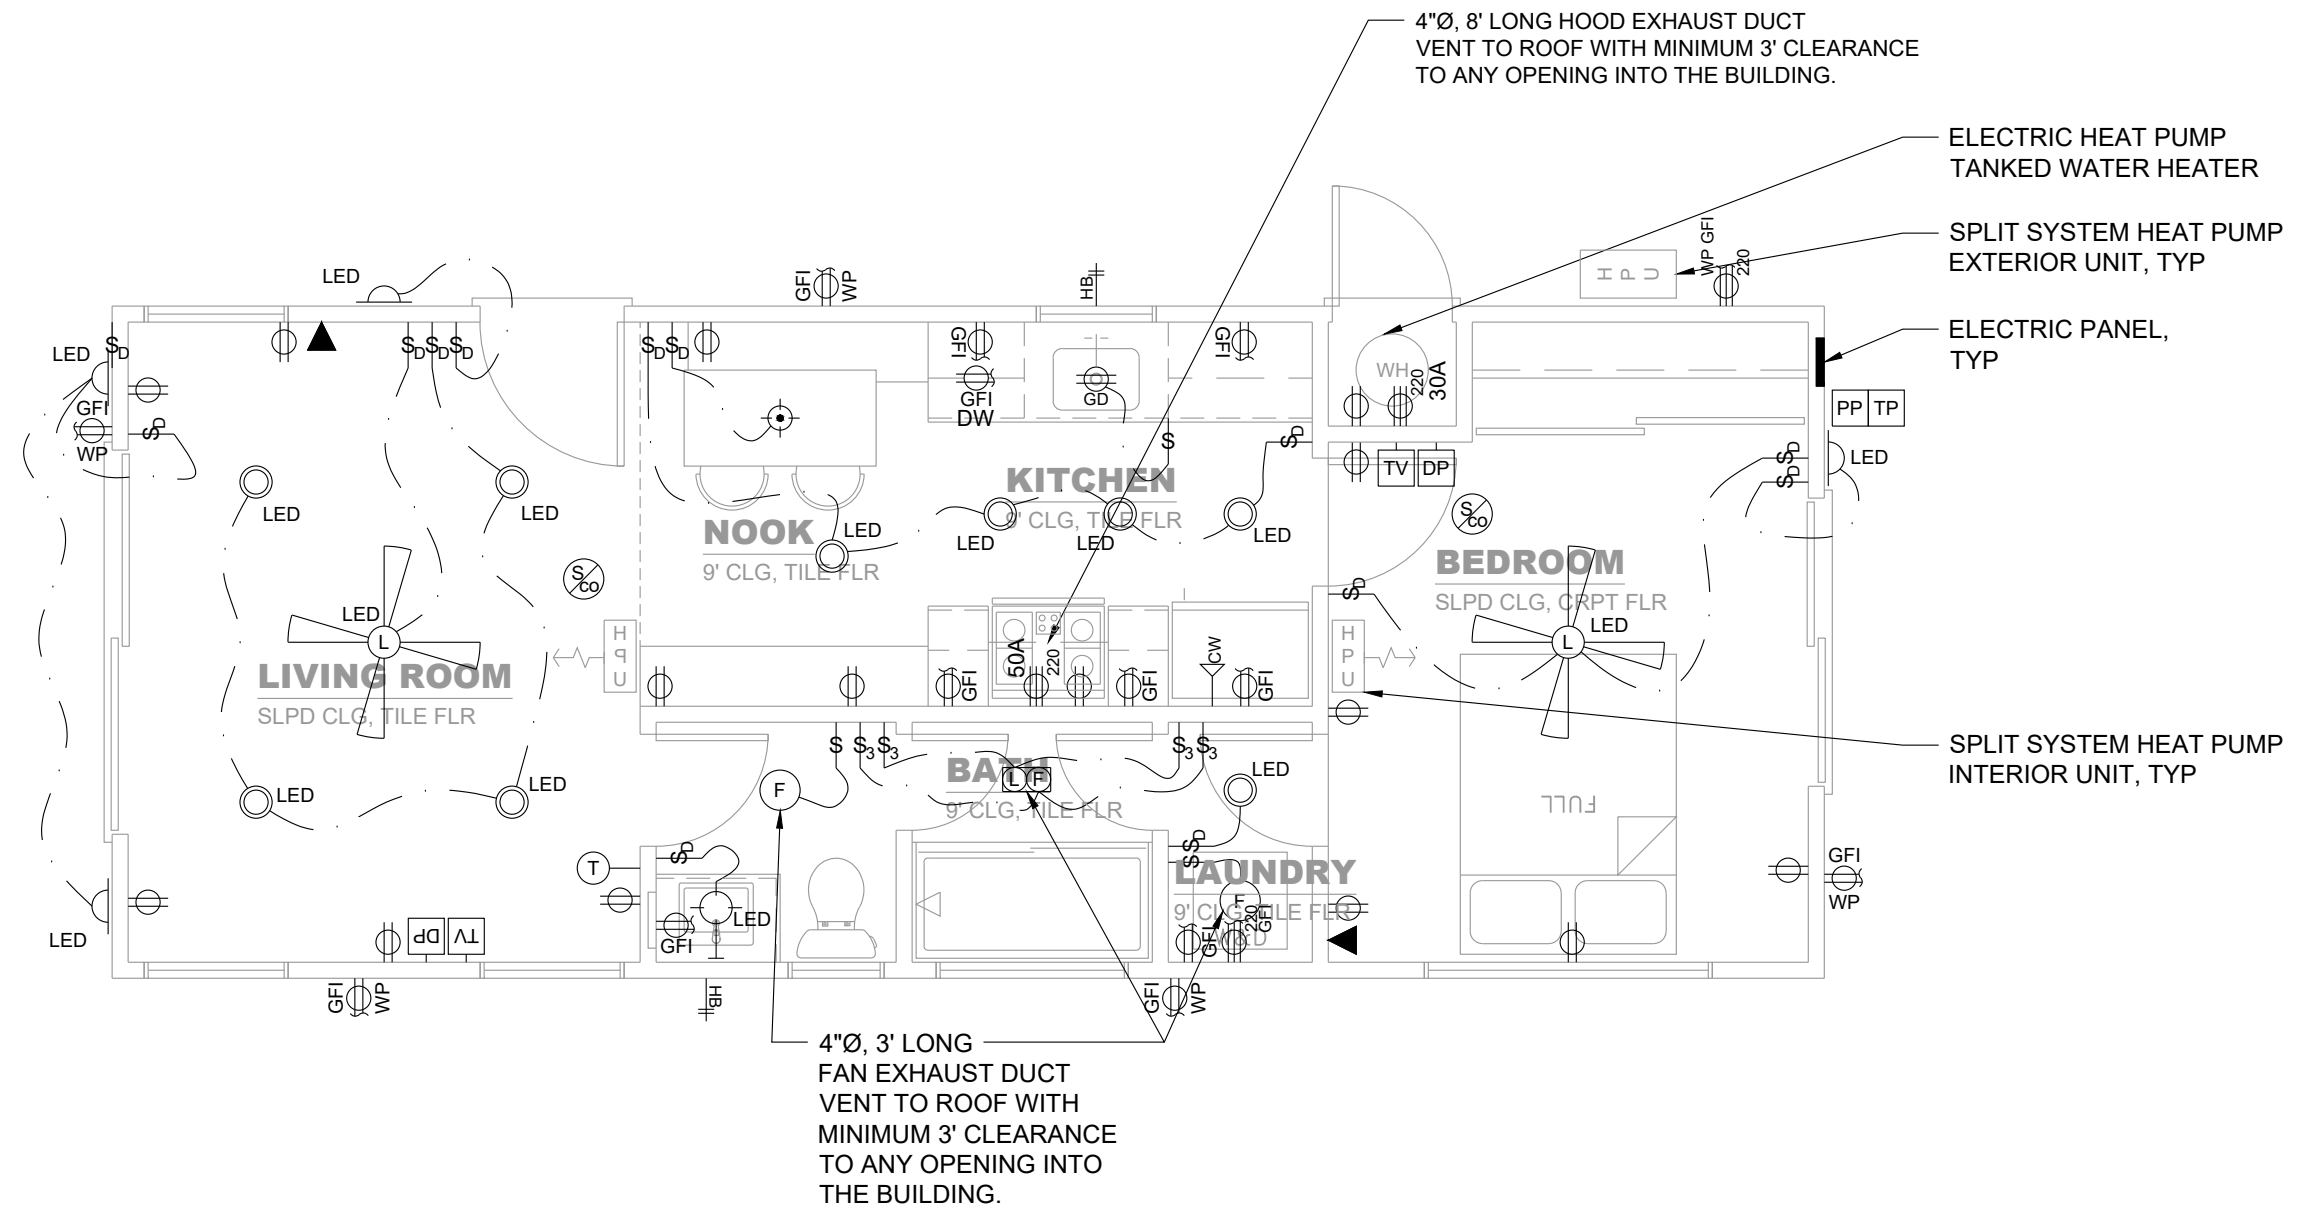

PREPARER SIGNATURE


FOR CITY STAMPS

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
 682 SECOND ST
 ENCINITAS, CA
 (760) 753 2464
 DZNPARTNERS.COM

1 utility plan

SCALE: 1/4" = 1'-0"

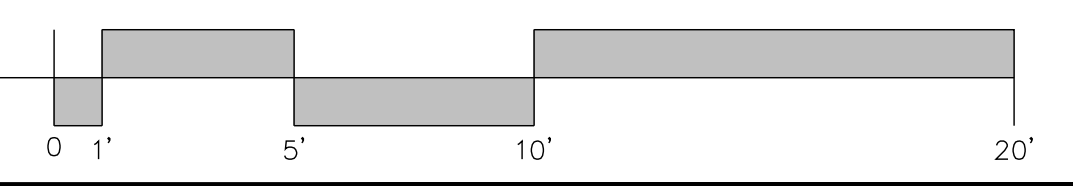

electrical:		electrical:		electrical:		plumbing:		plumbing:		plumbing:		mechanical:		mechanical:		media+safety:		media+safety:	
SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION	SYMBOL =	DESCRIPTION
LED	LIGHT EMITTING DIODE	\$D	DIMMER SWITCH	LHF	LED LIGHT/HEAT LAMP/FAN COMBO	WM	WATER METER	FS	FIRE SPRINKLER	TM	TOILET - WALL MOUNT	SP	SPLIT SYSTEM HEAT PUMP EXTERIOR UNIT	RA	RIGID SUPPLY AIR DUCT	ALARM	ALARM SOURCE	DB	DOORBELL CHIMES
E	ELECTRICAL METER	\$K	KEY OPERATED SWITCH	CSM	CEILING SURFACE MOUNT FIXTURE	FWM	FIRE WATER METER	SD	ROUND SHOWER DRAIN	F	FAUCET	IPU	SPLIT SYSTEM HEAT PUMP INTERIOR UNIT	RD	RIGID RETURN AIR DUCT	AUDIO	AUDIO SOURCE	DB	DOORBELL TRANSFORMER
I	ELECTRICAL PANEL	\$WP	WEATHERPROOF SWITCH	WMF	WALL MOUNTED FIXTURE	WH	TANK WATER HEATER	LD	LINEAR SHOWER DRAIN	P	PEDESTAL SINK	T	THERMOSTAT	FS	FLEXIBLE SUPPLY AIR DUCT	DATA	DATA SOURCE	A	ALARM SYSTEM PAD
DO	DUPLEX OUTLET	\$VS	VACANCY SENSOR SWITCH	HFX	HANGING FIXTURE	HPWH	ELECTRIC HEAT PUMP WATER HEATER	CO	CLEAN OUT	B	BATH SINK	SA	SUPPLY AIR WALL REGISTER	FE	FIRE EXTINGUISHER	PP	PHONE PANEL	CO	CARBON MONOXIDE DETECTOR
HO	HALF HOT DUPLEX OUTLET	D	DOOR OPERATED SWITCH	WSC	WALL SCIENCE	WH	TANKLESS WATER HEATER	FD	FLOOR DRAIN	BATHTUB	BATHTUB	CA	SUPPLY AIR CEILING REGISTER	VM	VACUUM MOTOR	TP	TELEVISION PANEL	S	SMOKE DETECTOR
QO	QUADRAPLEX OUTLET	F	VENT FAN	RCF	RECESSED CEILING FIXTURE	WC	WATER CONDITIONER	FS	FLOOR SINK	FBT	FREESTANDING BATHTUB	FR	SUPPLY AIR FLOOR REGISTER	V	VACUUM OUTLET	VP	VIDEO PANEL	SCD	SMOKE & CARBON MONOXIDE DETECTOR
GFI	GROUND FORCE OUTLET	IAQF	INDOOR AIR QUALITY FAN	RCWF	RECESSED CEILING WALL WASH FIXTURE	WSO	WATER SERVICE SHUTOFF	DRD	DECK OR ROOF DRAIN	BHS	BAR OR HAND SINK	RA	RETURN AIR WALL REGISTER	DV	DRYER VENT	TV	CABLE TELEVISION JACK	ELF	EMERGENCY LIGHT FIXTURE
WP	WATERPROOF GFI OUTLET	FH	WHOLE HOUSE FAN	RM	RECESSED MOISTURE RESISTANT CEILING FIXTURE	HBB	HOSE BIB	OS	OVERFLOW SCUPPER	S	SINGLE SINK	RCR	RETURN AIR CEILING REGISTER	FV	FAN VENT	DP	DATAPORT NETWORK JACK	EXIT	ILLUMINATED EXIT SIGN
IO	IN-FLOOR OUTLET	H	HEAT LAMP	F	FLOOD FIXTURE	CWV	COLD WATER VALVE	DRD+OS	DECK OR ROOF DRAIN + OVERFLOW SCUPPER	DS	DOUBLE SINK	RF	RETURN AIR FLOOR REGISTER	R	RANGE / OVEN VENT	TJ	TELEPHONE JACK	SP	SPEAKER
GD	GARBAGE DISPOSAL OUTLET	J	JUNCTION BOX	TLF	TRACK LIGHT FIXTURE	RP	RECESSED PLUMBING	DS	DOWNSPOUT	TS	TRIPLE SINK	RA	RETURN AIR WALL REGISTER	V	VACUUM OUTLET	VC	VIDEO CAMERA		
DG	DEDICATED GROUND OUTLET	L	LIGHT	FTF	FLOURESCENT TUBE FIXTURE	SH	SHOWERHEAD	U	URINAL	AS	APRON SINK	OV	OVERHEAD SHOWERHEAD	TO	TOILET - FLOOR MOUNT				
220	220V OUTLET	M	MOTION DETECTOR	ULCF	LED UNDERCABINET FIXTURE	OSH	OVERHEAD SHOWERHEAD	B	BIDET										
WP GFI 220	WATERPROOF 220V OUTLET	P	PHOTOELECTRIC SENSOR	CFWL	CEILING FAN WITH LIGHT	AS	ADJUSTABLE SHOWERHEAD												
\$	1 WAY SWITCH	HXF	HEAT LAMP/FAN COMBO	SL	STEP LIGHT														
\$3	3 WAY SWITCH	LXF	LED LIGHT/FAN COMBO	GL	GRID CEILING LIGHT														

1 BEDROOM PRADU

CITY: ANAHEIM

JOB: 202409R


UTILITY PLAN

a2.0



roof plan notes:

1. ALL ROOFING SHALL BE CLASS A RATED.
2. ROOFING SELECTION PER ROOF MATERIAL CHECKLIST ON SHEET #0.1.
3. ATTIC PROPOSED OF 196 sf
ATTIC VENTING REQUIRED: 196 sf / 150 = 1.31 sf VENT AREA
ATTIC VENTING PROVIDED: 2 sf [4 O'HAGIN VENTS @ 1/2 sf EACH]
4. IF THE ADU IS IN THE VHFHSZ THE O'HAGIN ROOF VENTS SHALL BE O'HAGIN FIRE & ICE@ LINE - FLAME AND EMBER RESISTANT ROOF VENTS
5. WHERE NO ATTIC IS PROPOSED DETAILS 86, 87 & 88/60.4 PROVIDE INSULATION ALTERNATIVES.



FOR CITY STAMPS

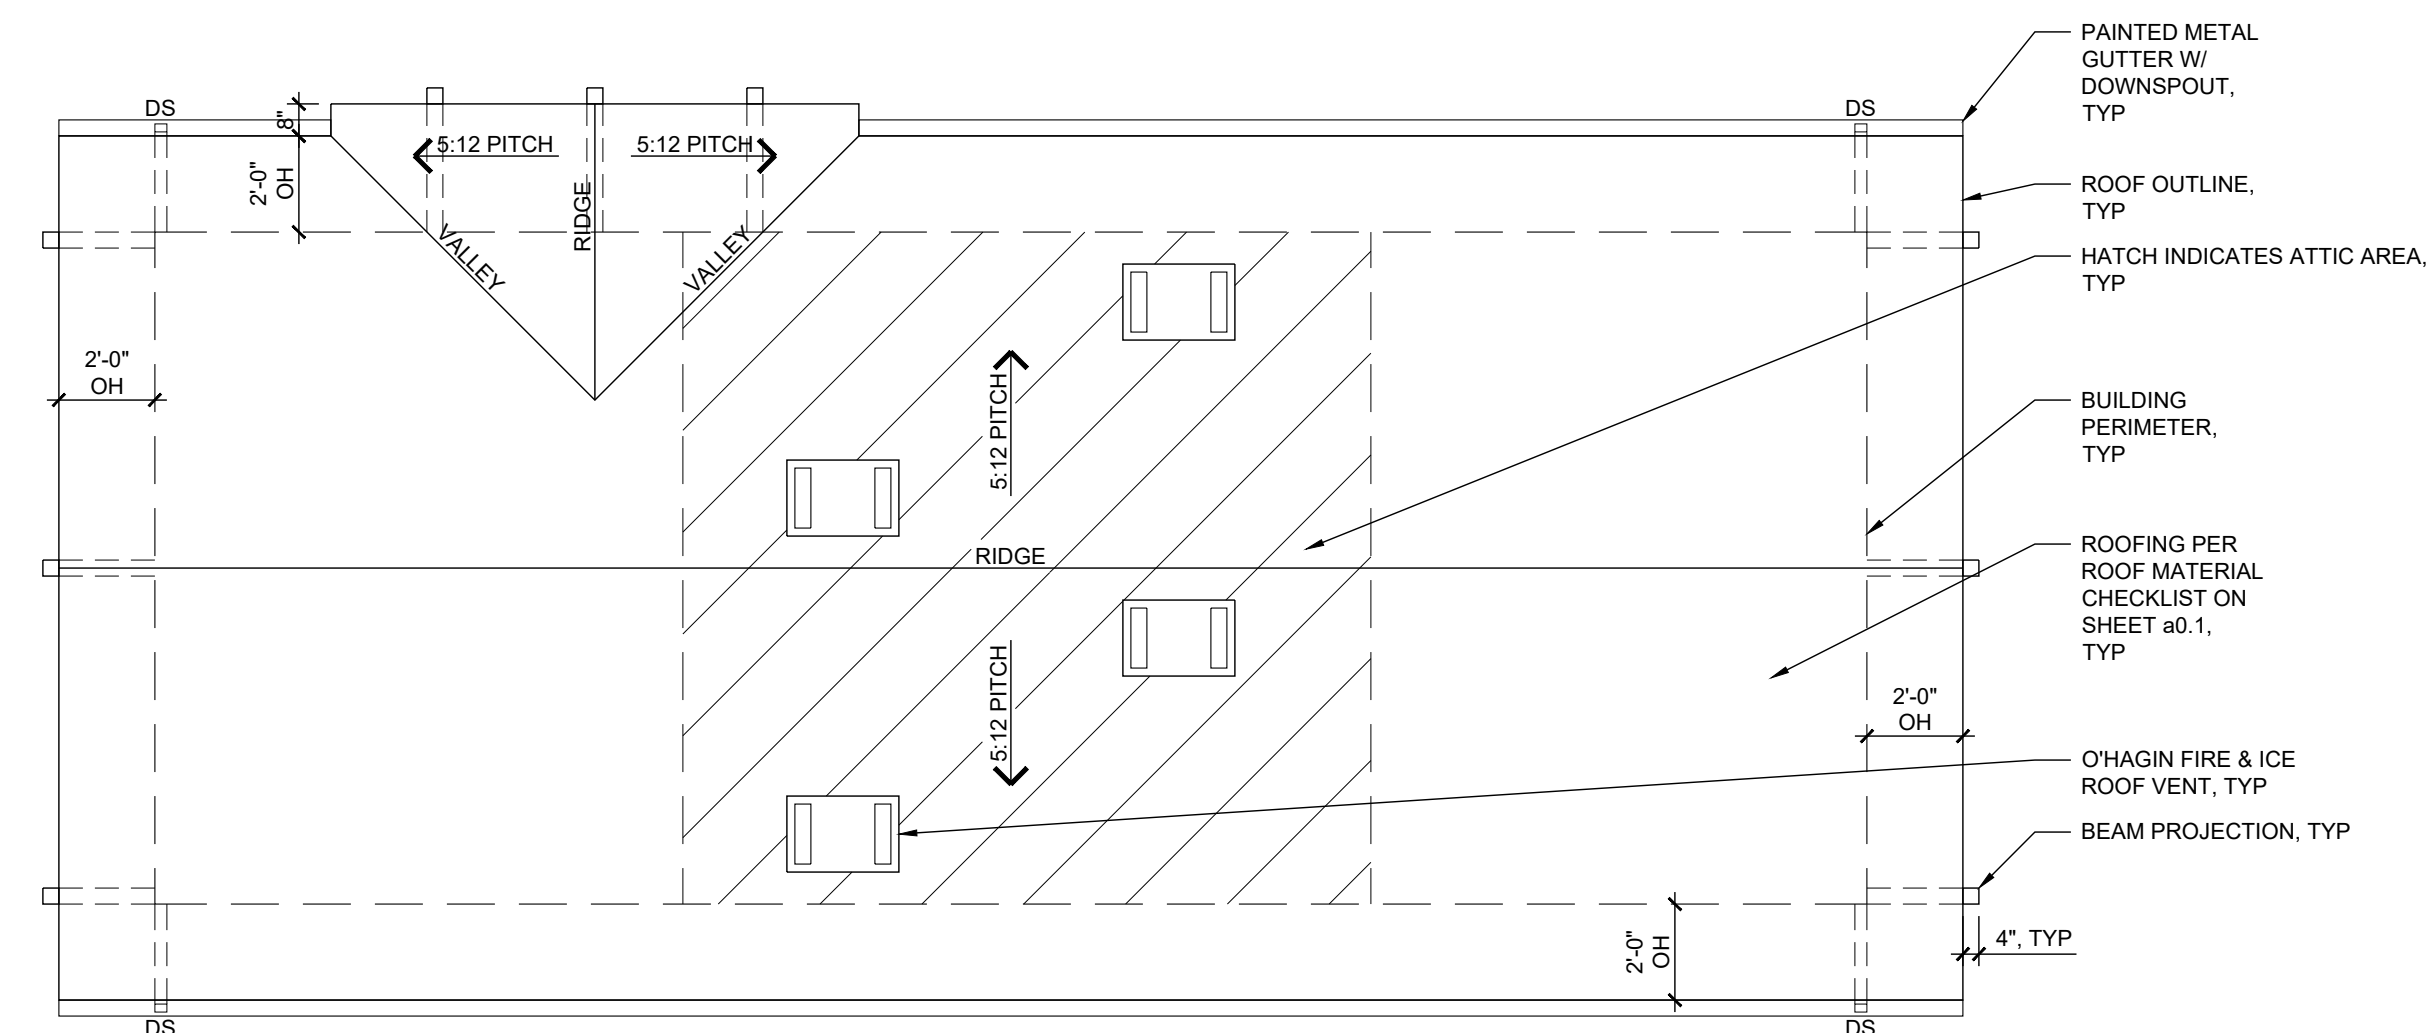


1 roof plan c
SCALE: 1/4" = 1'-0"

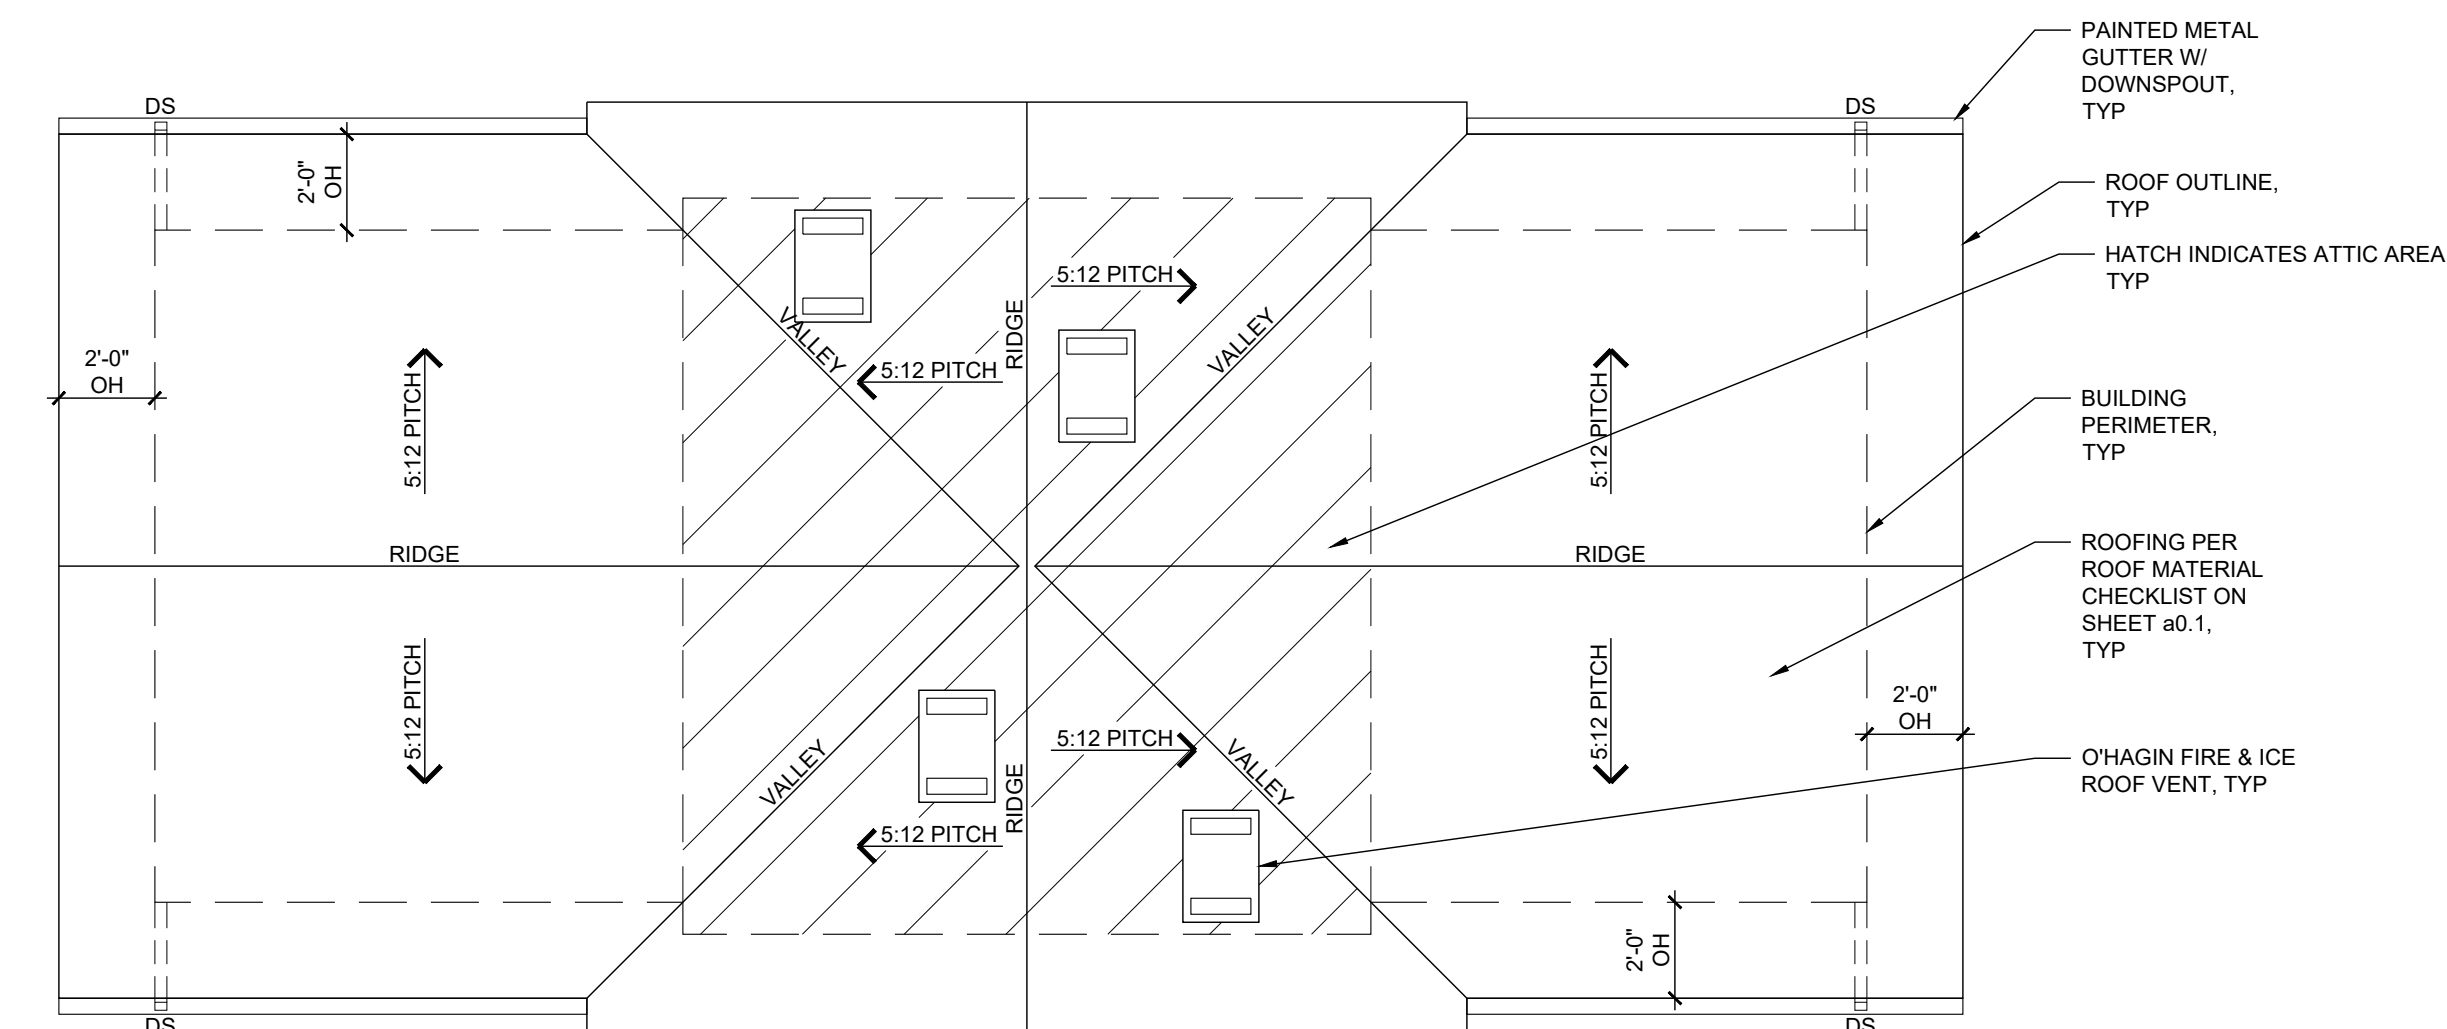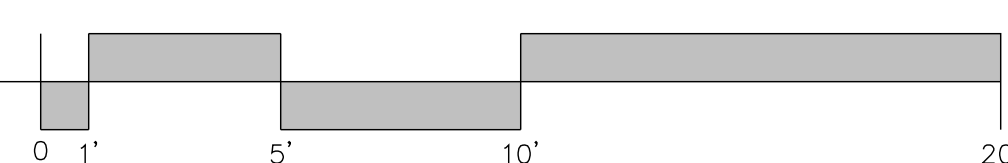

2 roof plan b
SCALE: 1/4" = 1'-0"

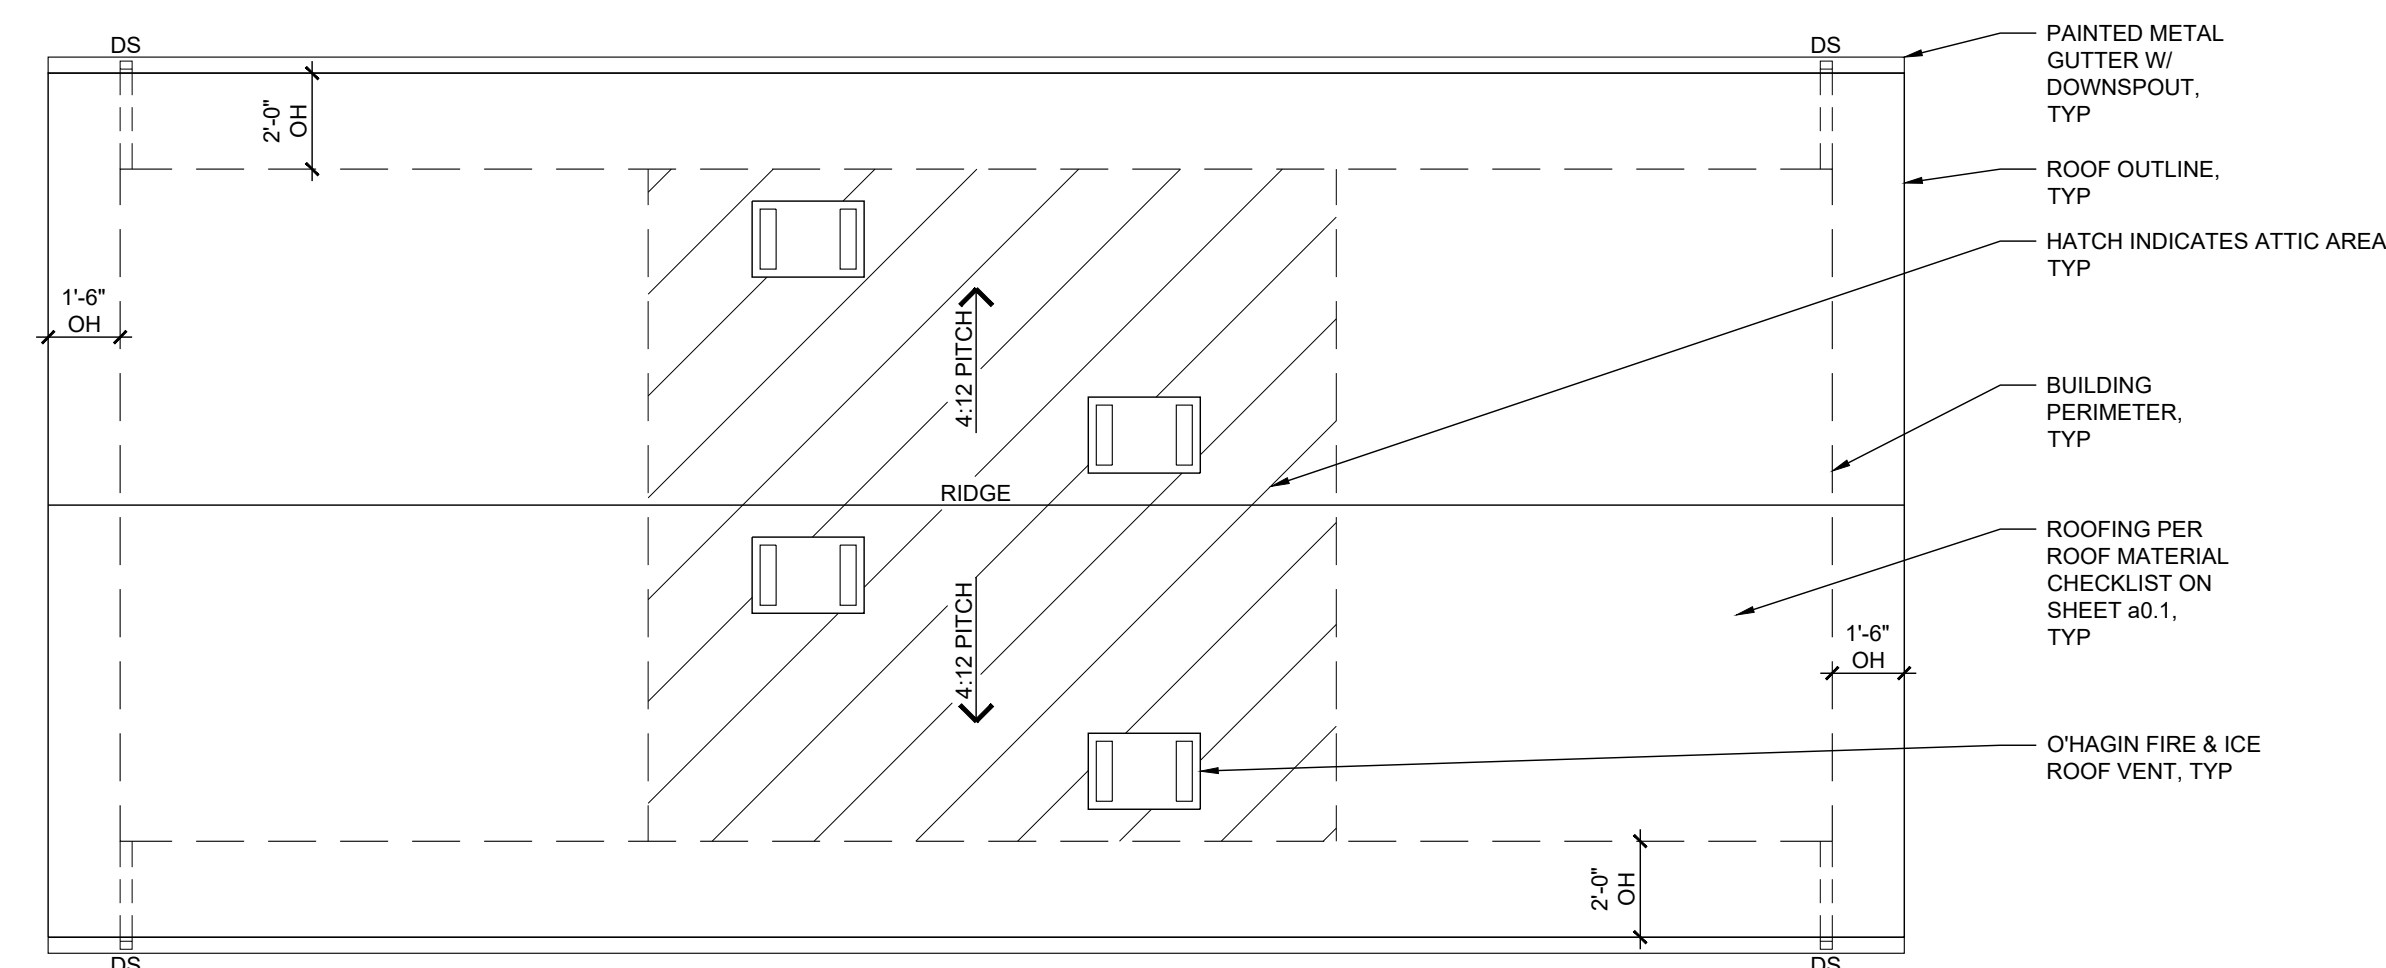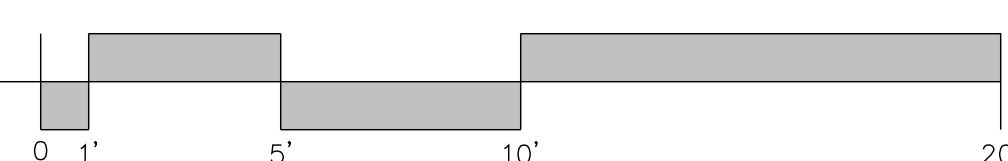

3 roof plan a
SCALE: 1/4" = 1'-0"

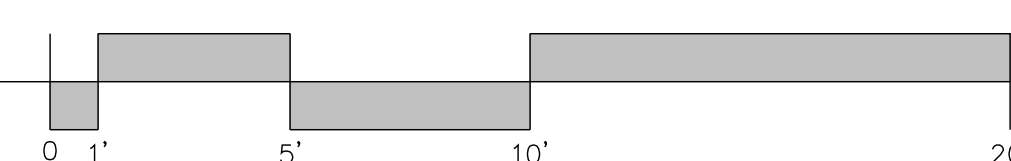

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


1 BEDROOM PRADU

CITY: ANAHEIM



JOB: 202409R

ROOF PLANS


a3.0

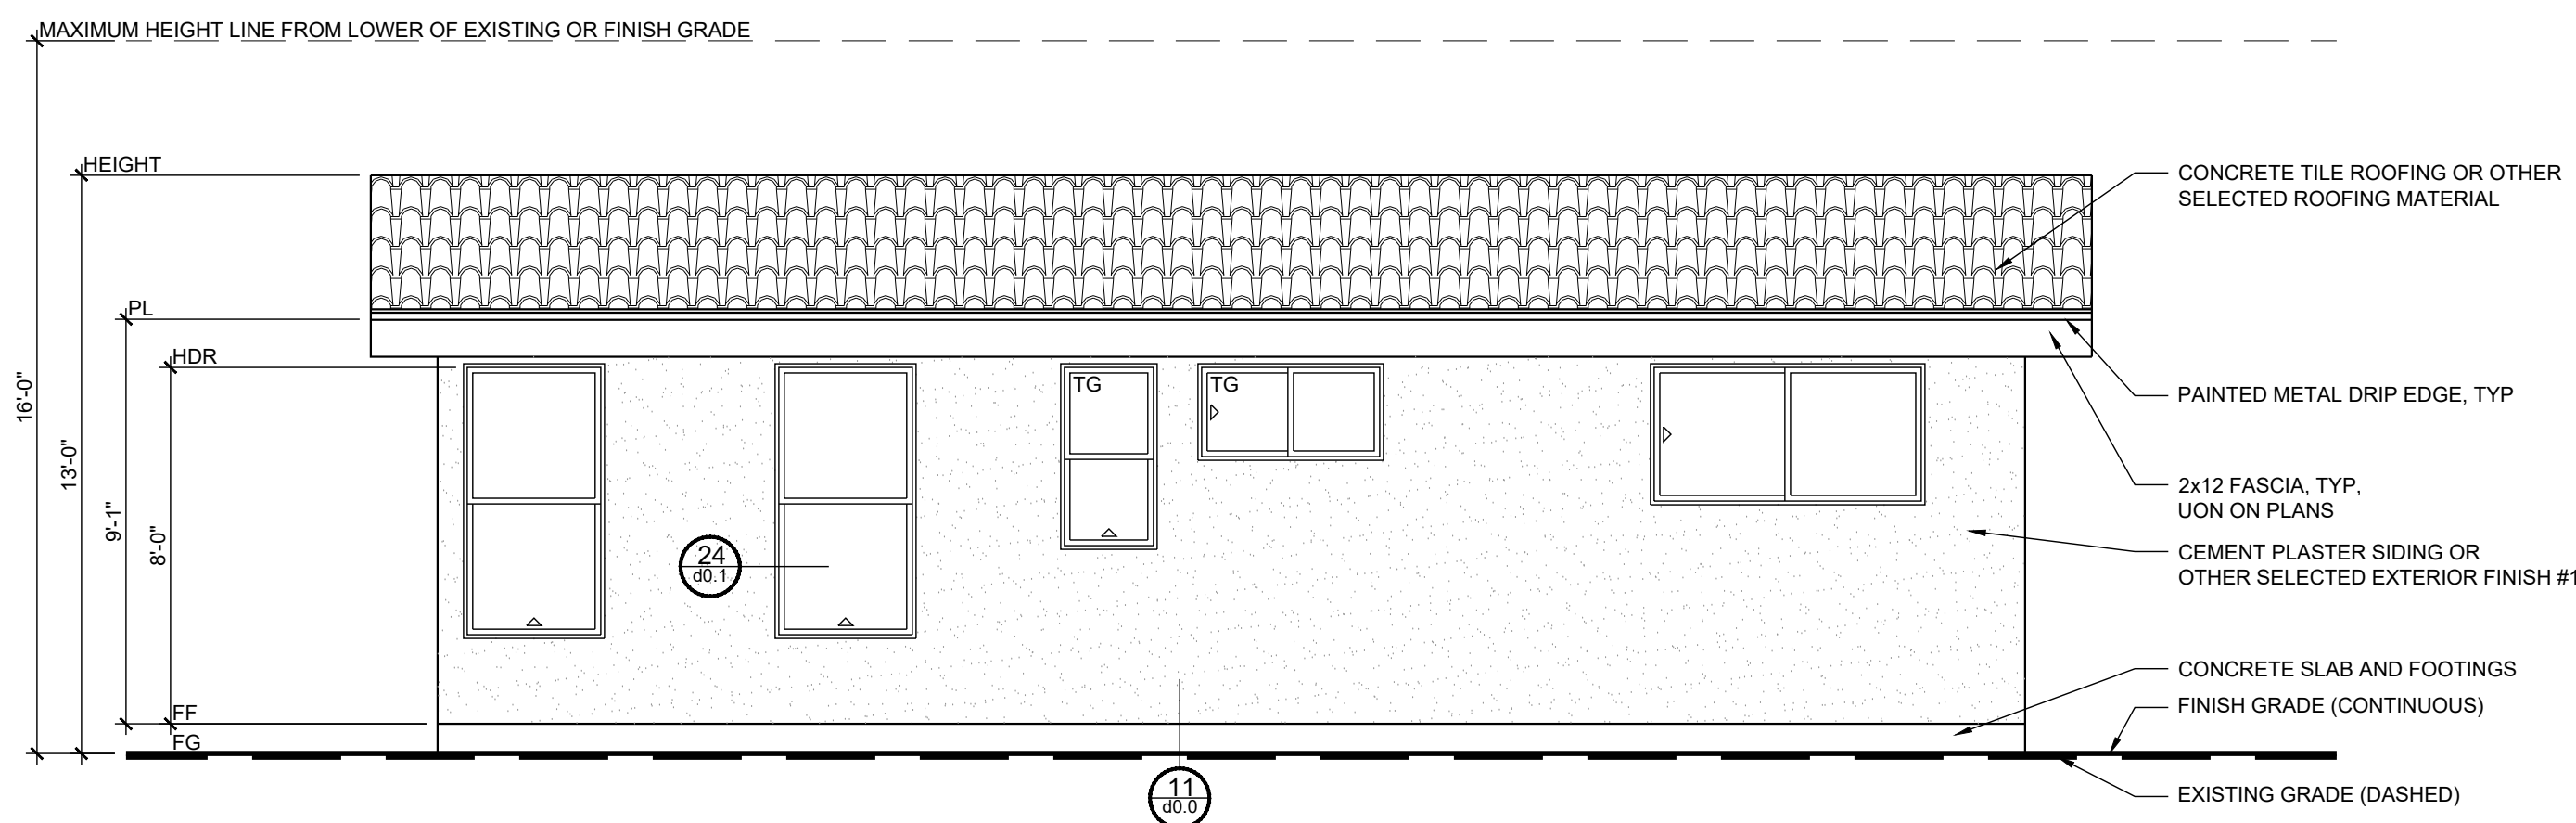

1 rear elevation a
SCALE: 1/4" = 1'-0"

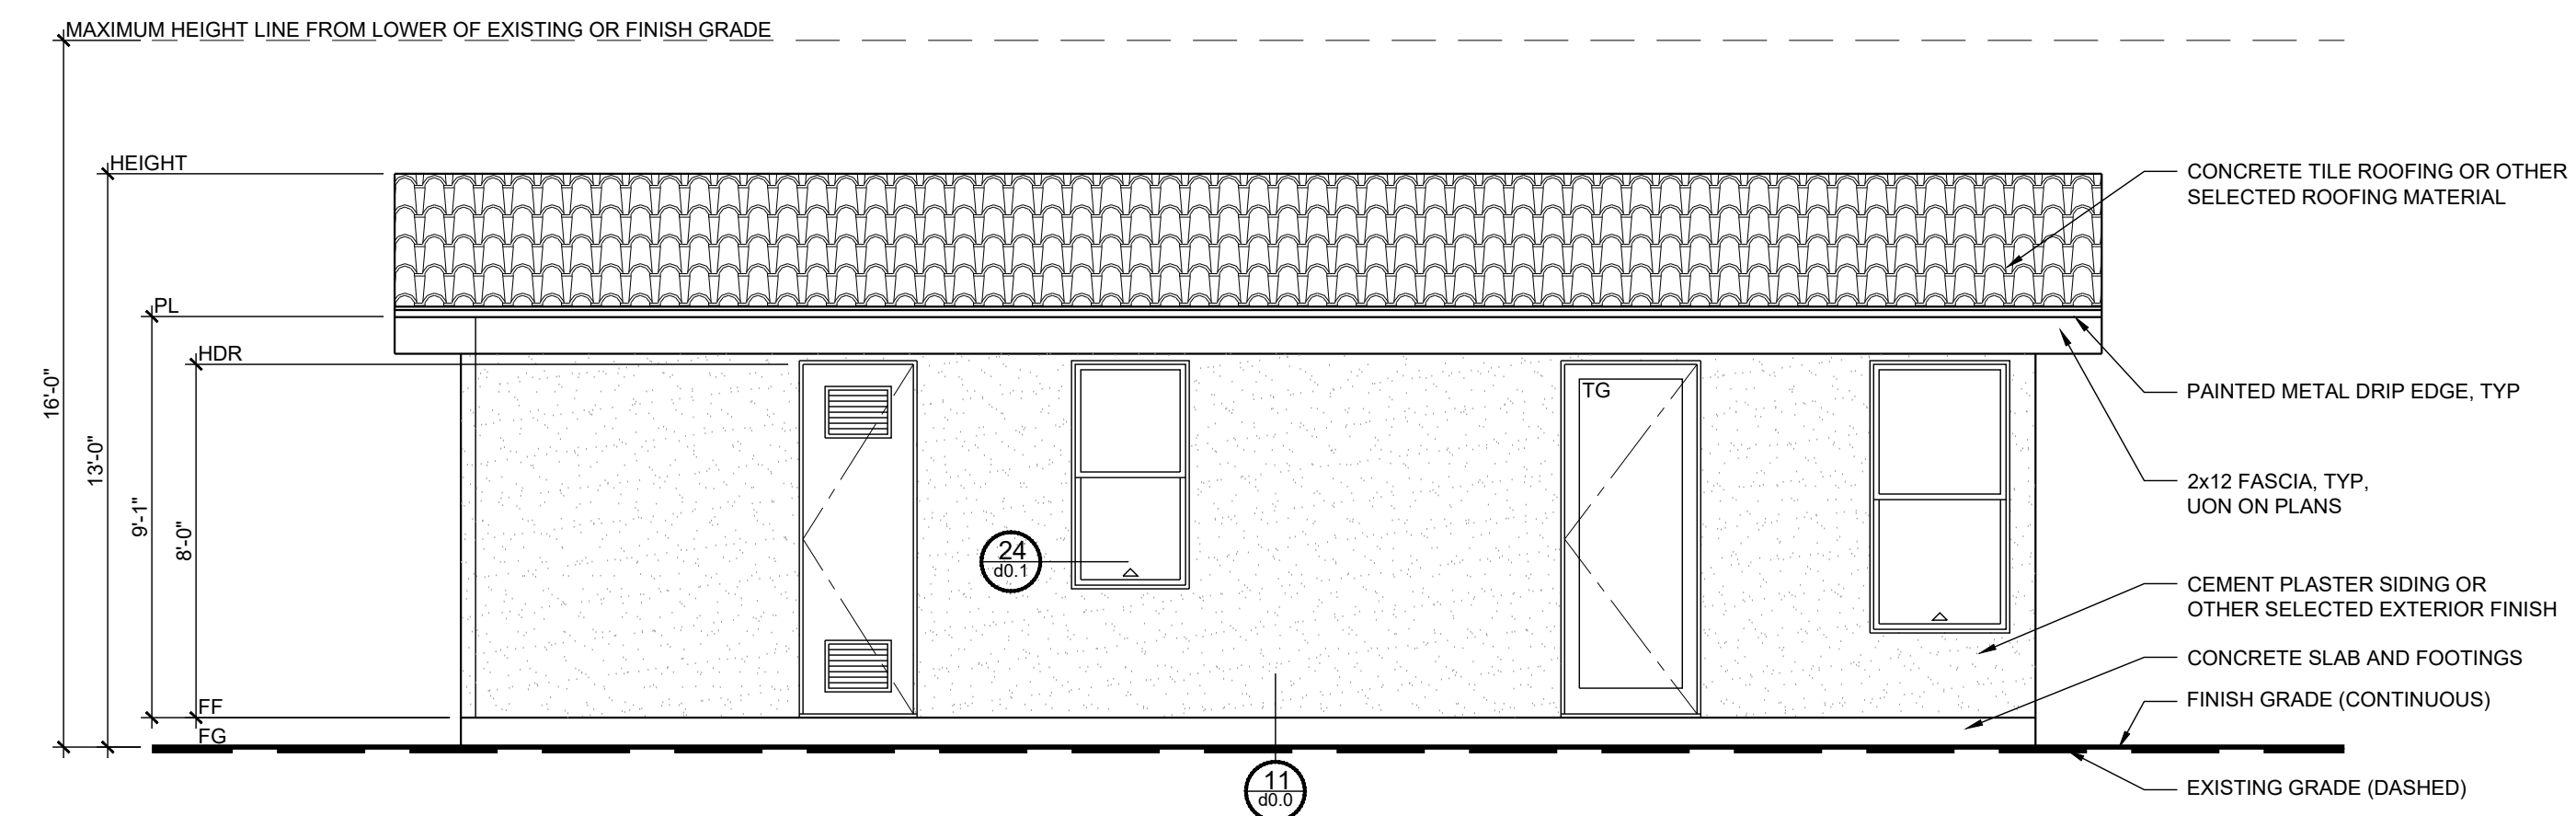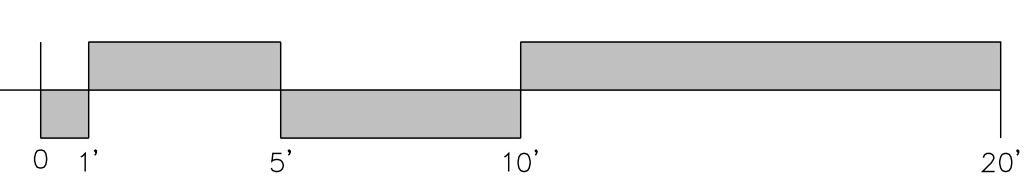


4 front elevation a
SCALE: 1/4" = 1'-0"


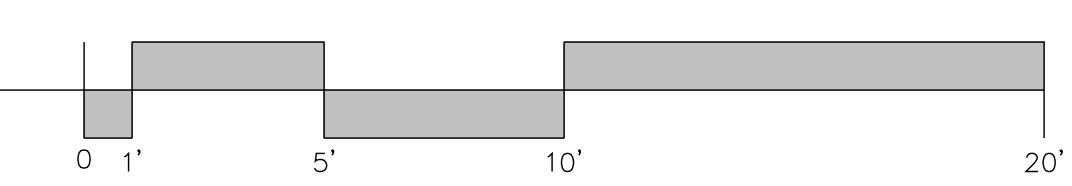


elevation + section notes:



1. ROOF PLAN NOTES THE LOCATION OF GUTTERS, DOWNSPOUTS & ROOF MOUNTED ATTIC VENTS.
2. ADJUSTMENT OF ROOF PITCH OR PLATE HEIGHT MAY BE REQUIRED IF RAISED FLOOR FOUNDATION IS SELECTED TO MEET HEIGHT REQUIREMENTS.
3. ELEVATIONS & SECTIONS SHALL SHOW BOTH FINISH (CONTINUOUS) & EXISTING (DASHED) GRADE AND THE CORRESPONDING HEIGHT LIMITATION LINE FROM THE LOWER OF THE FINISH OR EXISTING GRADE.
4. IF THE AVERAGE LOT SLOPE EXCEEDS 10% (NOT INCLUDING RR ZONED LOTS) THAN THE ADDITIONAL SLOPED LOT HEIGHT LIMITATION LINES SHALL BE SHOWN AS WELL.

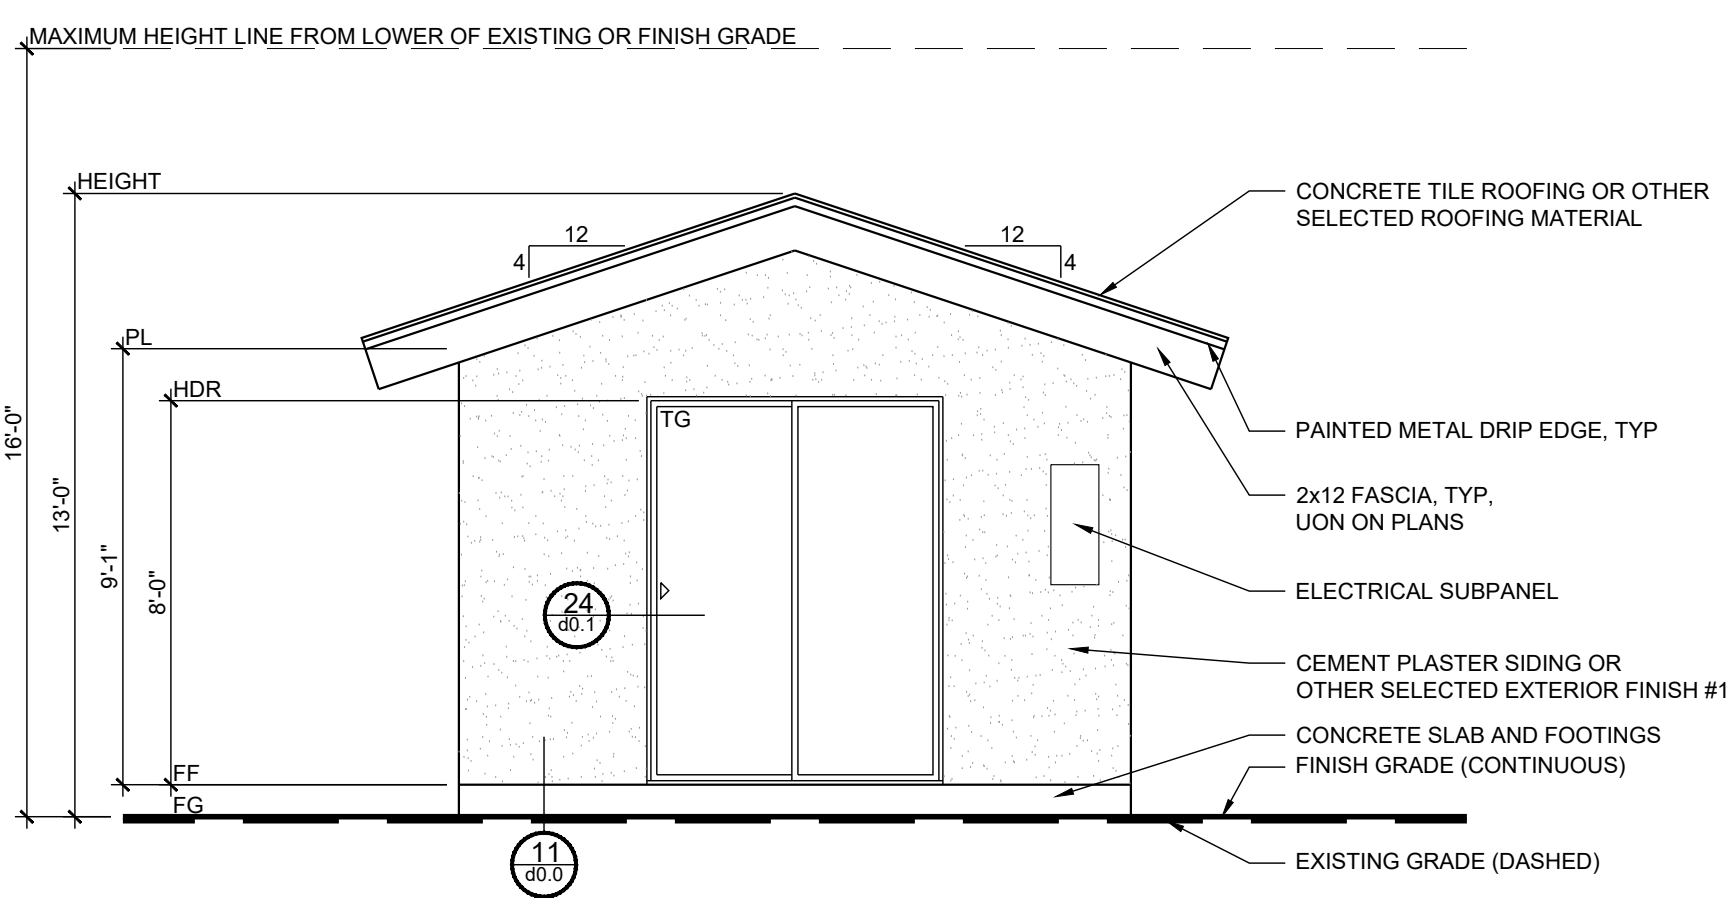



2 left elevation a
SCALE: 1/4" = 1'-0"

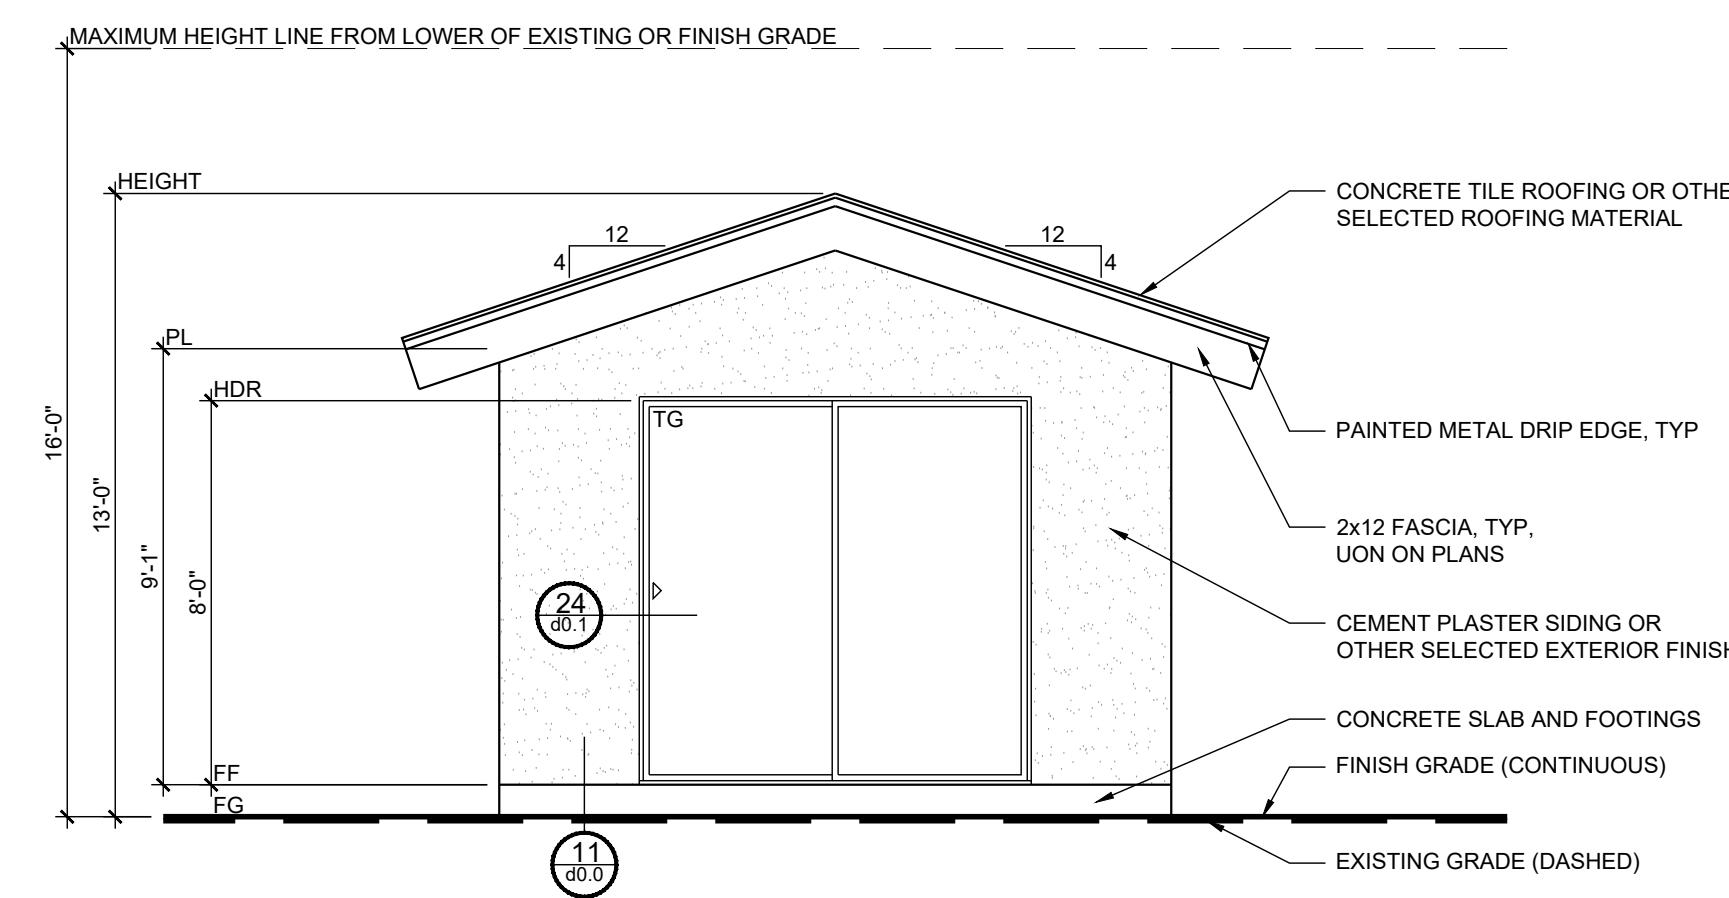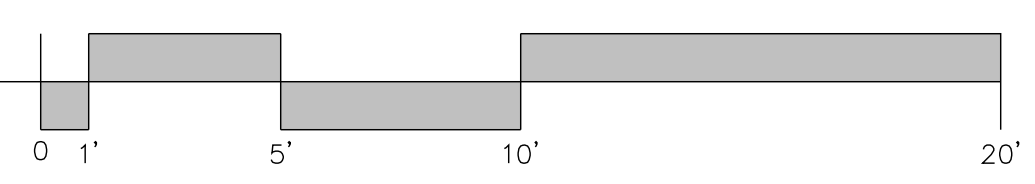


5 right elevation a
SCALE: 1/4" = 1'-0"

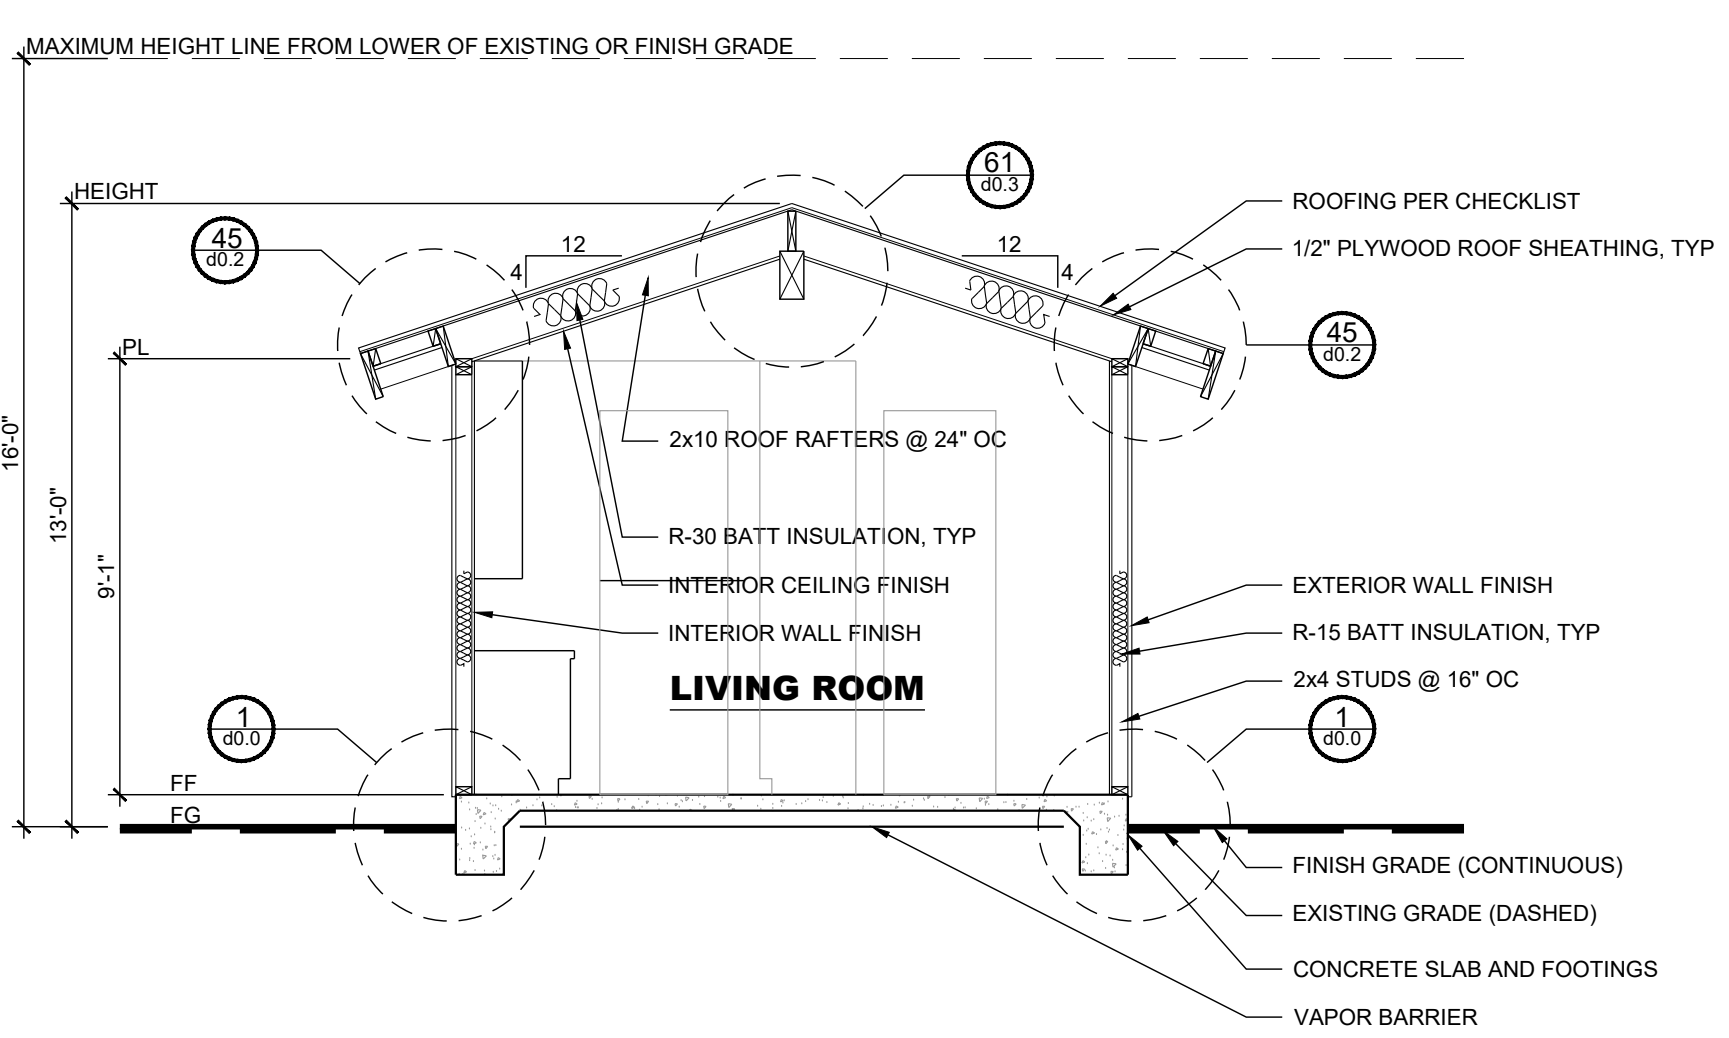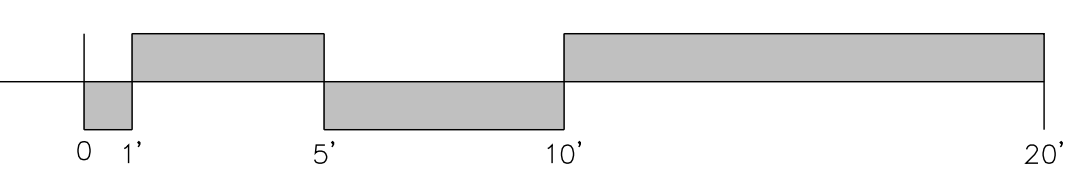

3 section a
SCALE: 1/4" = 1'-0"

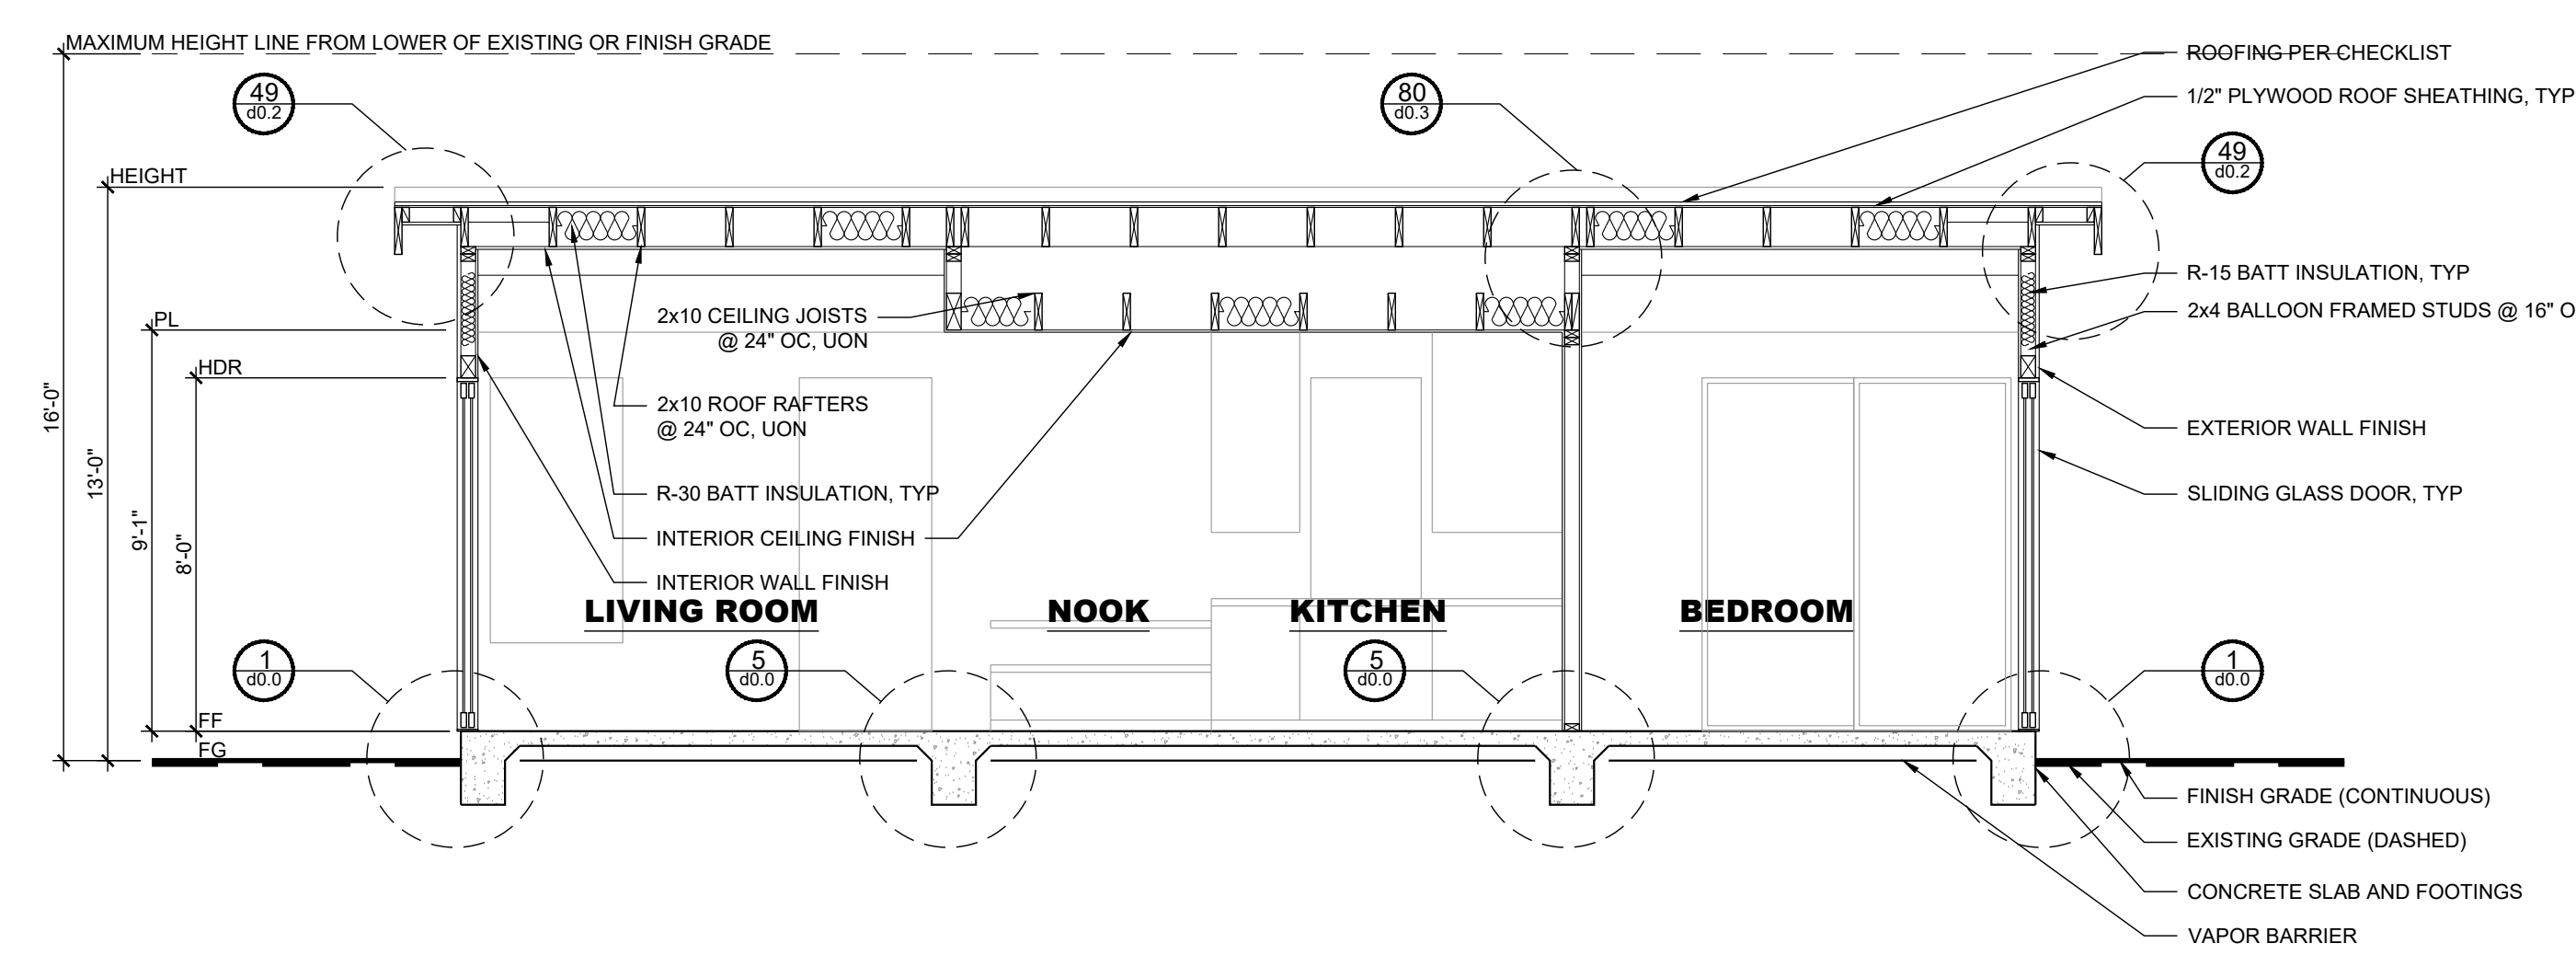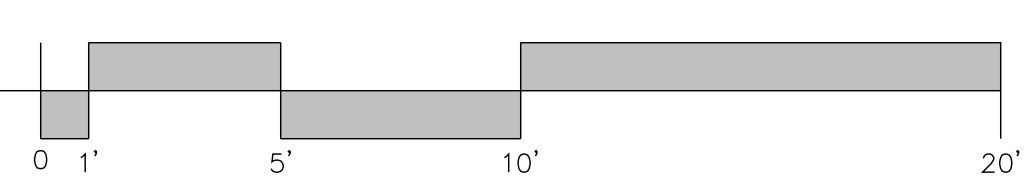

6 section b
SCALE: 1/4" = 1'-0"

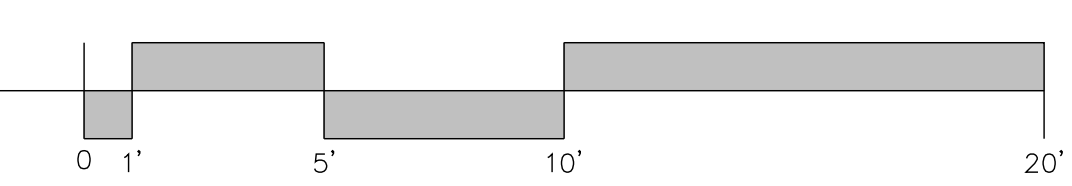

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


1 BEDROOM PRADU

CITY: ANAHEIM



JOB: 202409R

ELEVATION A + SECTION


a4.0

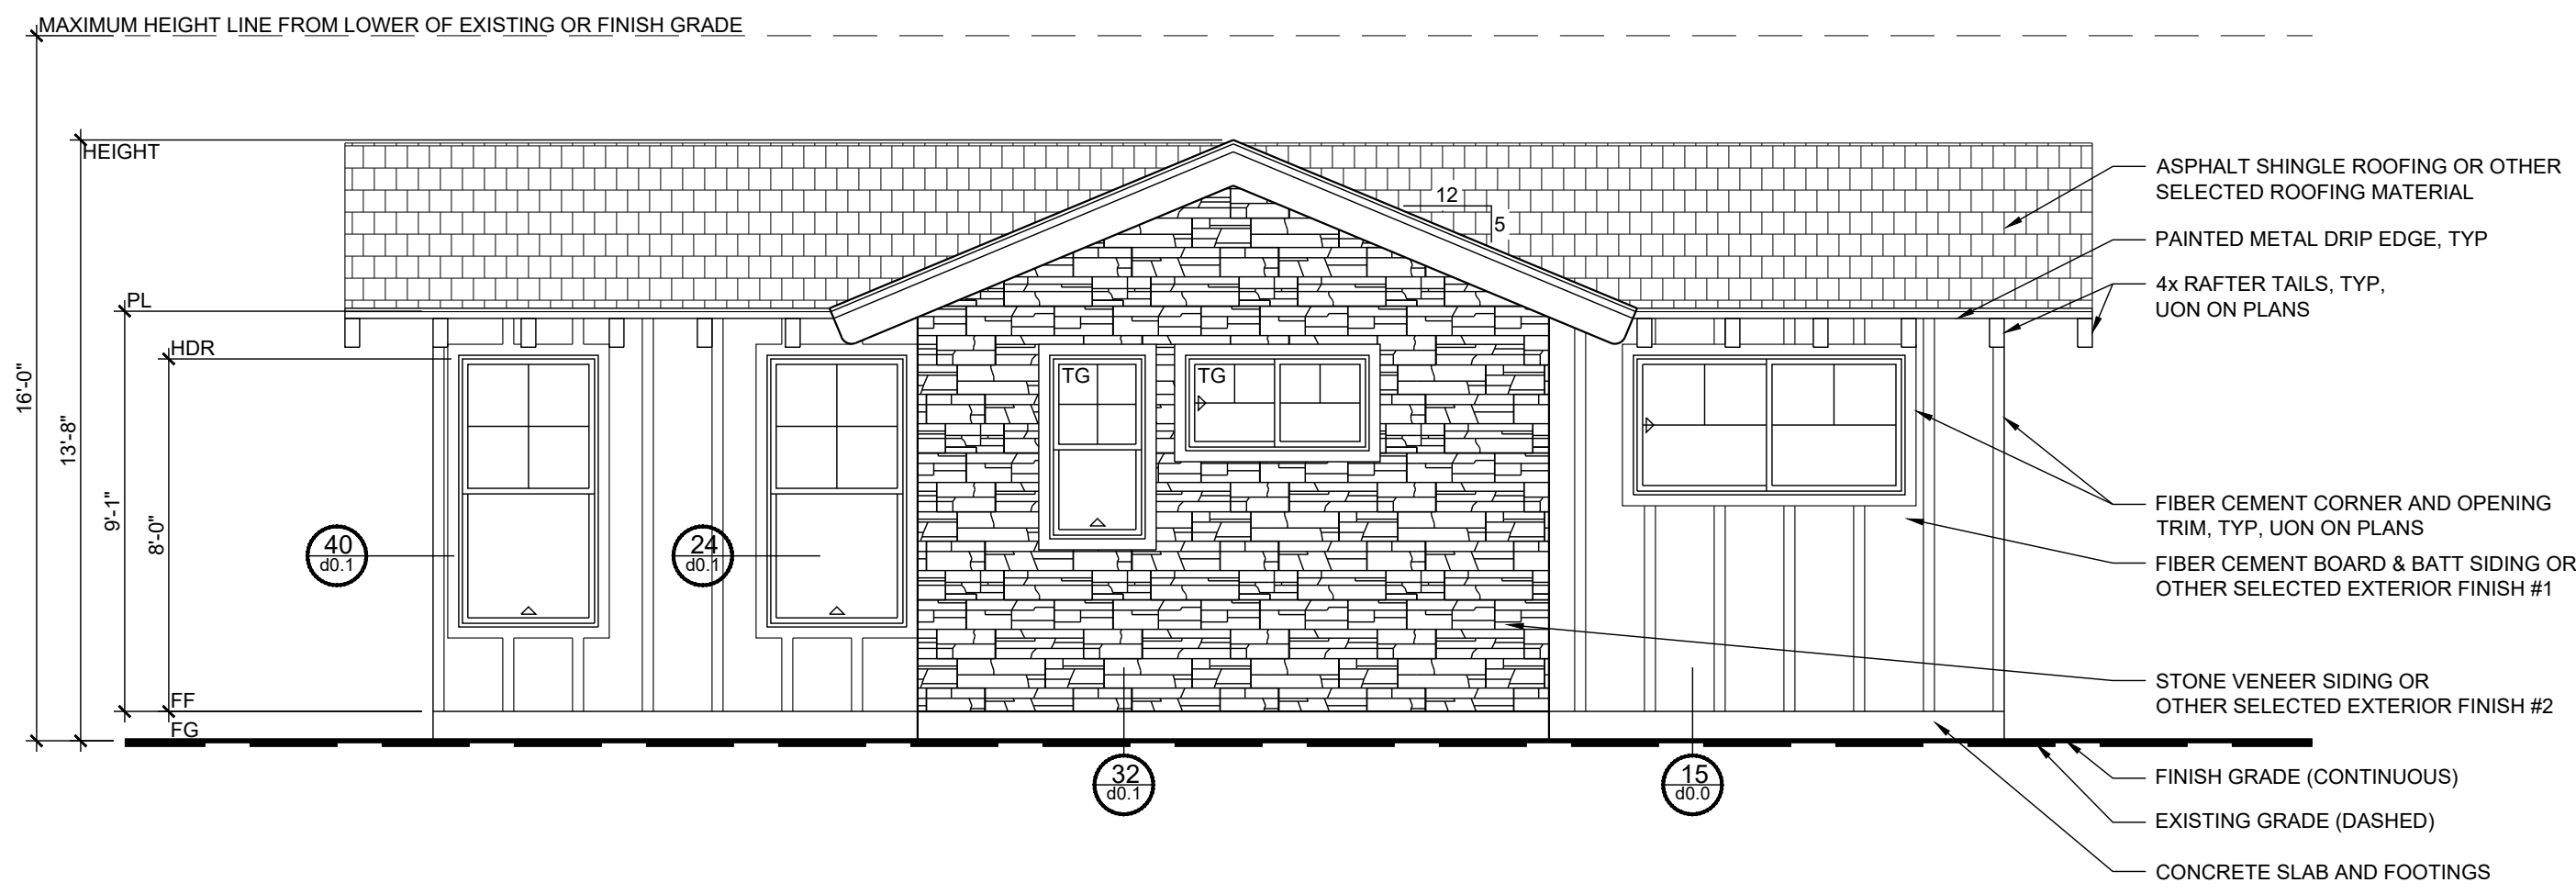

1 rear elevation b
SCALE: 1/4" = 1'-0"

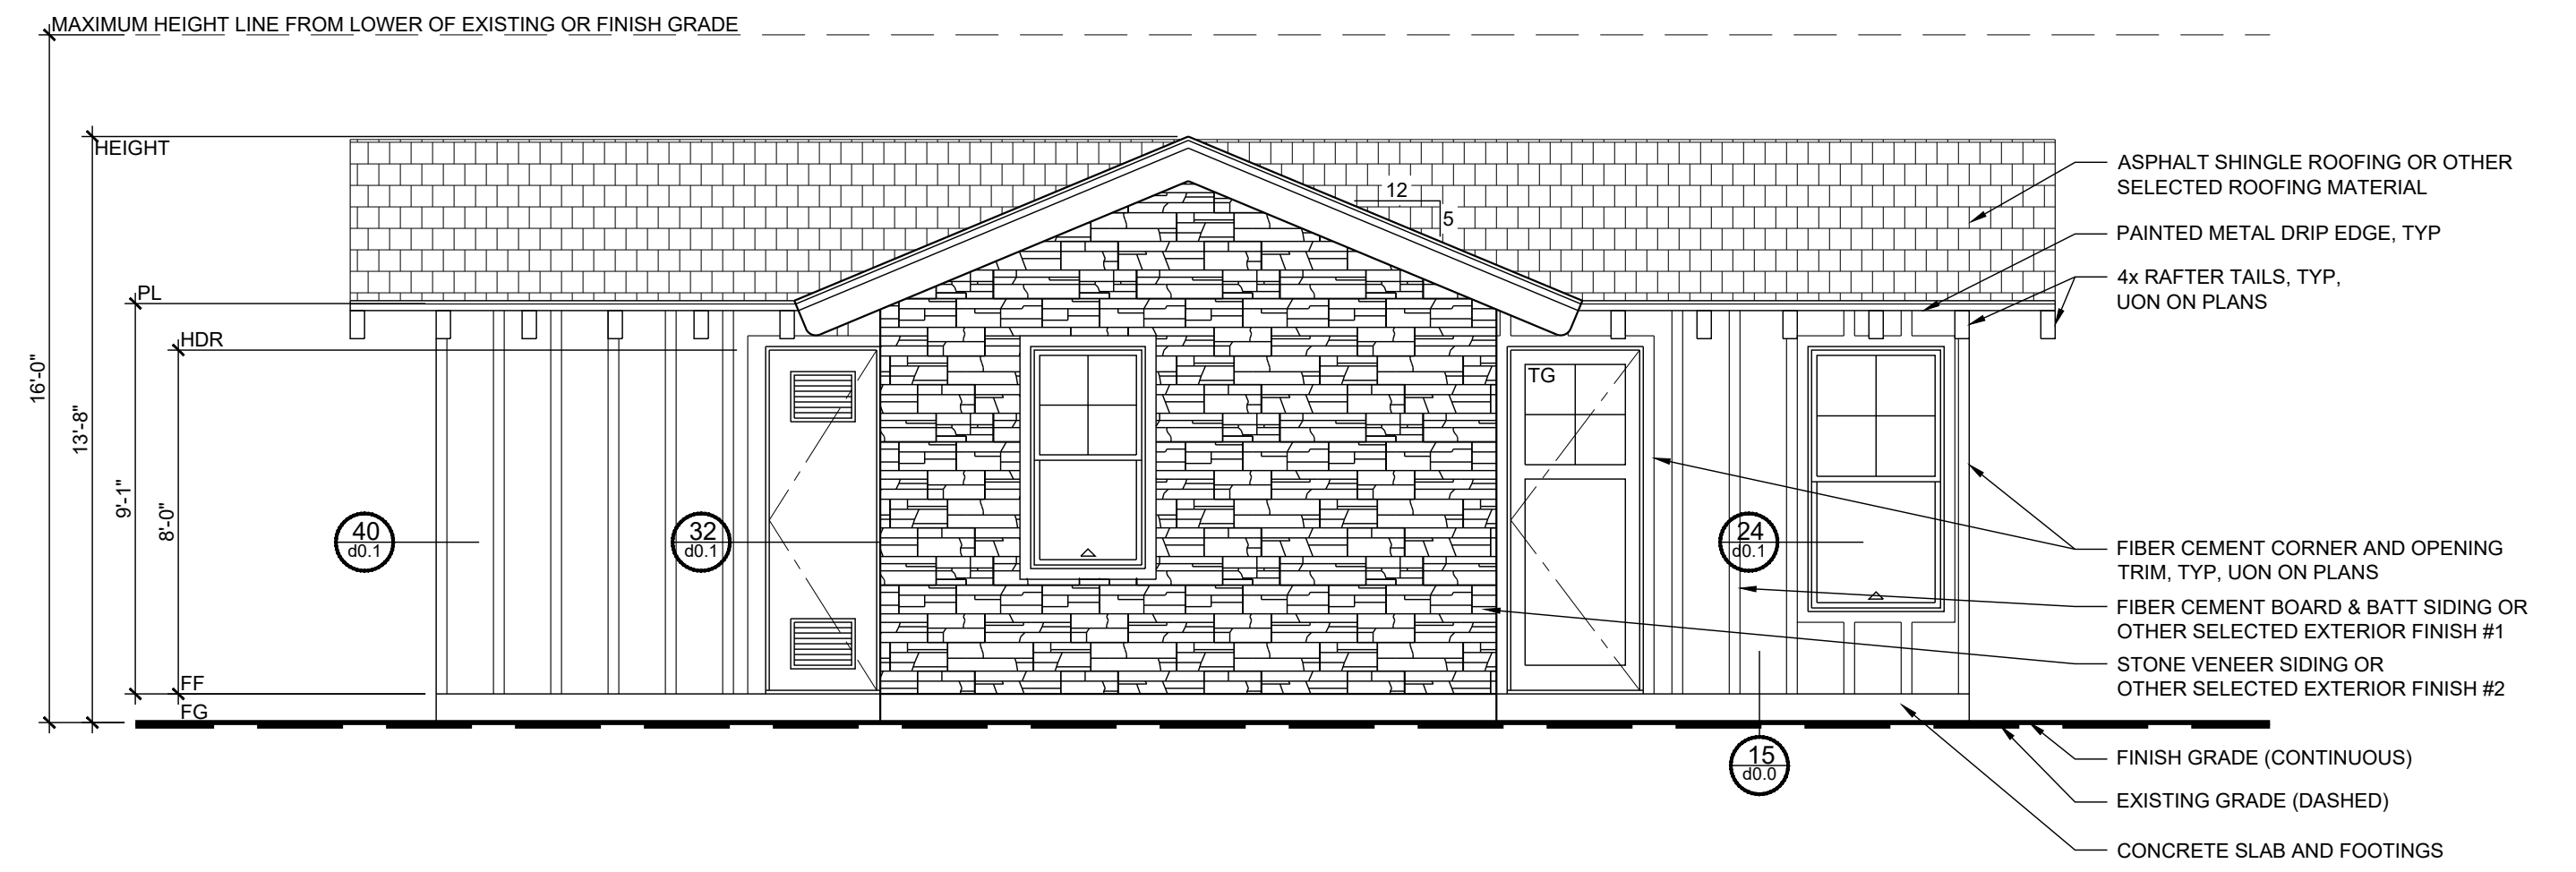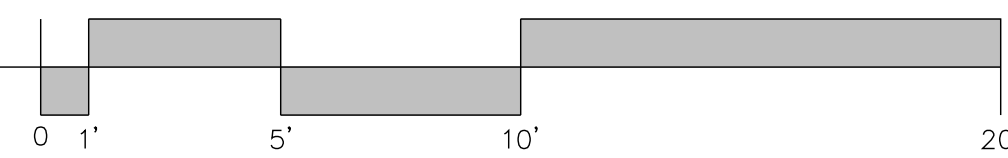


4 front elevation b
SCALE: 1/4" = 1'-0"


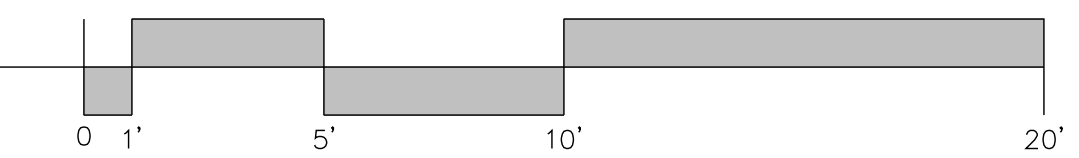


elevation + section notes:



1. ROOF PLAN NOTES THE LOCATION OF GUTTERS, DOWNSPOUTS & ROOF MOUNTED ATTIC VENTS.
2. ADJUSTMENT OF ROOF PITCH OR PLATE HEIGHT MAY BE REQUIRED IF RAISED FLOOR FOUNDATION IS SELECTED TO MEET HEIGHT REQUIREMENTS.
3. ELEVATIONS & SECTIONS SHALL SHOW BOTH FINISH (CONTINUOUS) & EXISTING (DASHED) GRADE AND THE CORRESPONDING HEIGHT LIMITATION LINE FROM THE LOWER OF THE FINISH OR EXISTING GRADE.
4. IF THE AVERAGE LOT SLOPE EXCEEDS 10% (NOT INCLUDING RR ZONED LOTS) THAN THE ADDITIONAL SLOPED LOT HEIGHT LIMITATION LINES SHALL BE SHOWN AS WELL.

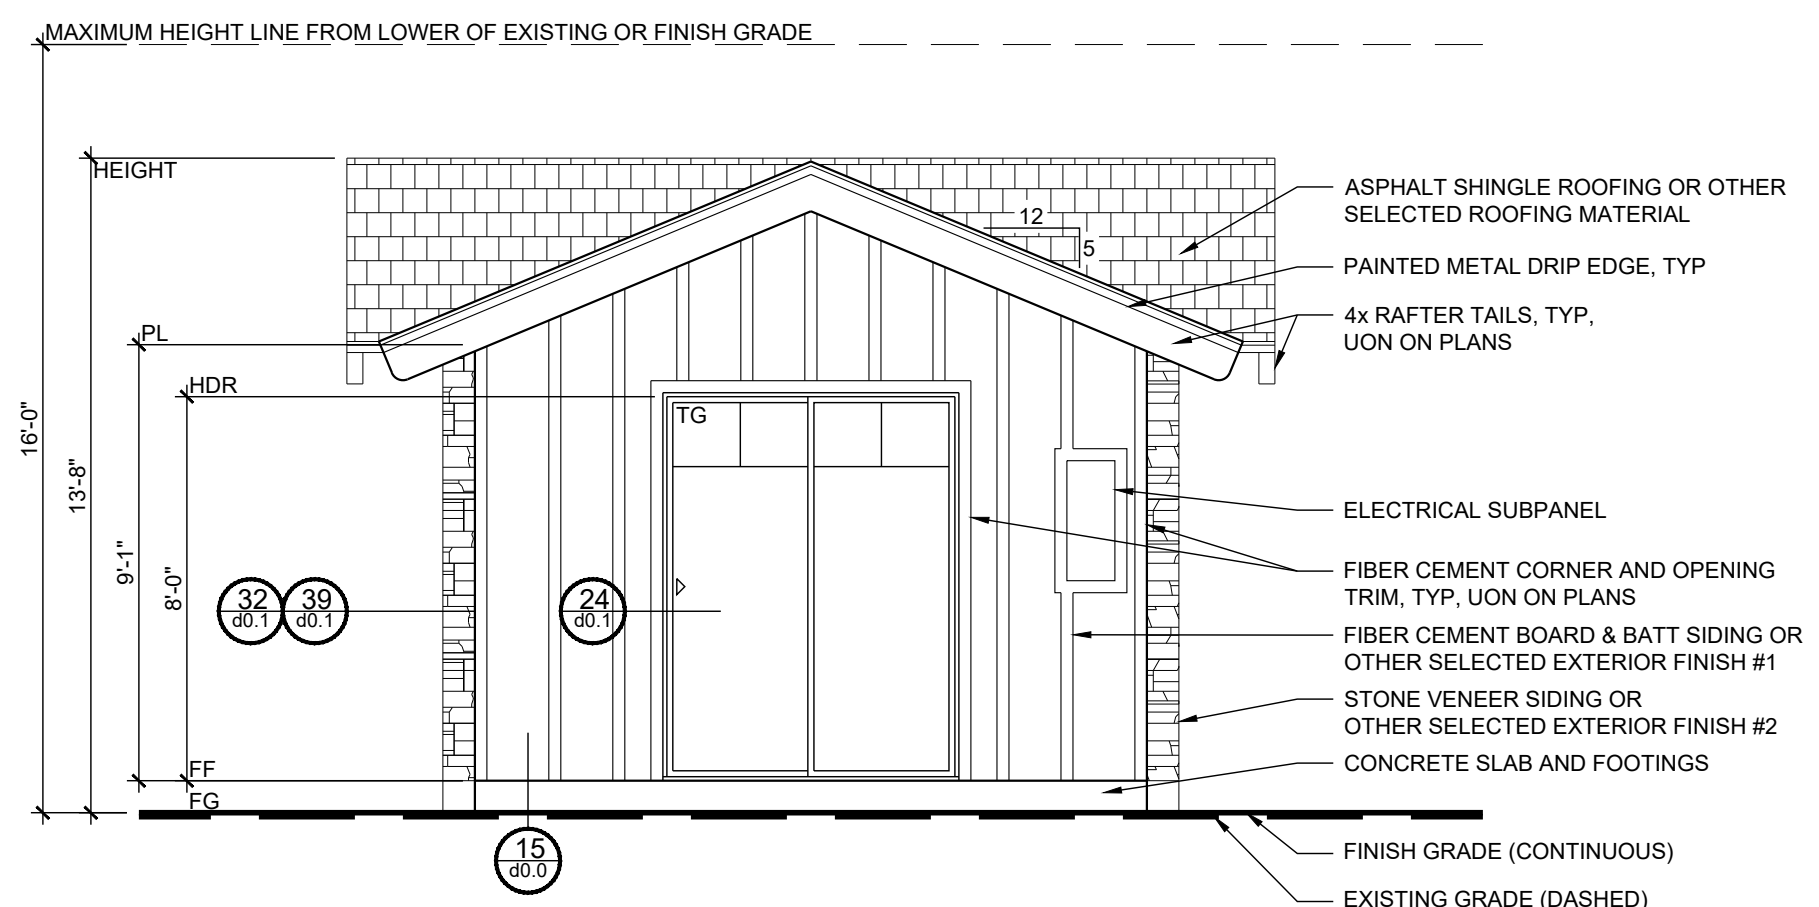



2 left elevation b
SCALE: 1/4" = 1'-0"

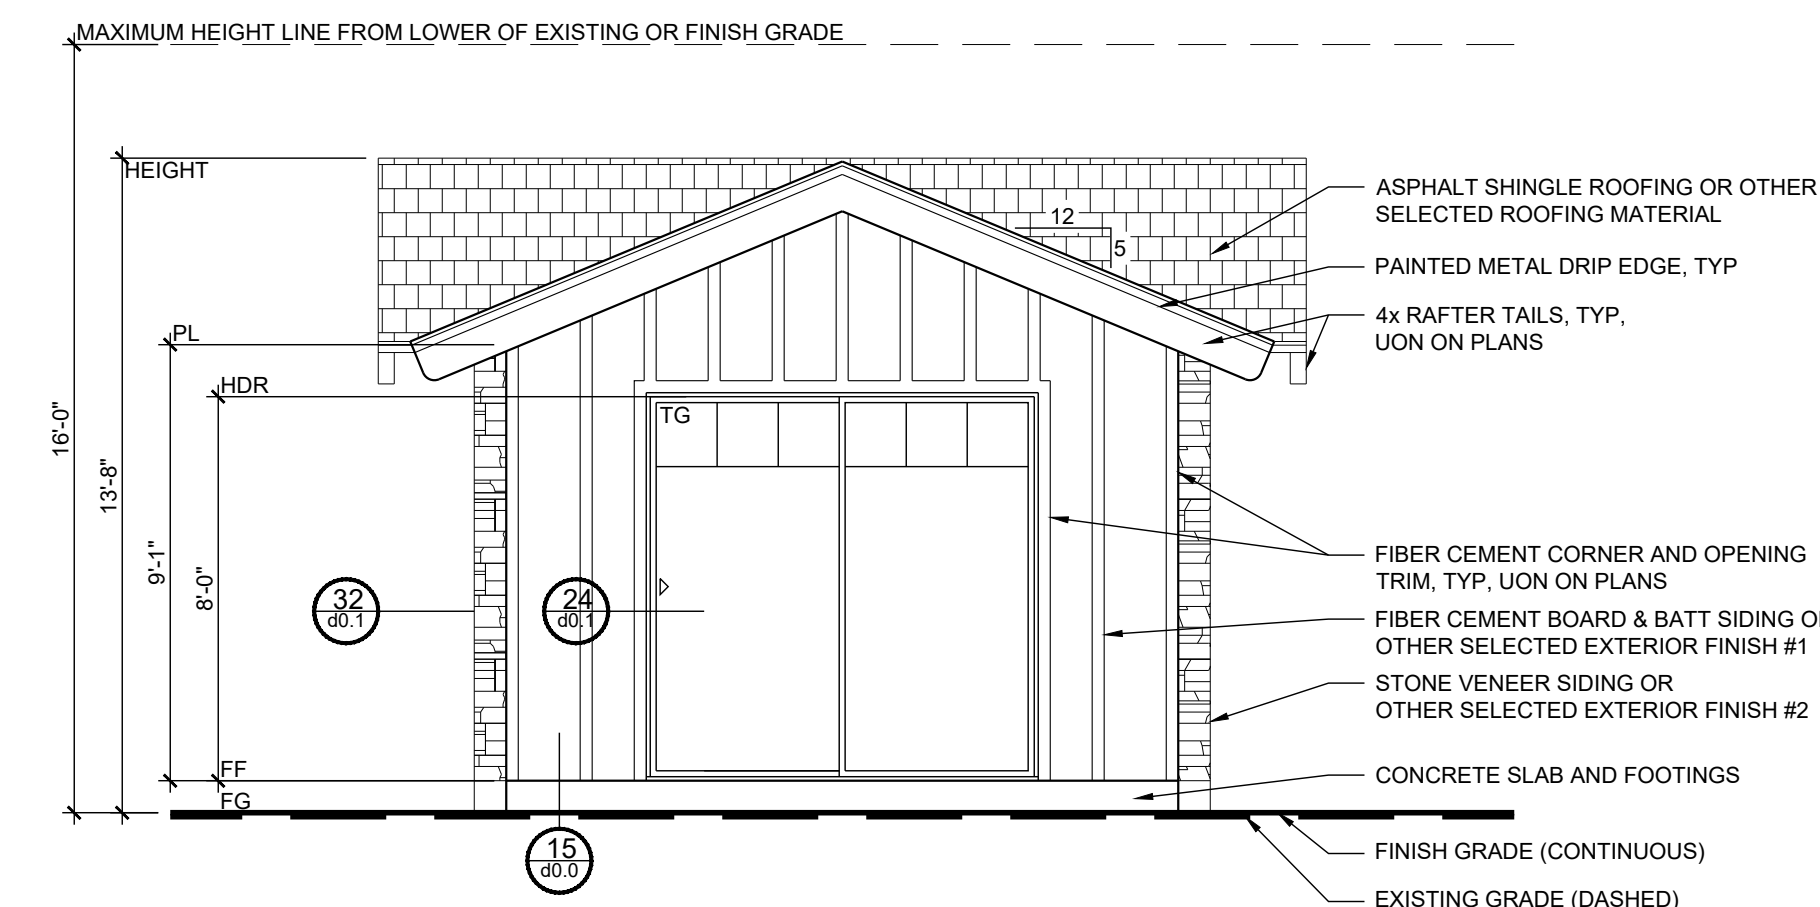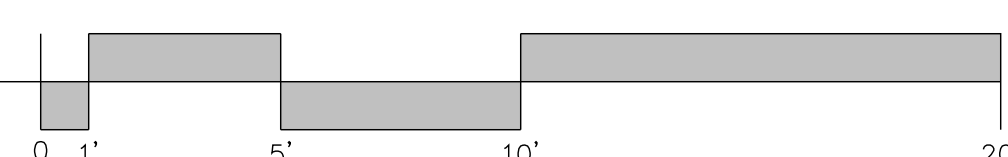

5 right elevation b
SCALE: 1/4" = 1'-0"

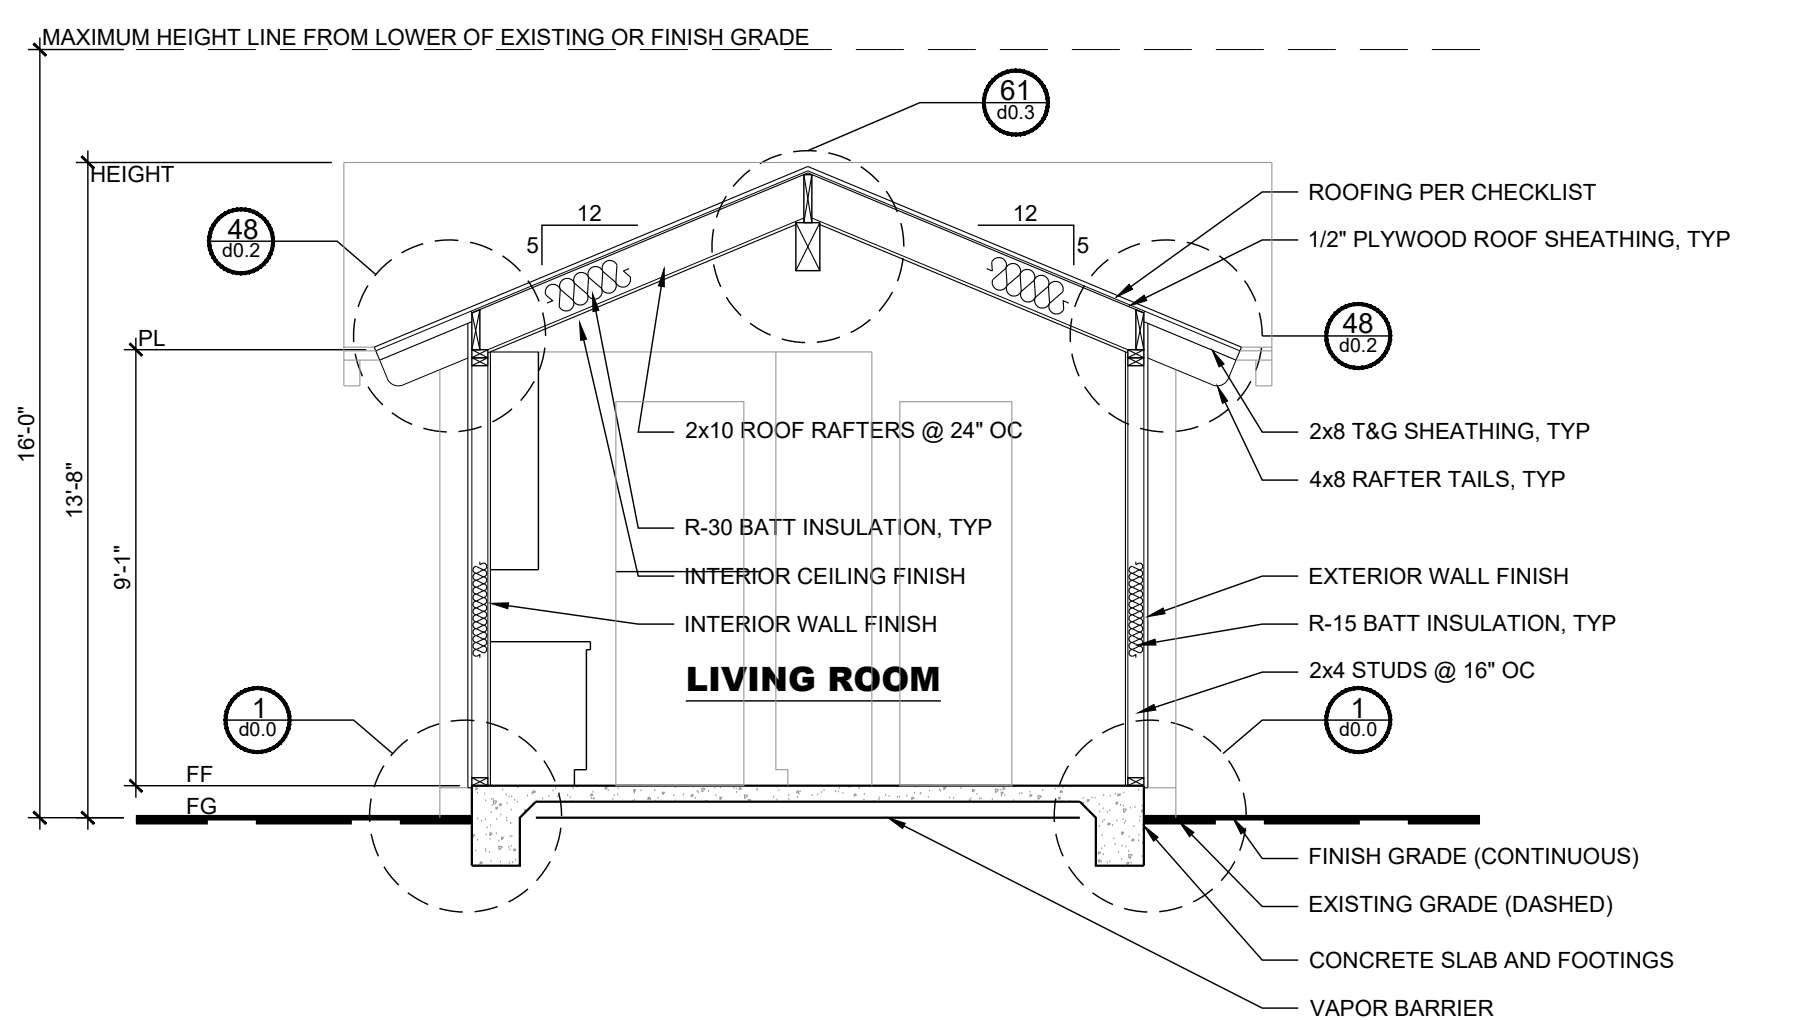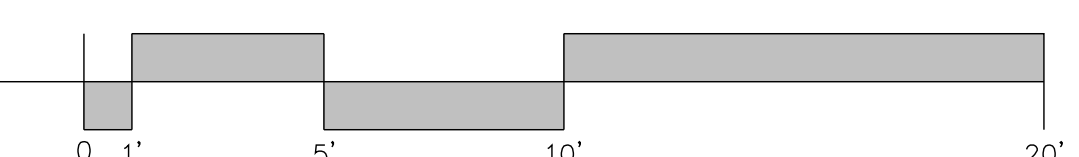

3 section c
SCALE: 1/4" = 1'-0"

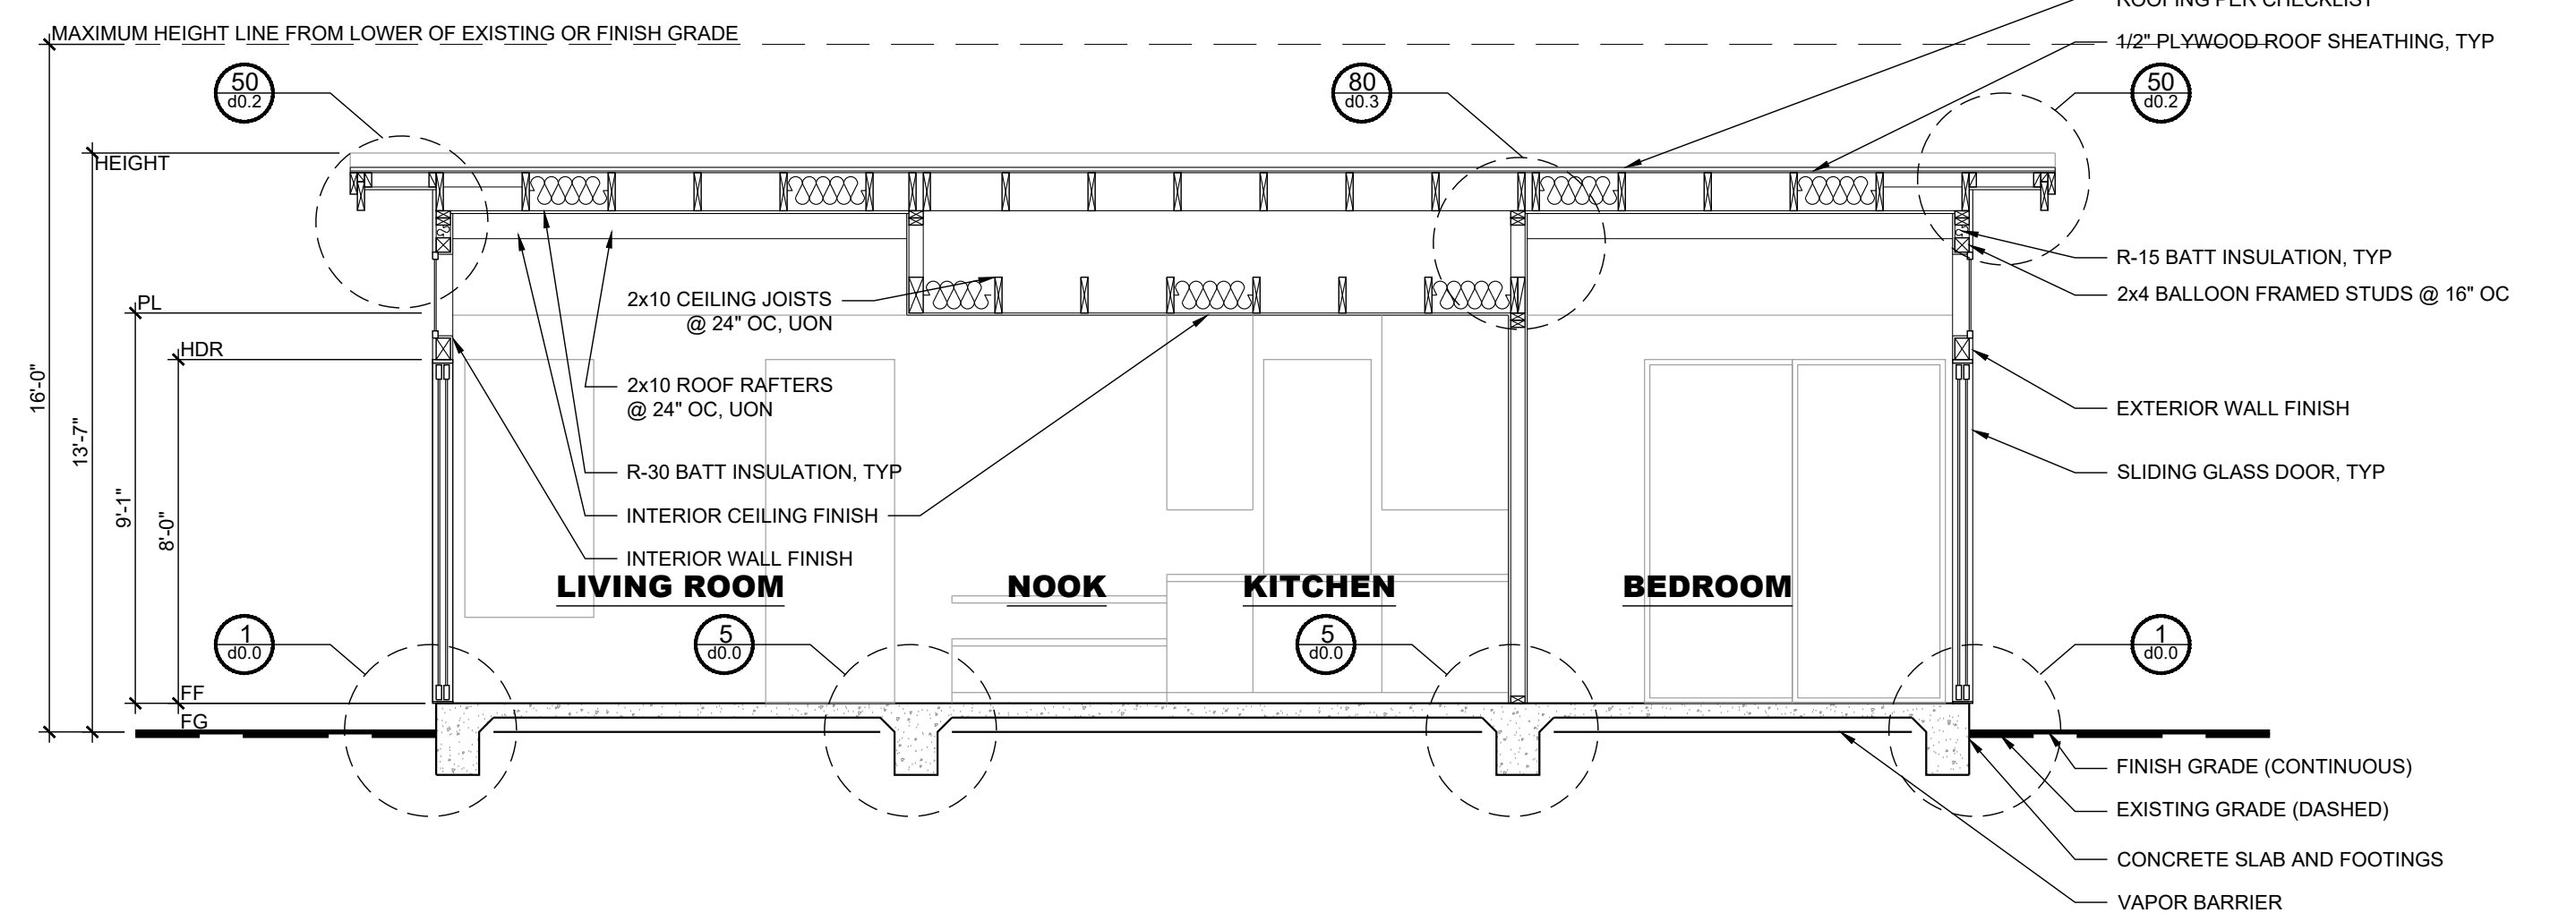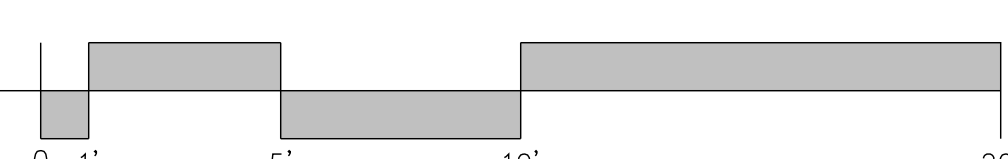

6 section d
SCALE: 1/4" = 1'-0"



BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


1 BEDROOM PRADU

CITY: ANAHEIM



JOB: 202409R

ELEVATION B + SECTION


a4.1

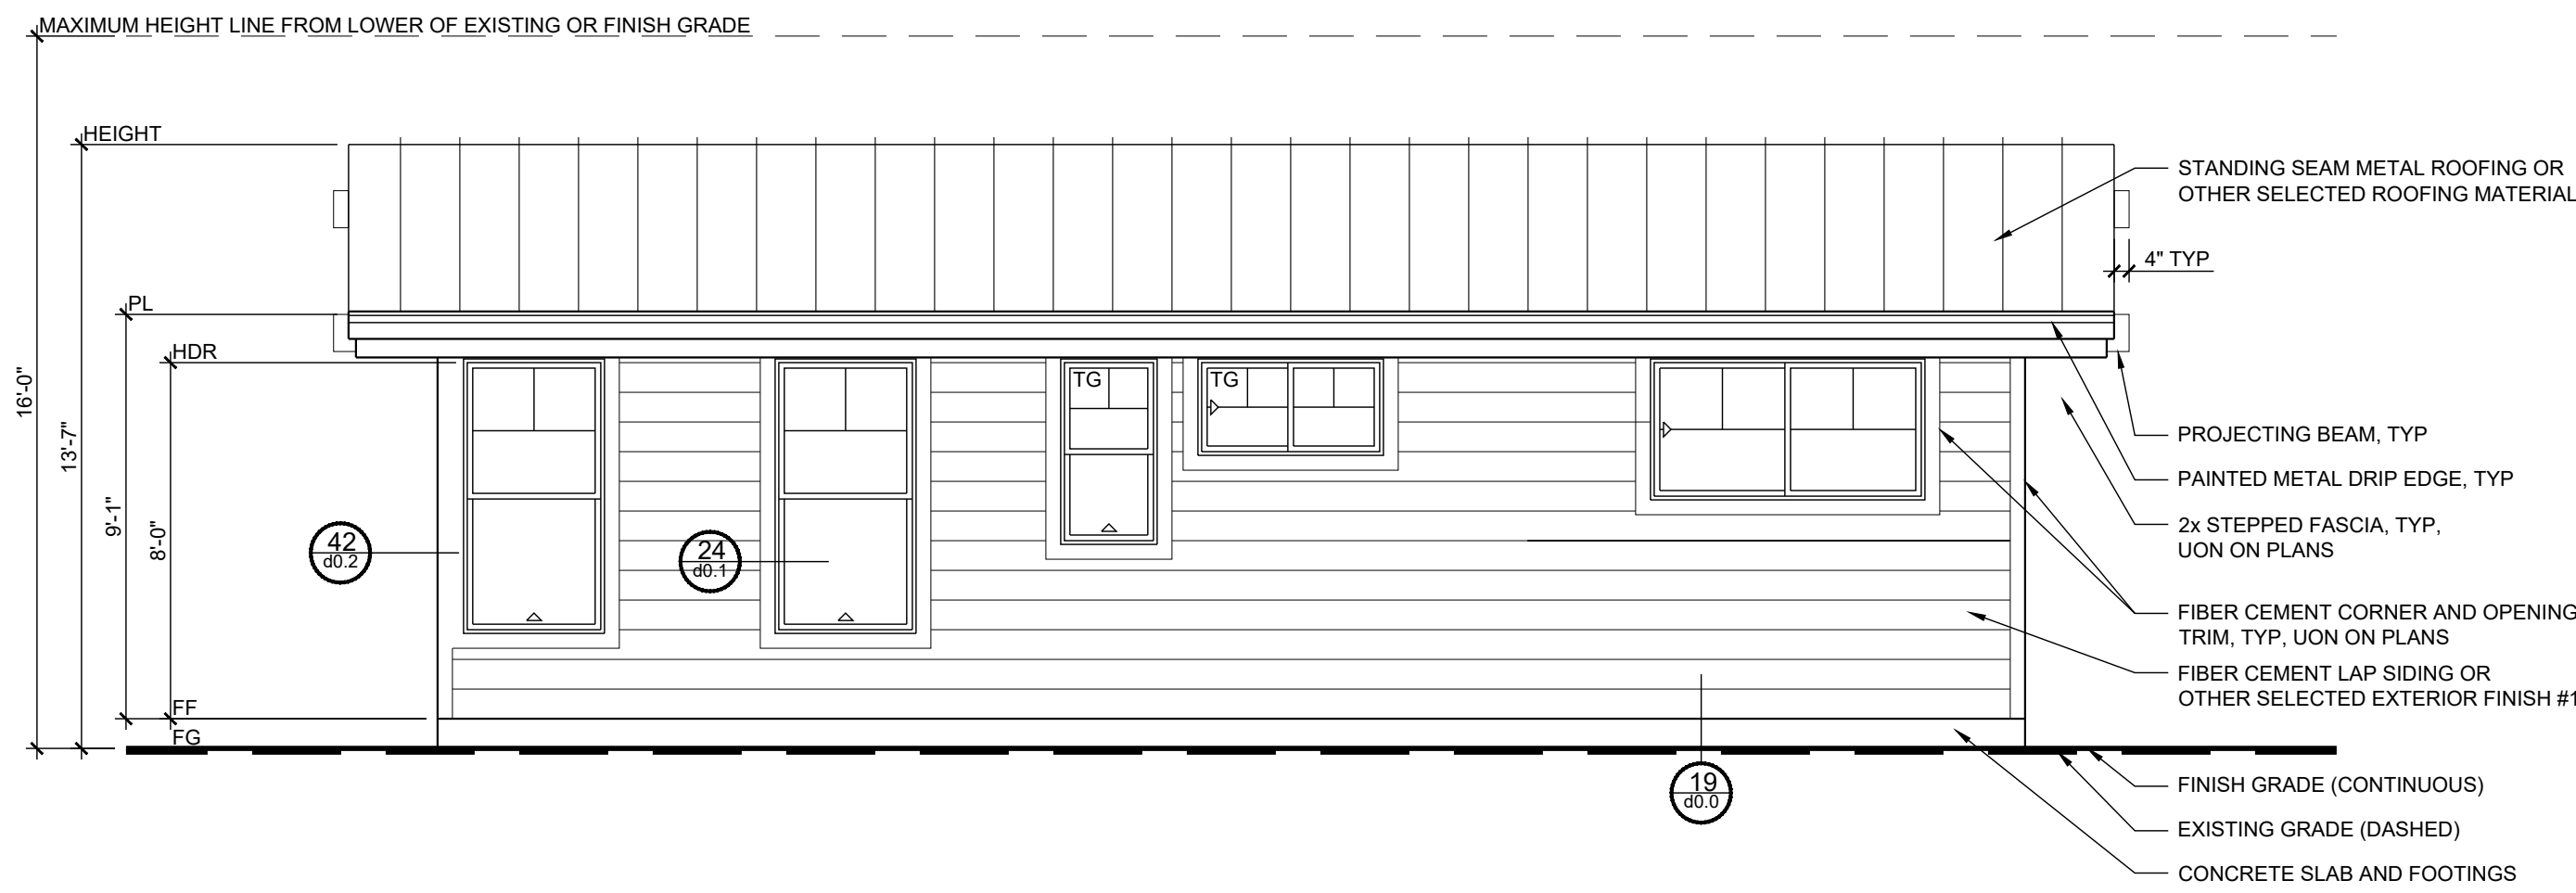

1 rear elevation c
SCALE: 1/4" = 1'-0"

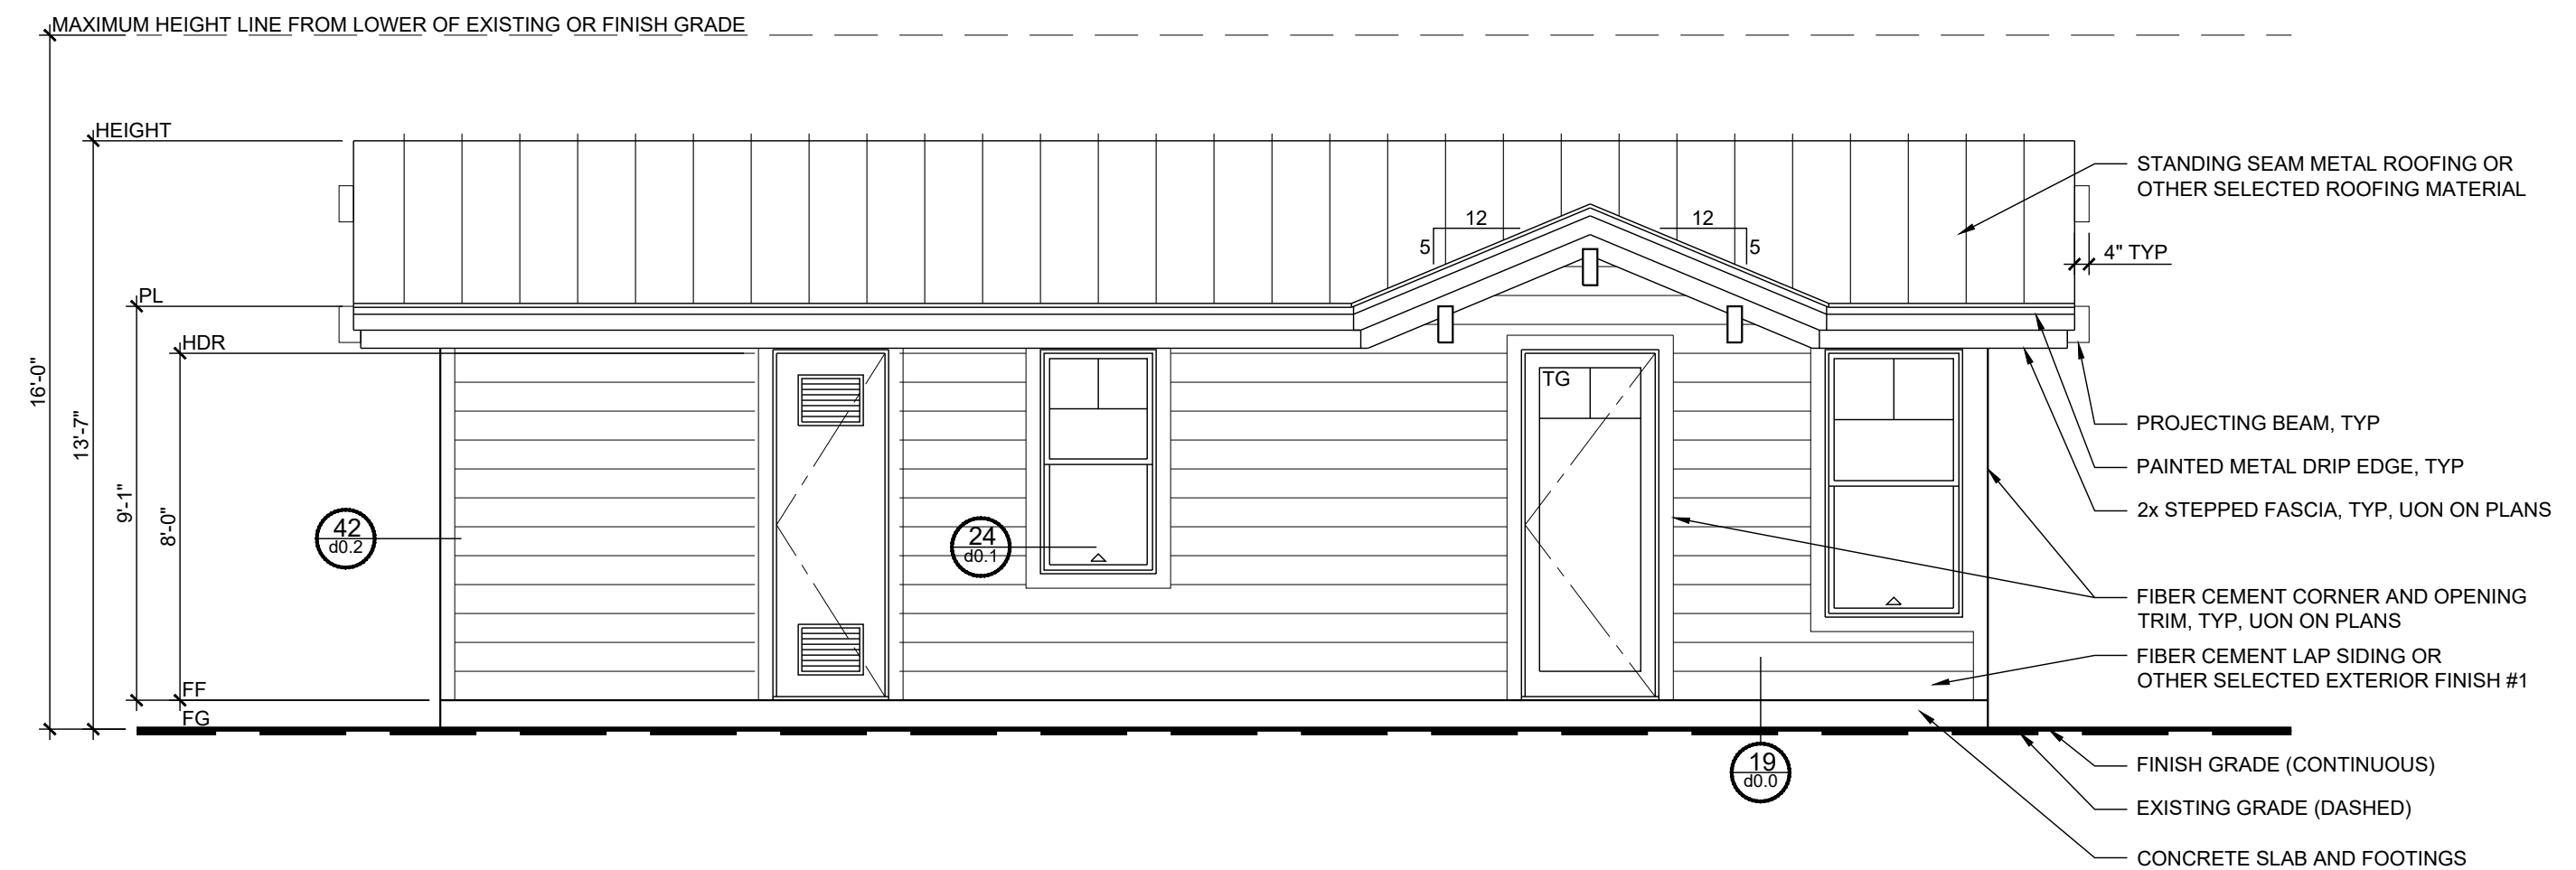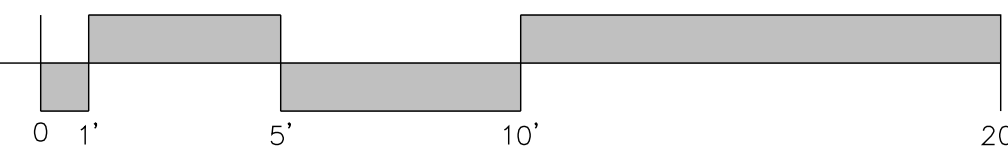


4 front elevation c
SCALE: 1/4" = 1'-0"


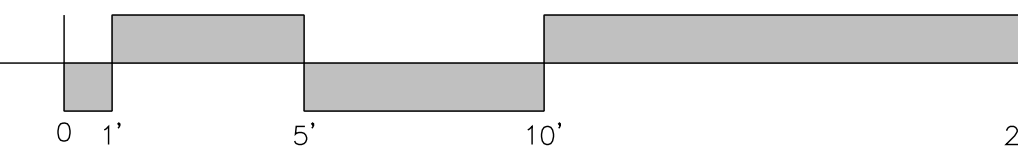


elevation + section notes:



1. ROOF PLAN NOTES THE LOCATION OF GUTTERS, DOWNSPOUTS & ROOF MOUNTED ATTIC VENTS.
2. ADJUSTMENT OF ROOF PITCH OR PLATE HEIGHT MAY BE REQUIRED IF RAISED FLOOR FOUNDATION IS SELECTED TO MEET HEIGHT REQUIREMENTS.
3. ELEVATIONS & SECTIONS SHALL SHOW BOTH FINISH (CONTINUOUS) & EXISTING (DASHED) GRADE AND THE CORRESPONDING HEIGHT LIMITATION LINE FROM THE LOWER OF THE FINISH OR EXISTING GRADE.
4. IF THE AVERAGE LOT SLOPE EXCEEDS 10% (NOT INCLUDING RR ZONED LOTS) THAN THE ADDITIONAL SLOPED LOT HEIGHT LIMITATION LINES SHALL BE SHOWN AS WELL.

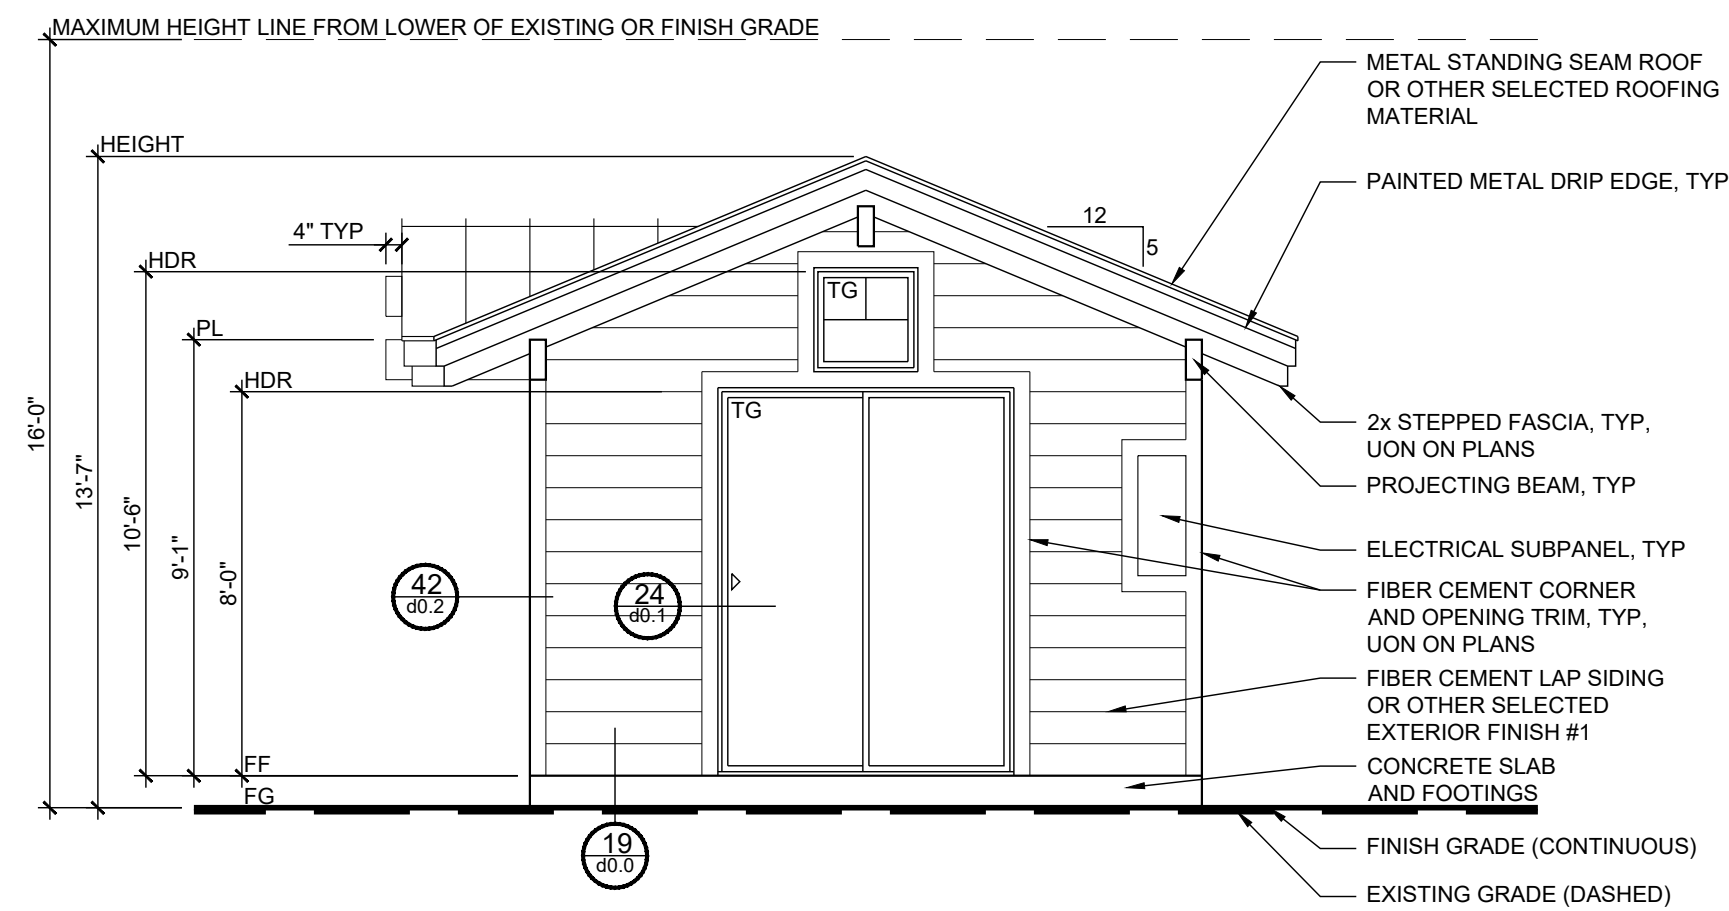



2 left elevation c
SCALE: 1/4" = 1'-0"

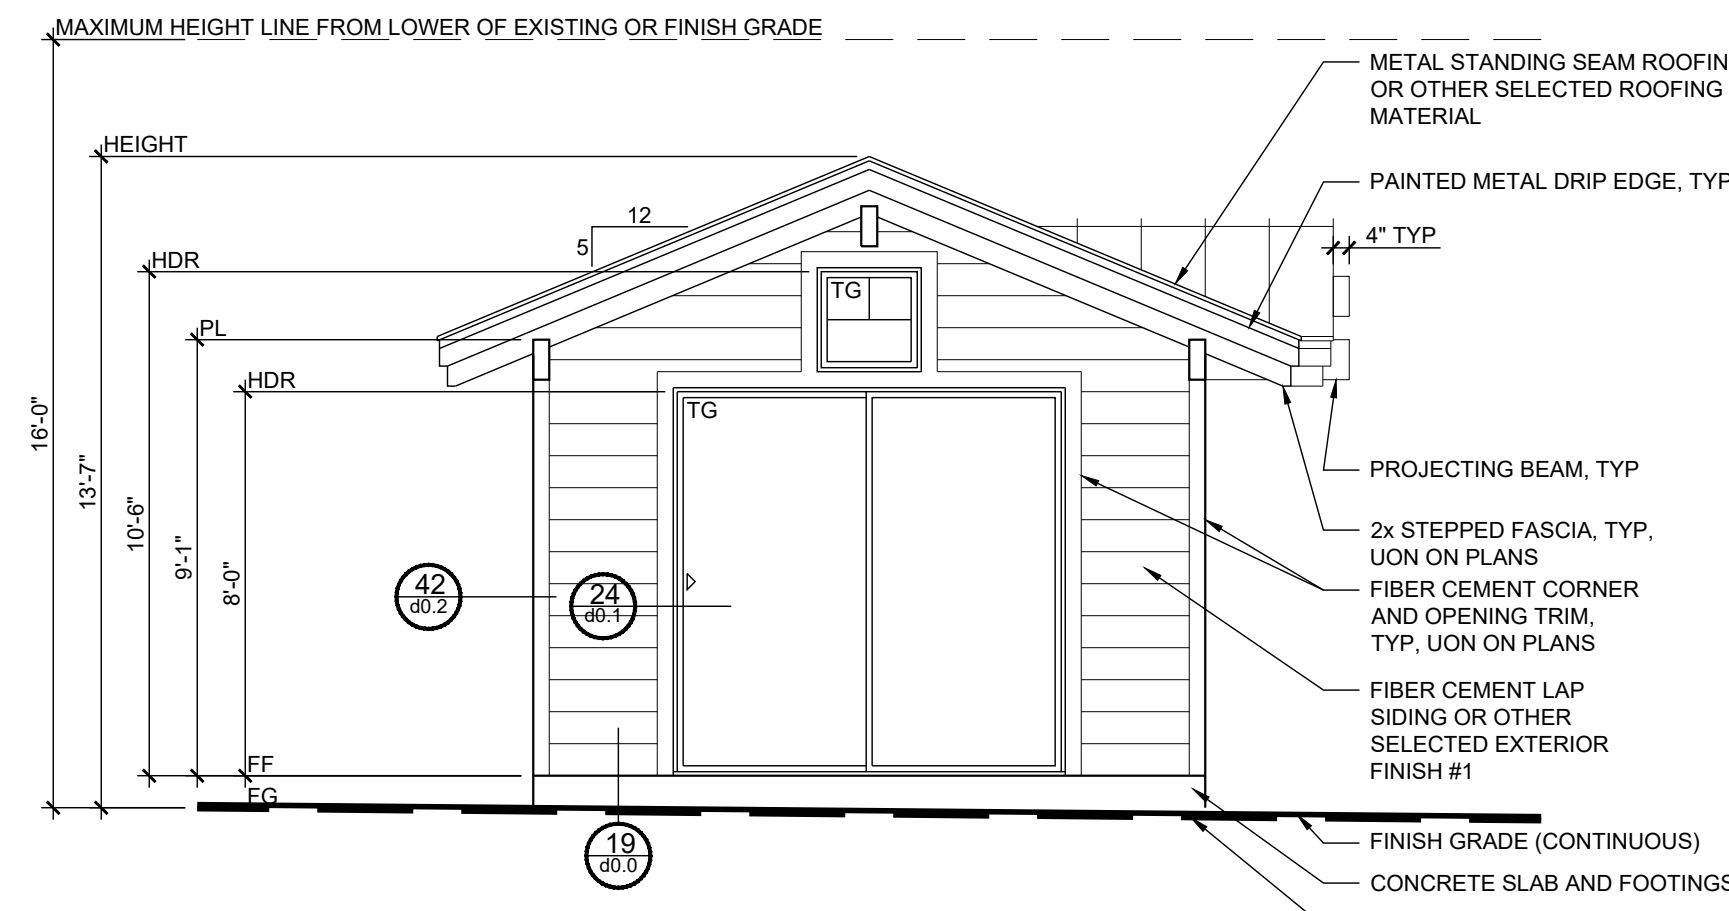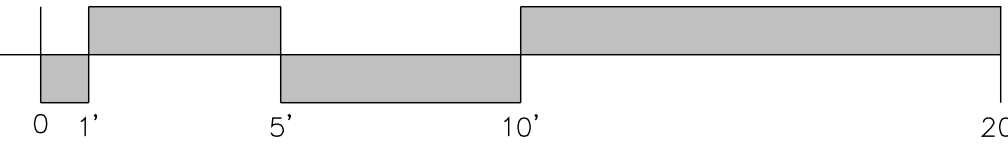


5 right elevation c
SCALE: 1/4" = 1'-0"

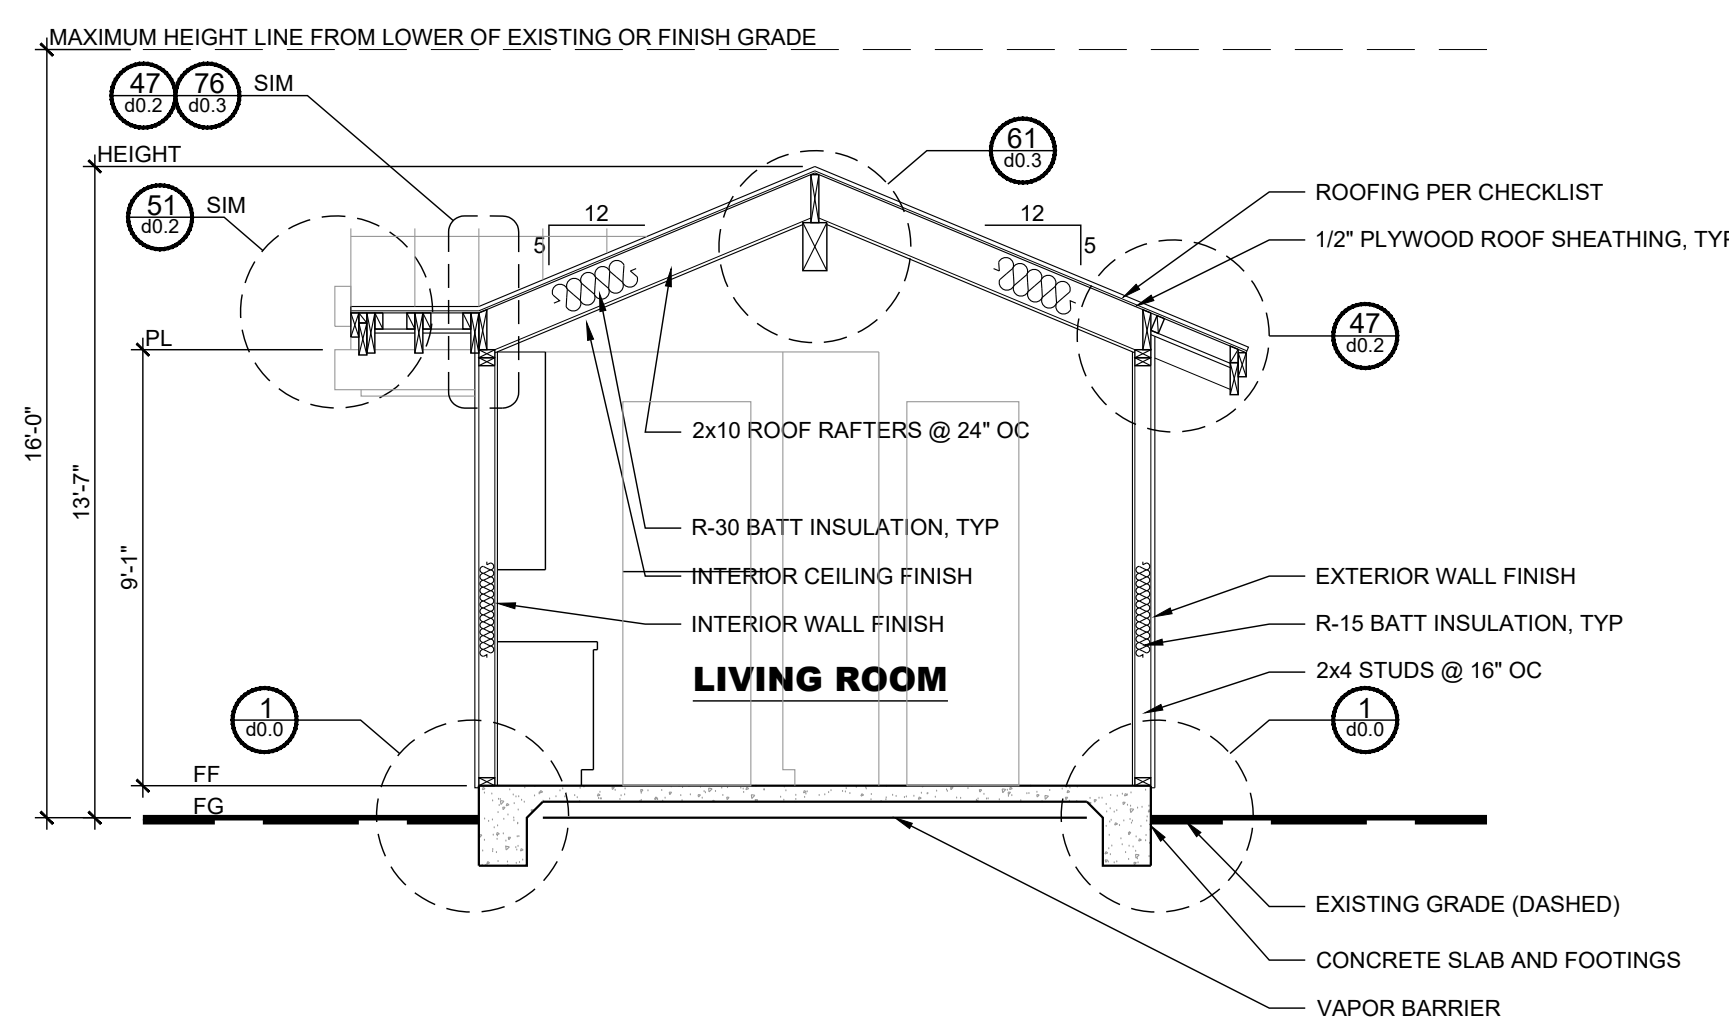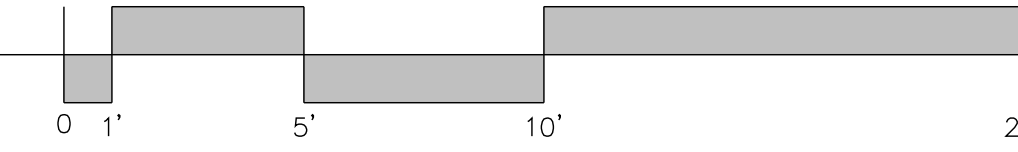

3 section e
SCALE: 1/4" = 1'-0"

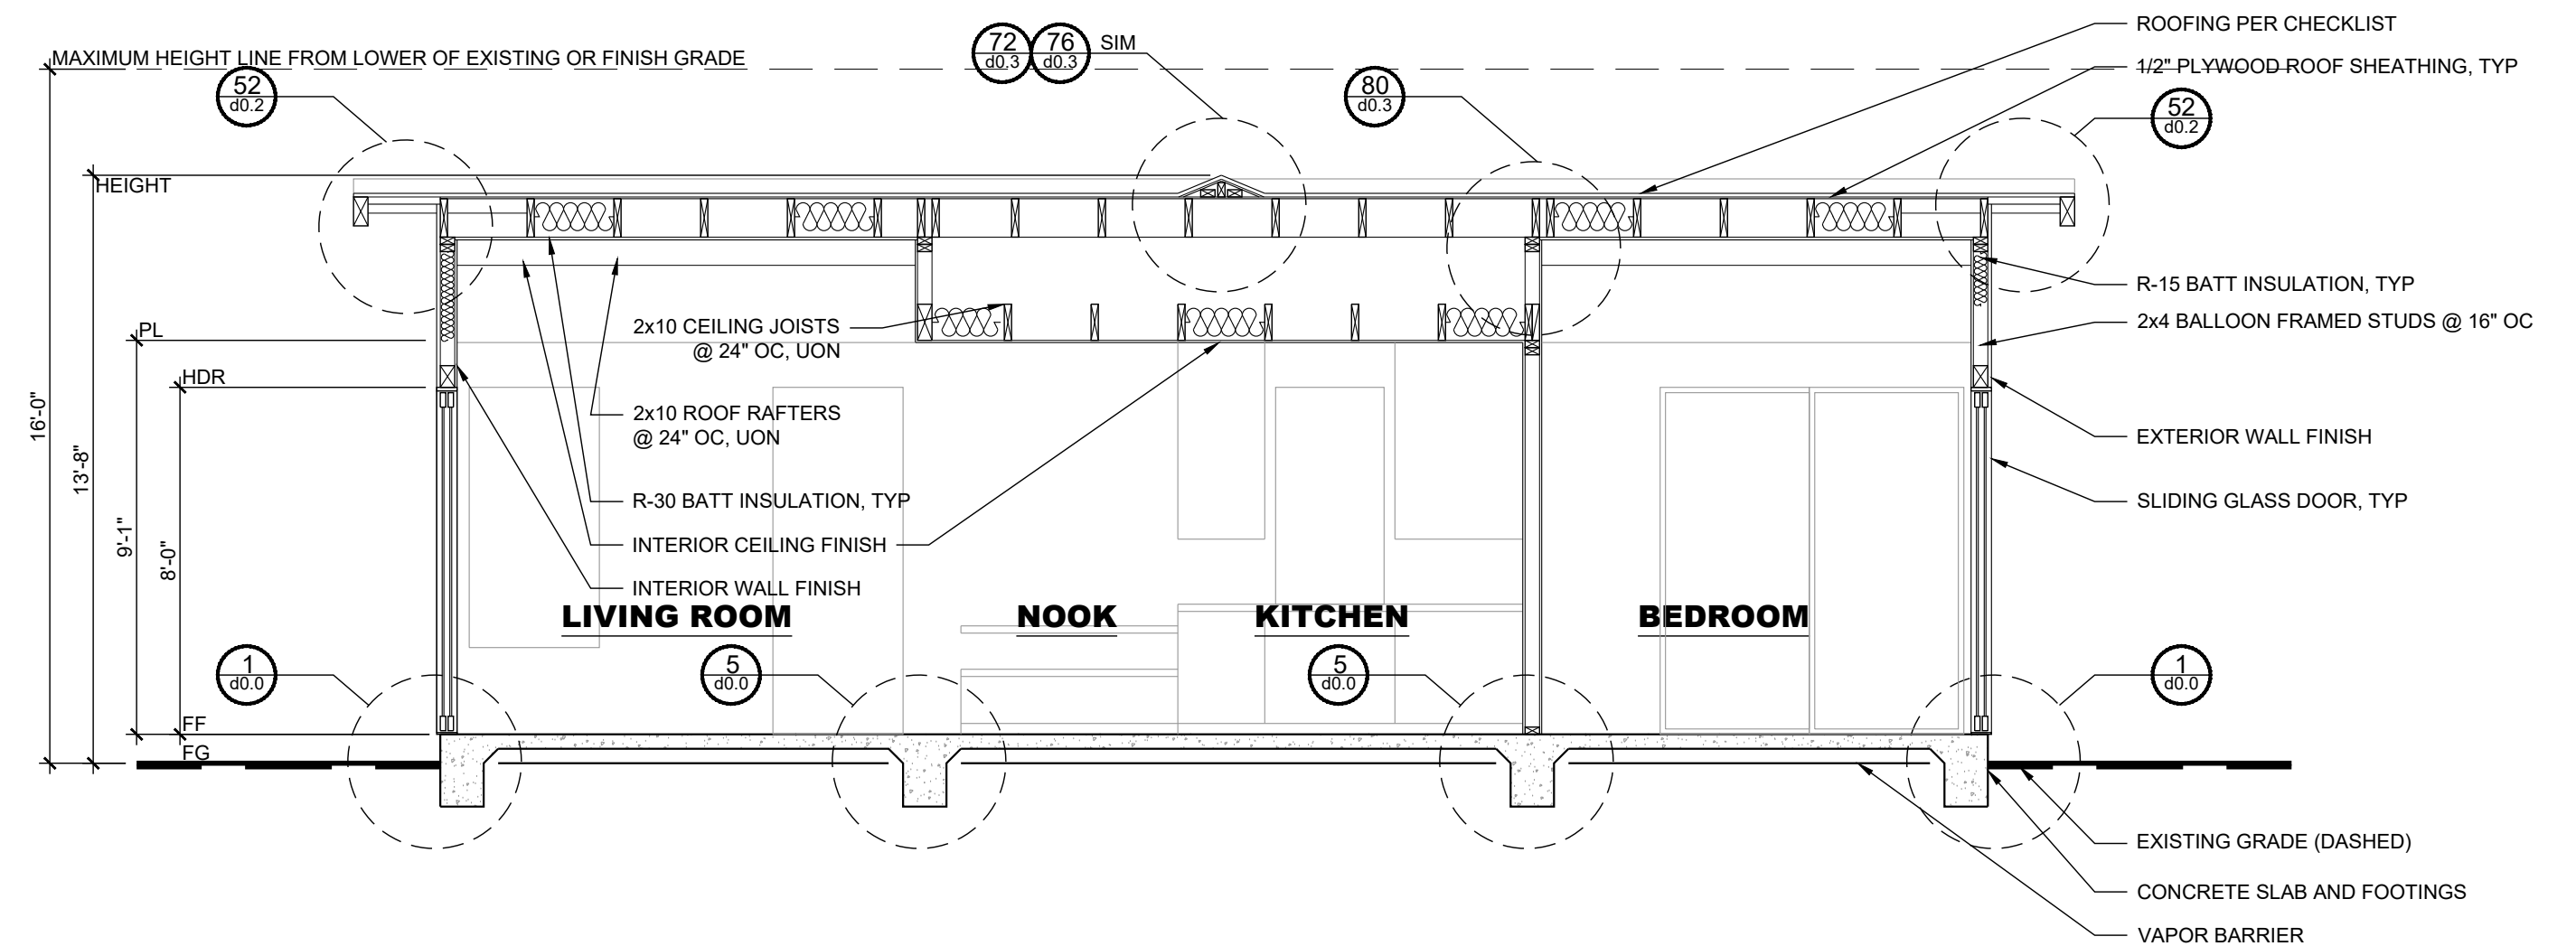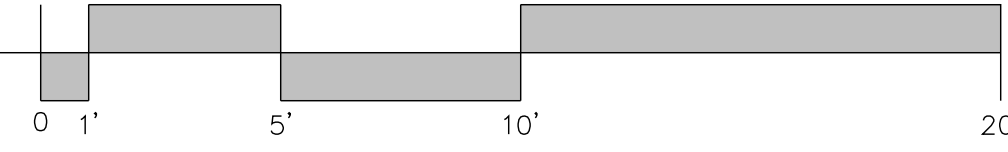

6 section f
SCALE: 1/4" = 1'-0"

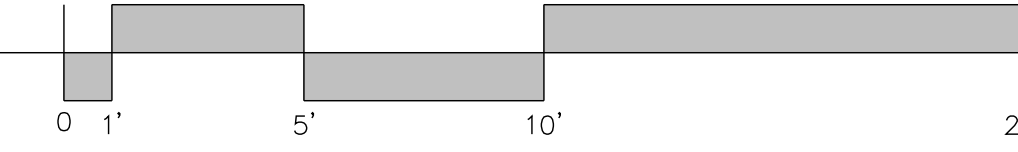

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


1 BEDROOM PRADU

CITY: ANAHEIM



JOB: 202409R

ELEVATION C + SECTION



a4.2

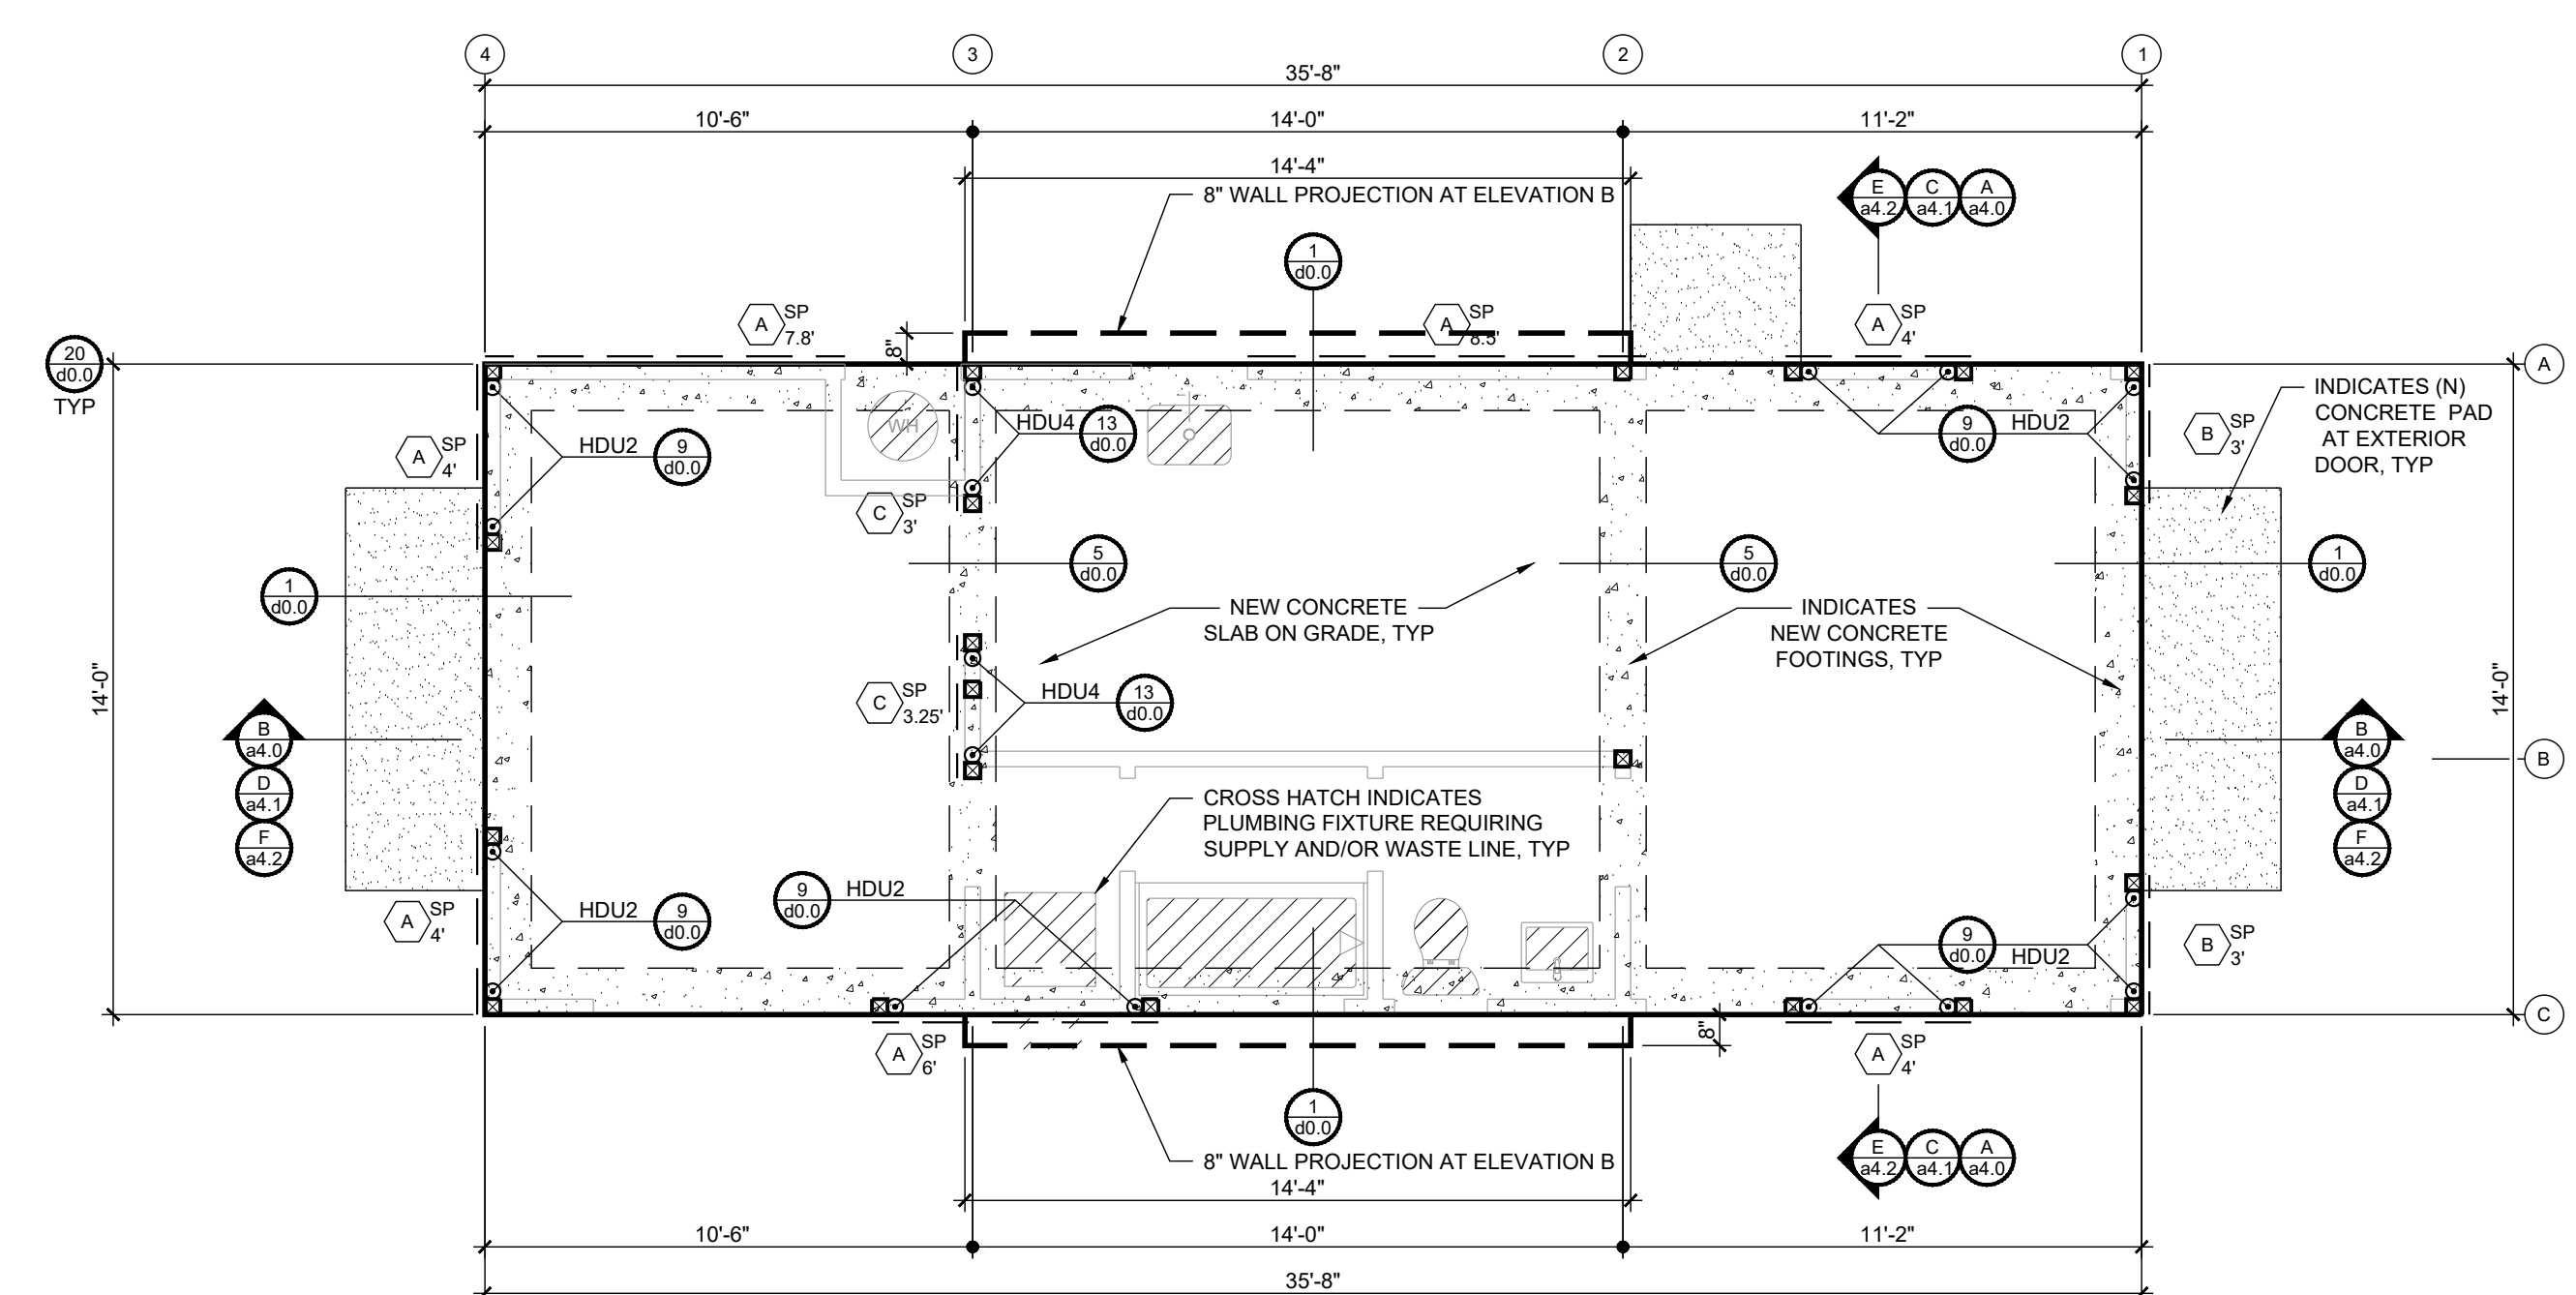


2 reverse foundation plan
SCALE: 1/4" = 1'-0"

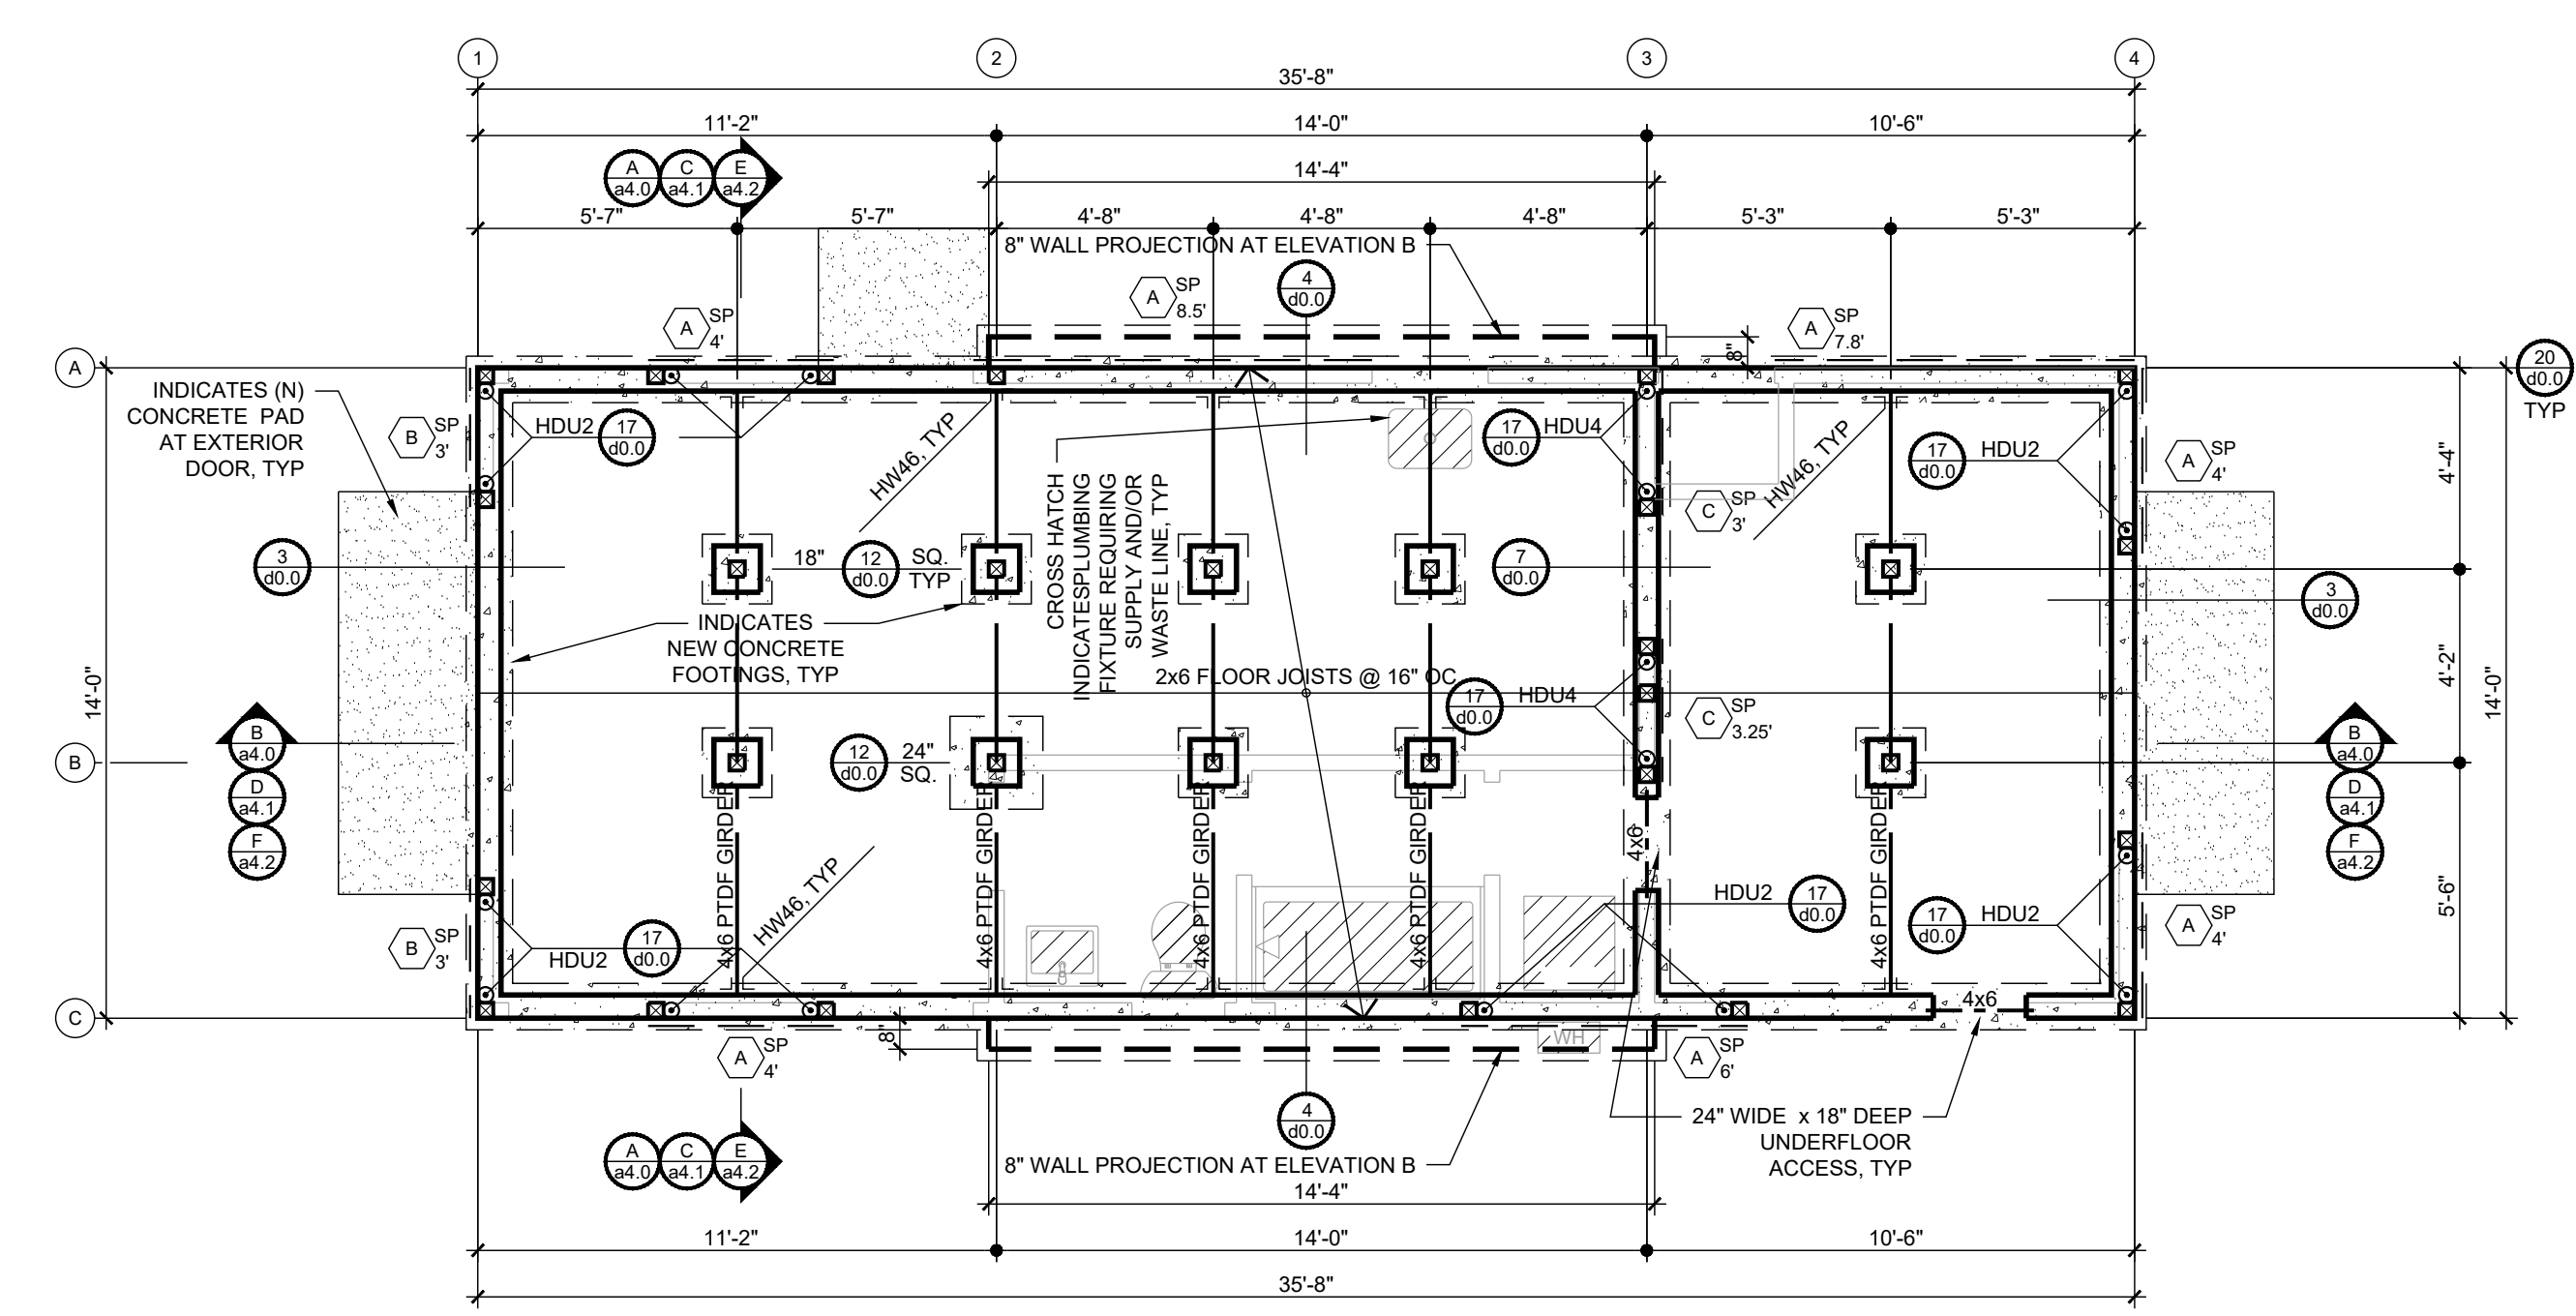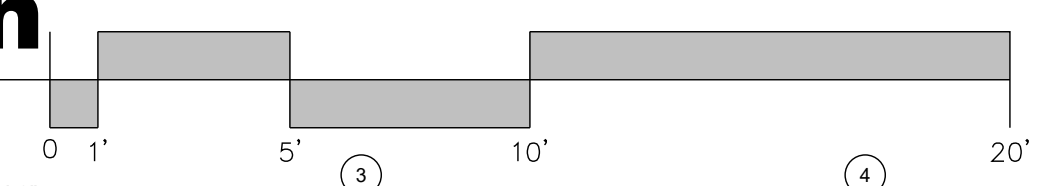

1 raised floor foundation
SCALE: 1/4" = 1'-0"

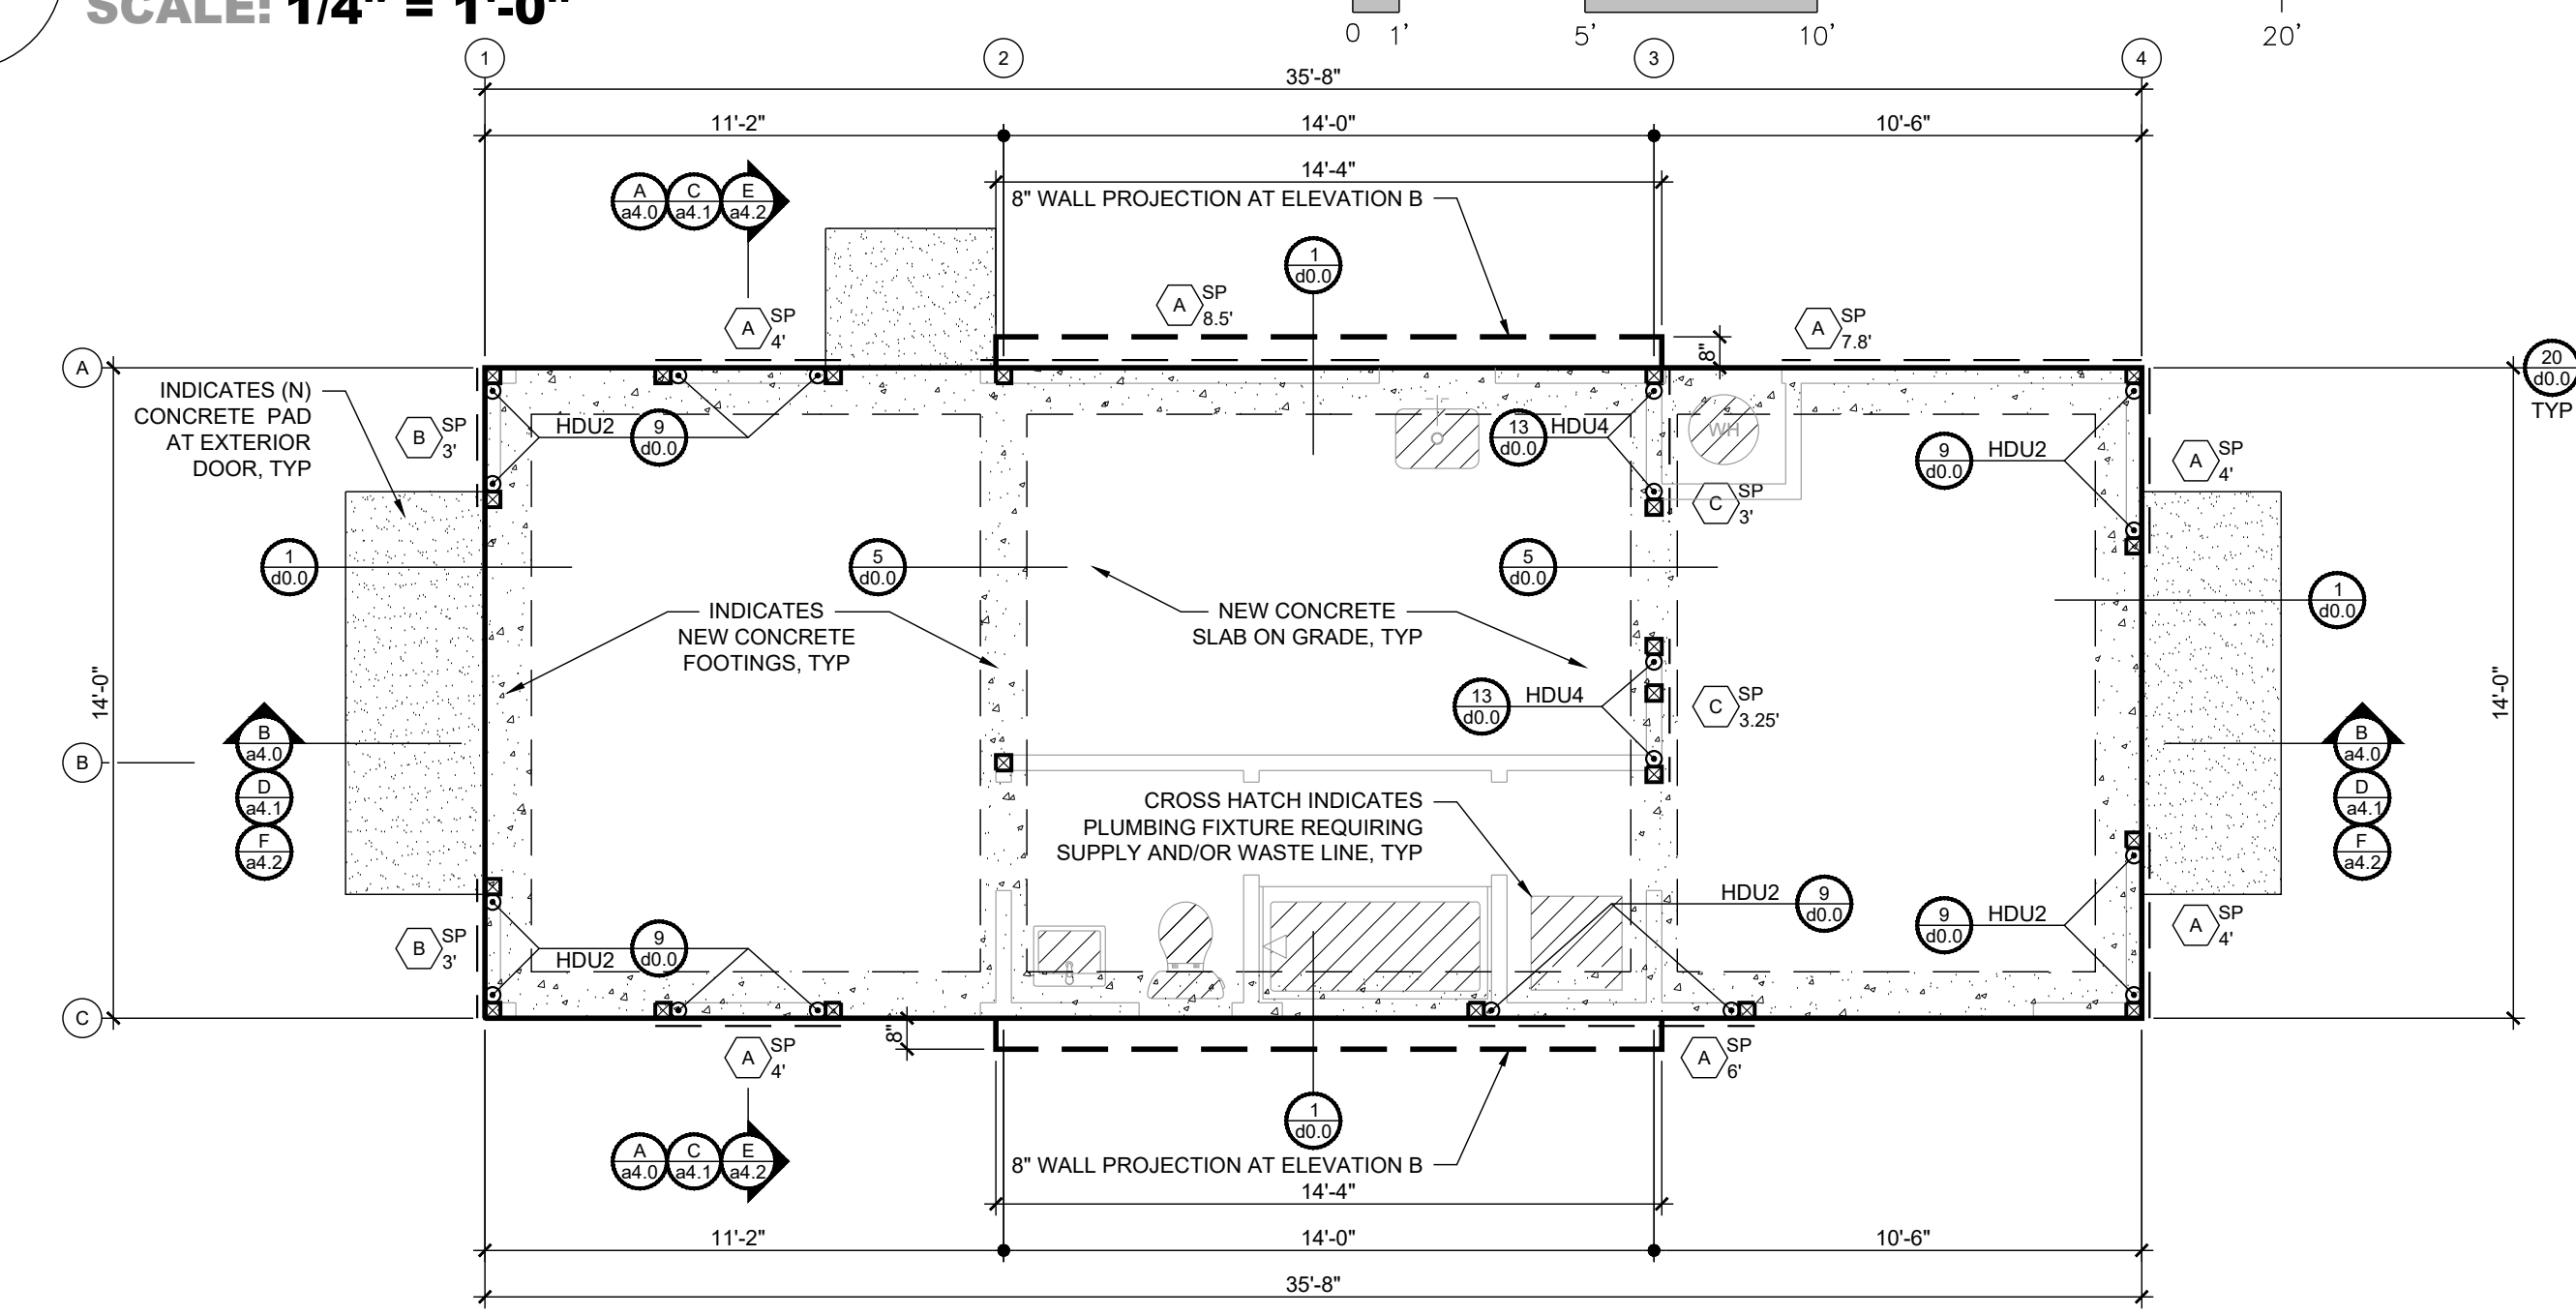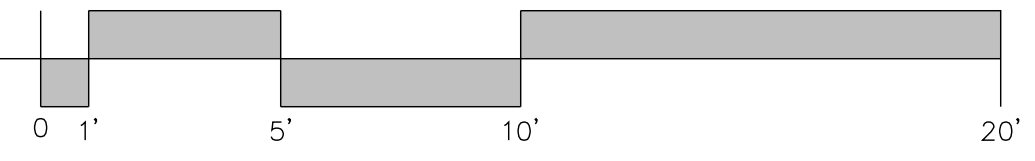

3 foundation plan
SCALE: 1/4" = 1'-0"

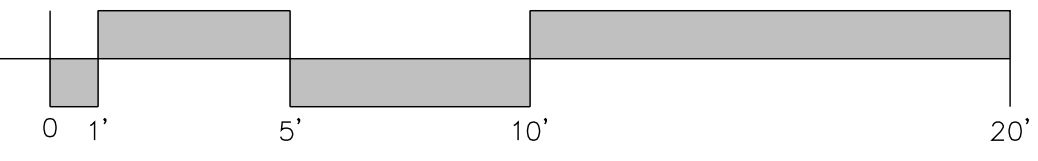

raised floor foundation notes:

- EXPANSIVE SOIL LOCATIONS SHALL PROVIDE FOOTING DIMENSIONS SPECIFIED IN DETAILS 3, 4, 7, 8 & 12/40.0 FOR EXPANSIVE SOILS.
- ROOF FRAMING PLAN FOR OTHER ELEVATIONS MAY HAVE DIFFERENT SHEAR PANEL LENGTHS. VERIFY SHEAR PANEL LENGTHS WITH ROOF FRAMING PLAN PRIOR TO PLACING HOLD DOWN AND/OR ANCHOR BOLTS.
- PROVIDE FOUNDATION VENTS FOR RAISED FLOOR AREA AT 1 SQ. FT. OF VENT AREA FOR EVERY 150 SQ. FT. OF RAISED FLOOR AREA. 499/150 = 3.33 SQ. FT. TWELVE (12) 3"x14" FOUNDATION VENTS ARE REQUIRED AND SHALL BE EVENLY DISTRIBUTED AT THE FOUNDATION PERIMETER. CRC §408.1
- PROVIDE A 18"x24" FOUNDATION ACCESS TO RAISED FLOOR FOUNDATION AREAS. CRC §408.4
- PROVIDE R-19 BATT INSULATION AT UNDER-FLOOR JOISTS, TYP.
- FLOOR DIAPHRAGM SHALL BE 23/32" APA STURD-I-FLOOR, EXPOSURE 1, 40/20, TONGUE & GROOVE WITH 10d COMMON NAILS @ 6" OC AT BOUNDARY (BN) & PANEL EDGE NAILING (EN) AND 12" OC AT INTERMEDIATE FRAMING MEMBERS (FN).

foundation plan notes:

- EXPANSIVE SOIL LOCATIONS SHALL SUBSTITUTE DETAIL 2/40.0 FOR DETAIL 1/40.0 AT PERIMETER FOOTINGS.
- EXPANSIVE SOIL LOCATIONS SHALL SUBSTITUTE DETAIL 6/40.0 FOR DETAIL 5/40.0 AT INTERIOR FOOTINGS.
- ROOF FRAMING PLAN FOR OTHER ELEVATIONS MAY HAVE DIFFERENT SHEAR PANEL LENGTHS. VERIFY SHEAR PANEL LENGTHS WITH ROOF FRAMING PLAN PRIOR TO PLACING HOLD DOWN AND/OR ANCHOR BOLTS.

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM

1 BEDROOM PRADU

CITY: ANAHEIM

JOB: 202409R


FOUNDATION PLANS

s1.0



roof framing plan notes:

- ENCLOSED RAFTER SPACES DO NOT REQUIRE VENTING IF THE FOLLOWING SPECIFIC INSULATION DESIGN IS USED, PER SECTIONS R806.5/EM3.9.6:
 - IF THE INSULATION IS AIR-PERMEABLE AND IT IS INSTALLED DIRECTLY BELOW THE ROOF SHEATHING WITH RIGID BOARD OR SHEET INSULATION WITH A MINIMUM R-5 VALUE INSTALLED ABOVE THE ROOF SHEATHING. (OR)
 - IF THE INSULATION IS AIR-IMPERMEABLE AND IT IS IN DIRECT CONTACT WITH THE UNDERSIDE OF THE ROOF SHEATHING. (OR)
 - IF TWO LAYERS OF INSULATION ARE INSTALLED BELOW THE ROOF SHEATHING: AN AIR-IMPERMEABLE LAYER IN DIRECT CONTACT WITH THE UNDERSIDE OF THE ROOF SHEATHING AND AN ADDITIONAL LAYER OF AIR-PERMEABLE INSULATION INSTALLED DIRECTLY UNDER THE AIR-IMPERMEABLE INSULATION. DETAILS 86, 87 & 88/d0.4 PROVIDE MORE INFORMATION ABOUT THESE ROOF INSULATION ALTERNATIVES.
- ROOF DIAPHRAGM SHALL BE 15/32" APA RATED SHEATHING (MIN), EXPOSURE 1, 24/0 MAXIMUM SPAN RATING WITH 8d COMMON NAILS @ 6" OC AT BOUNDARY (BN) & PANEL EDGE NAILING (EN) AND 12" OC AT INTERMEDIATE FRAMING MEMBERS (FN).
- 4X6 IS THE MINIMUM MEMBER ALLOWED AT A TRELLIS.
- TRELLIS MEMBERS AND OTHER WEATHER EXPOSED MEMBERS SHALL BE PRESSURE TREATED DOUGLAS FIR (PTDF) OR NATURALLY PEST AND ROT RESISTANT WOOD SPECIES SUCH AS REDWOOD OR CEDAR, TYP, OAE



FOR CITY STAMPS

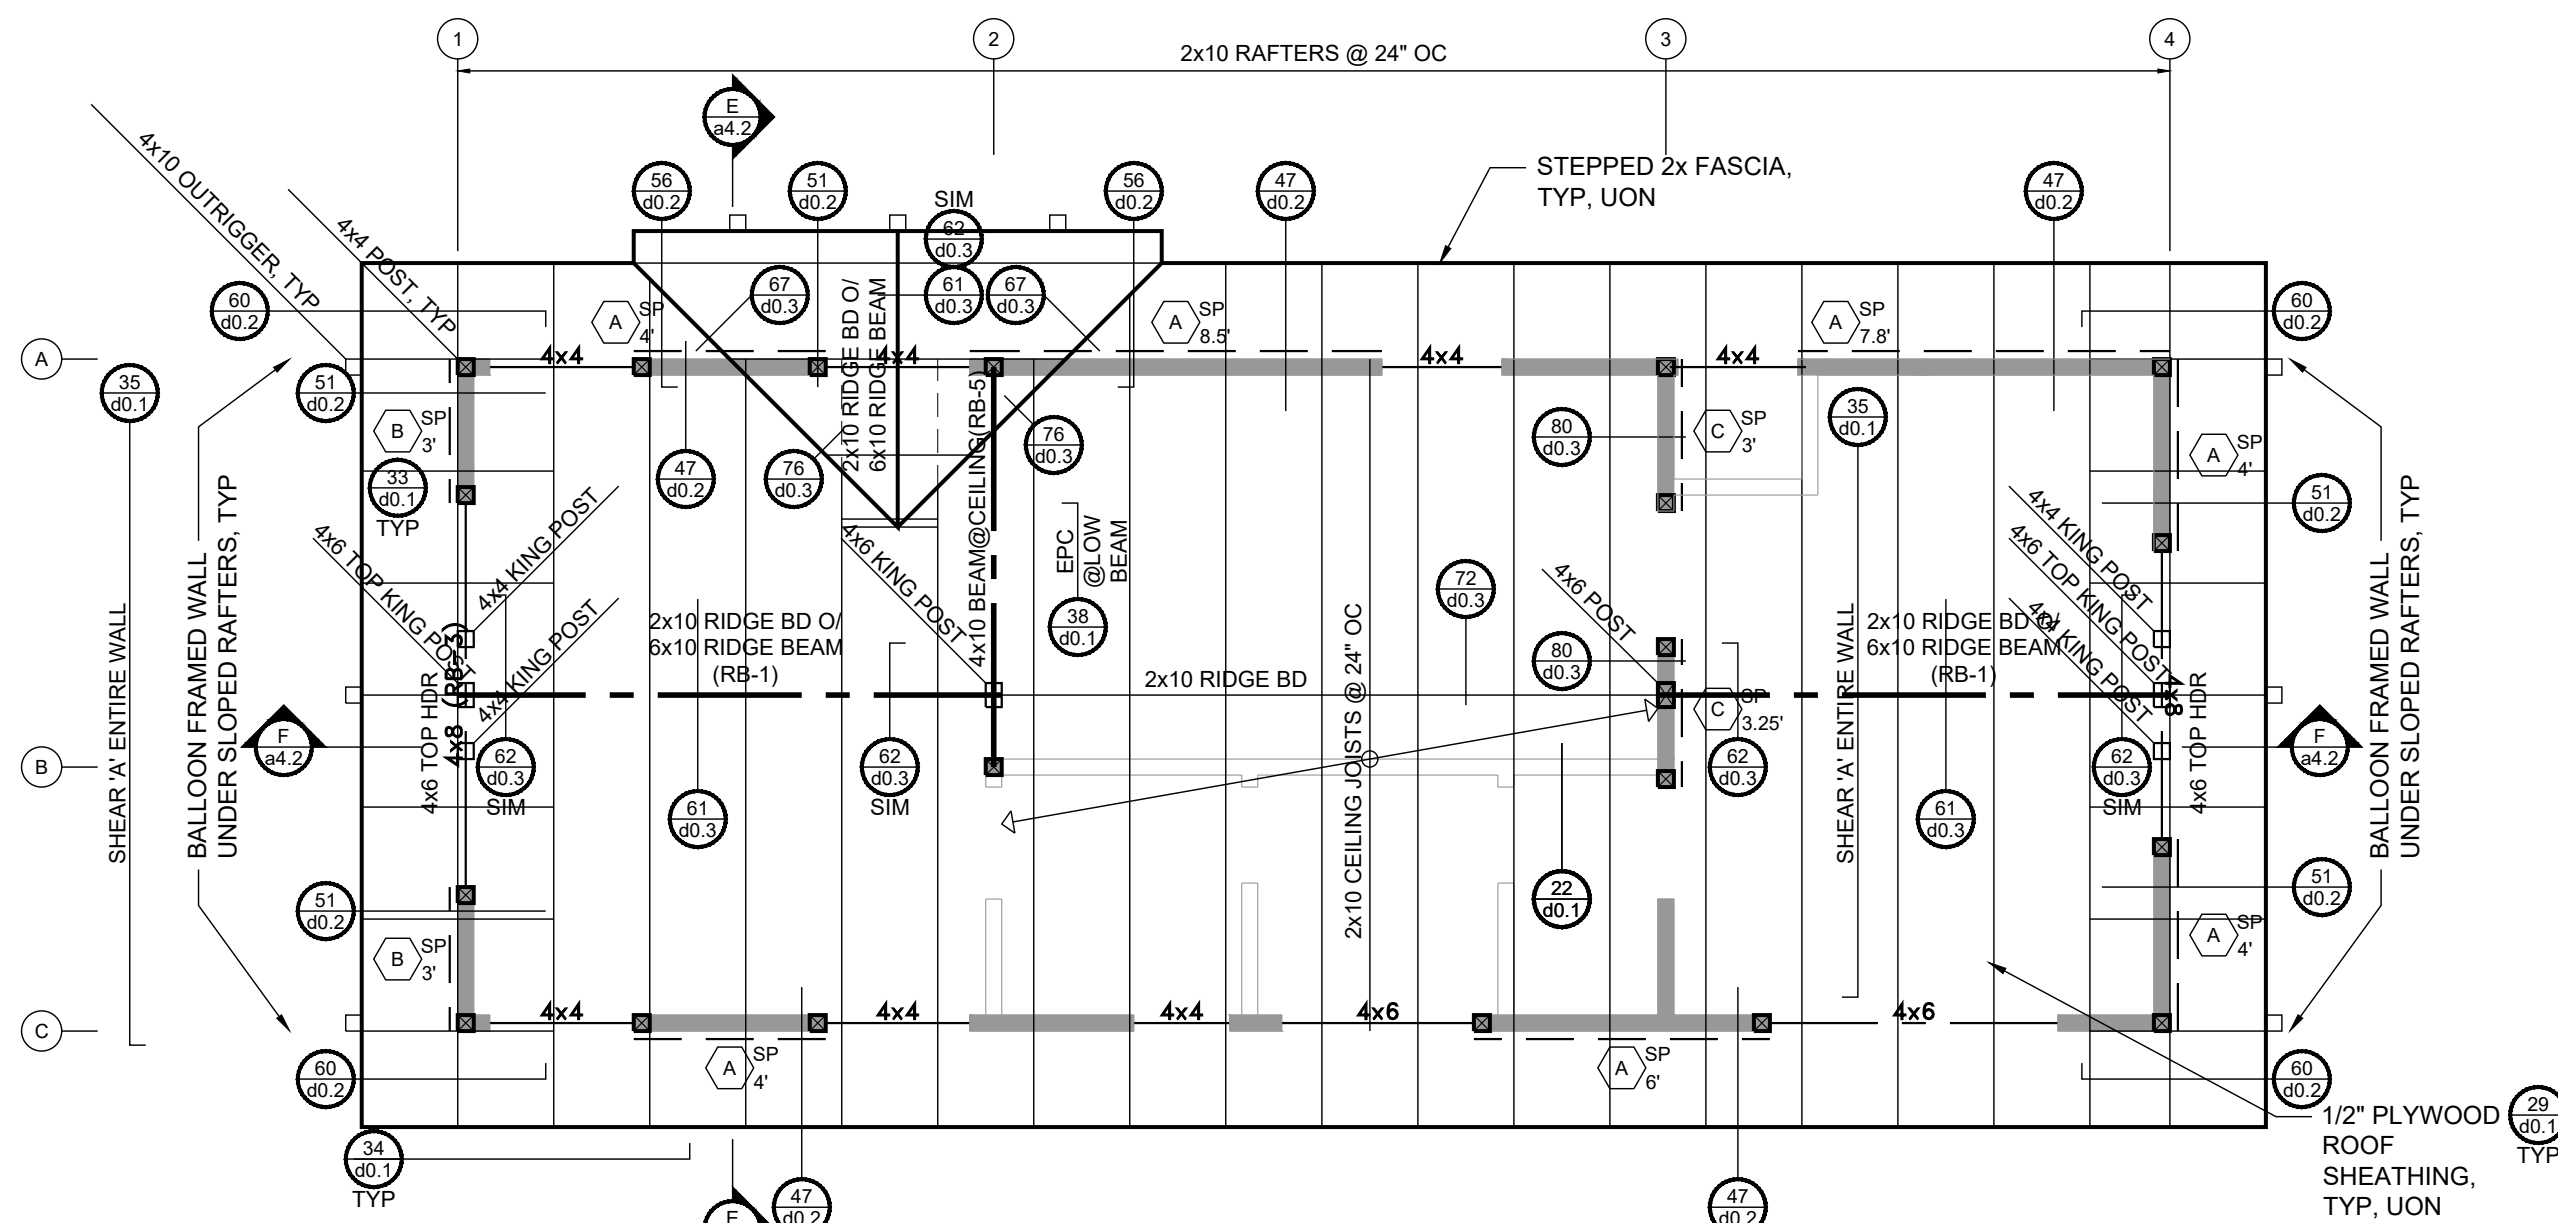


1 roof framing plan c
SCALE: 1/4" = 1'-0"

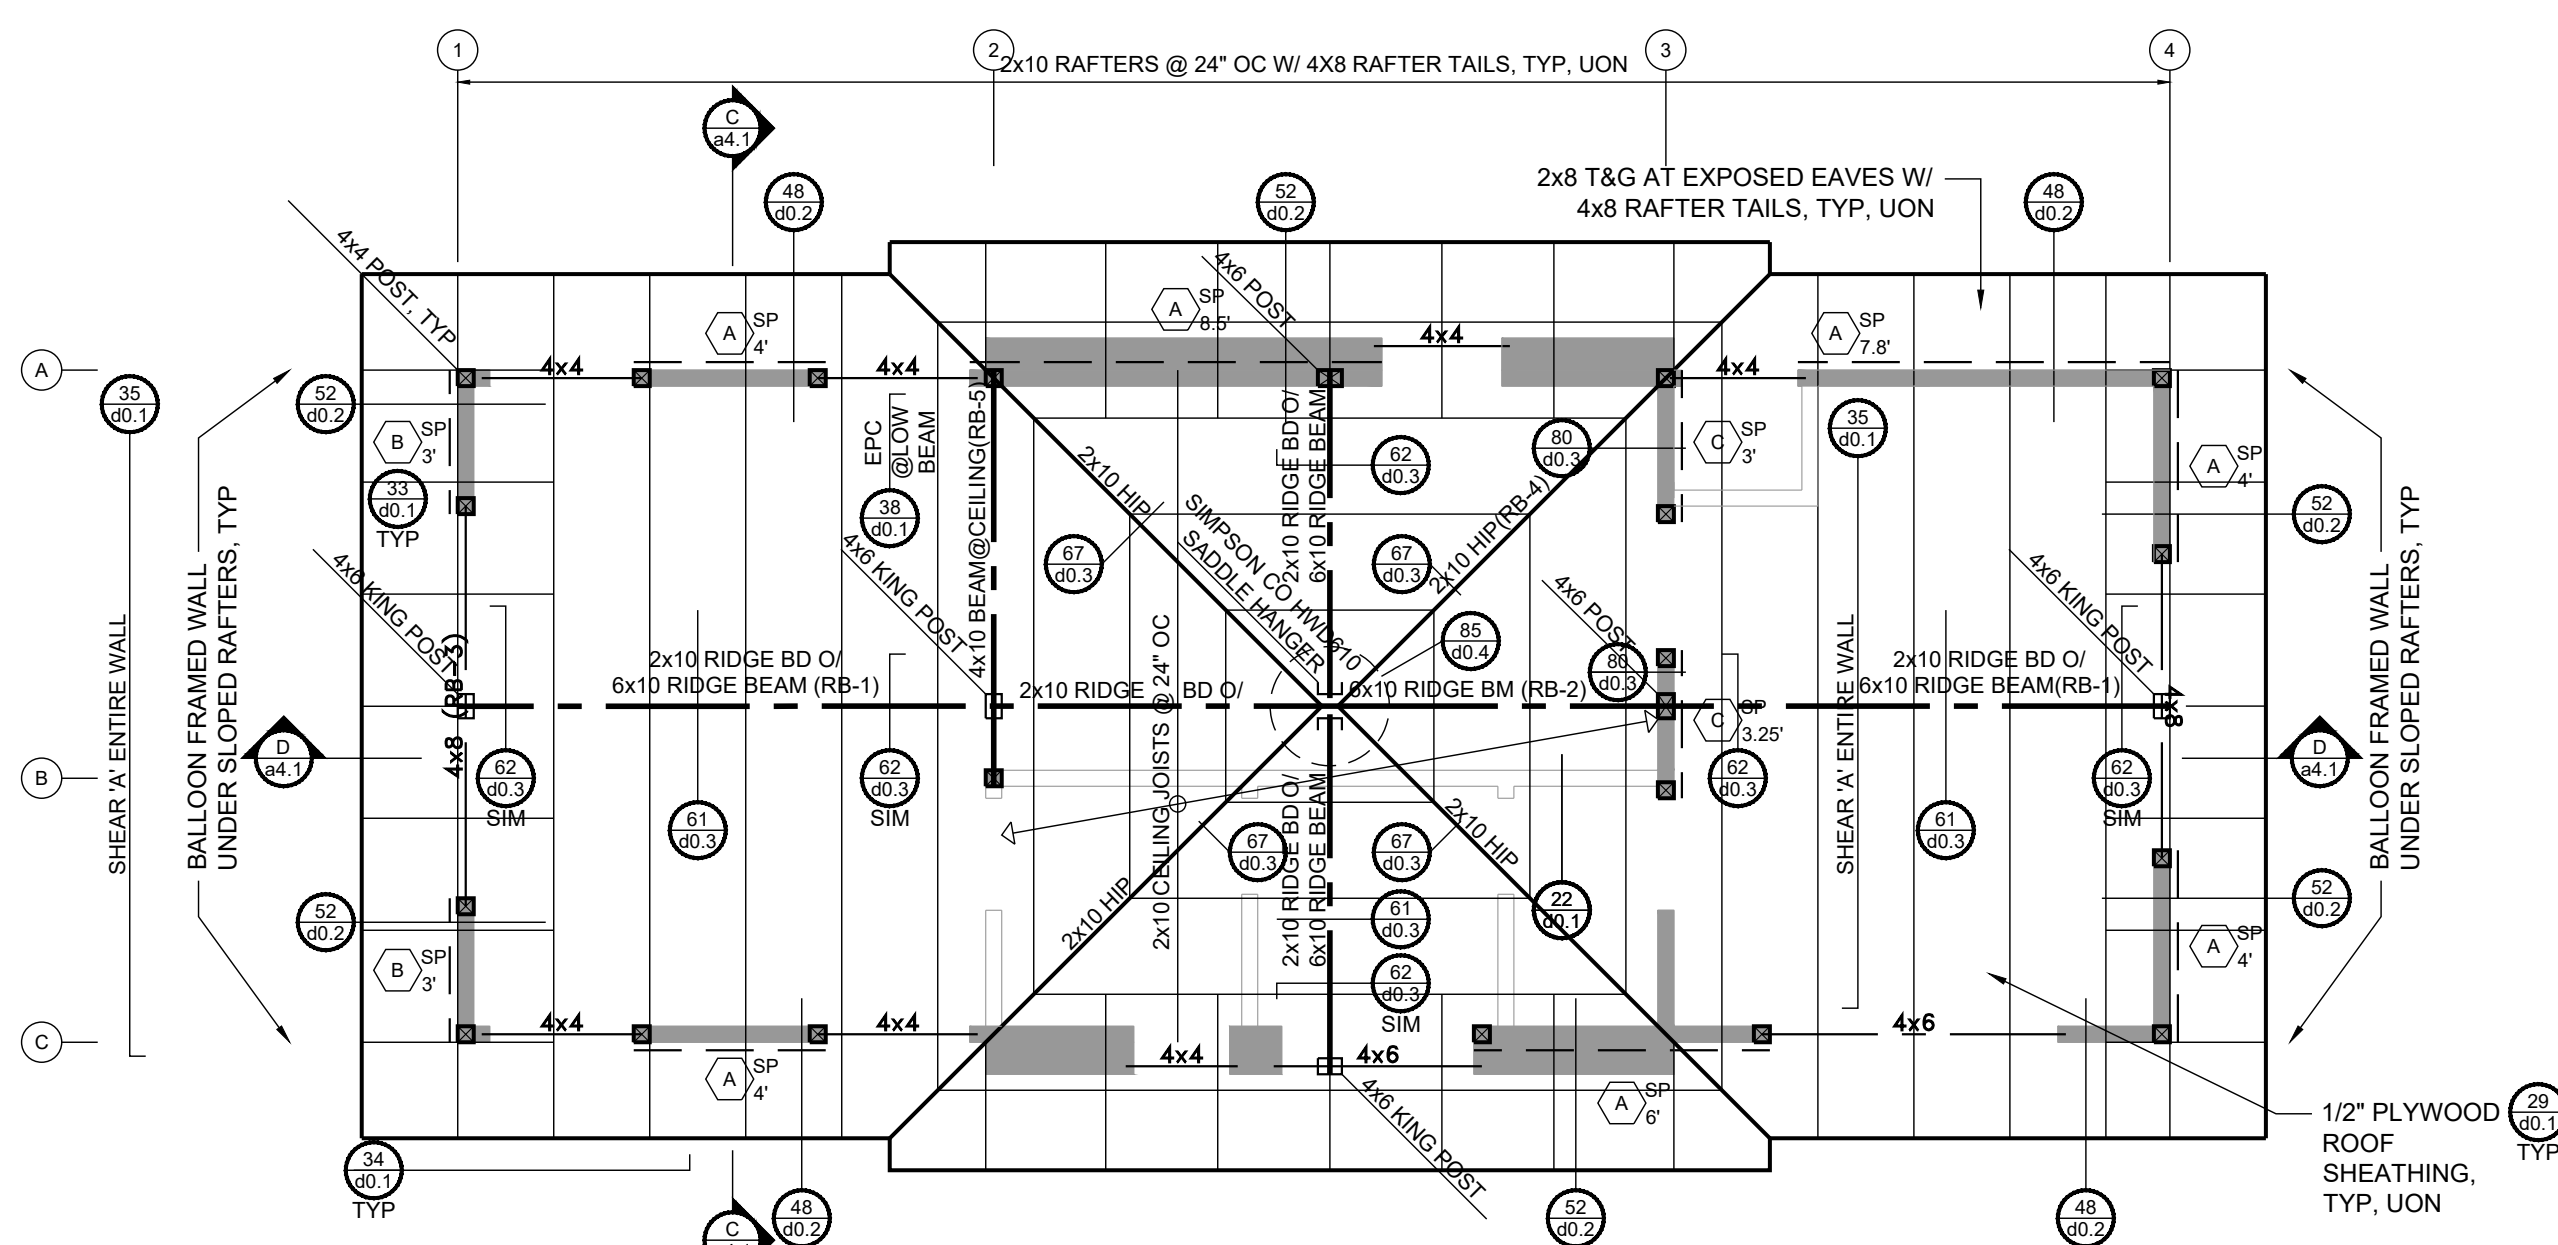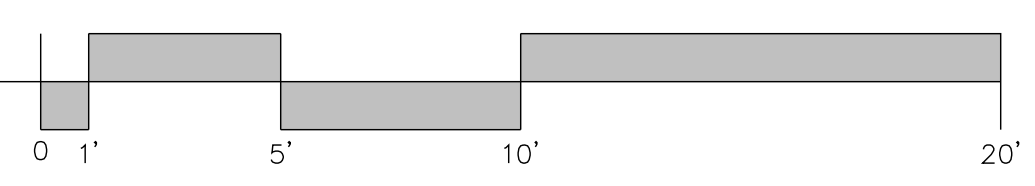

2 roof framing plan b
SCALE: 1/4" = 1'-0"

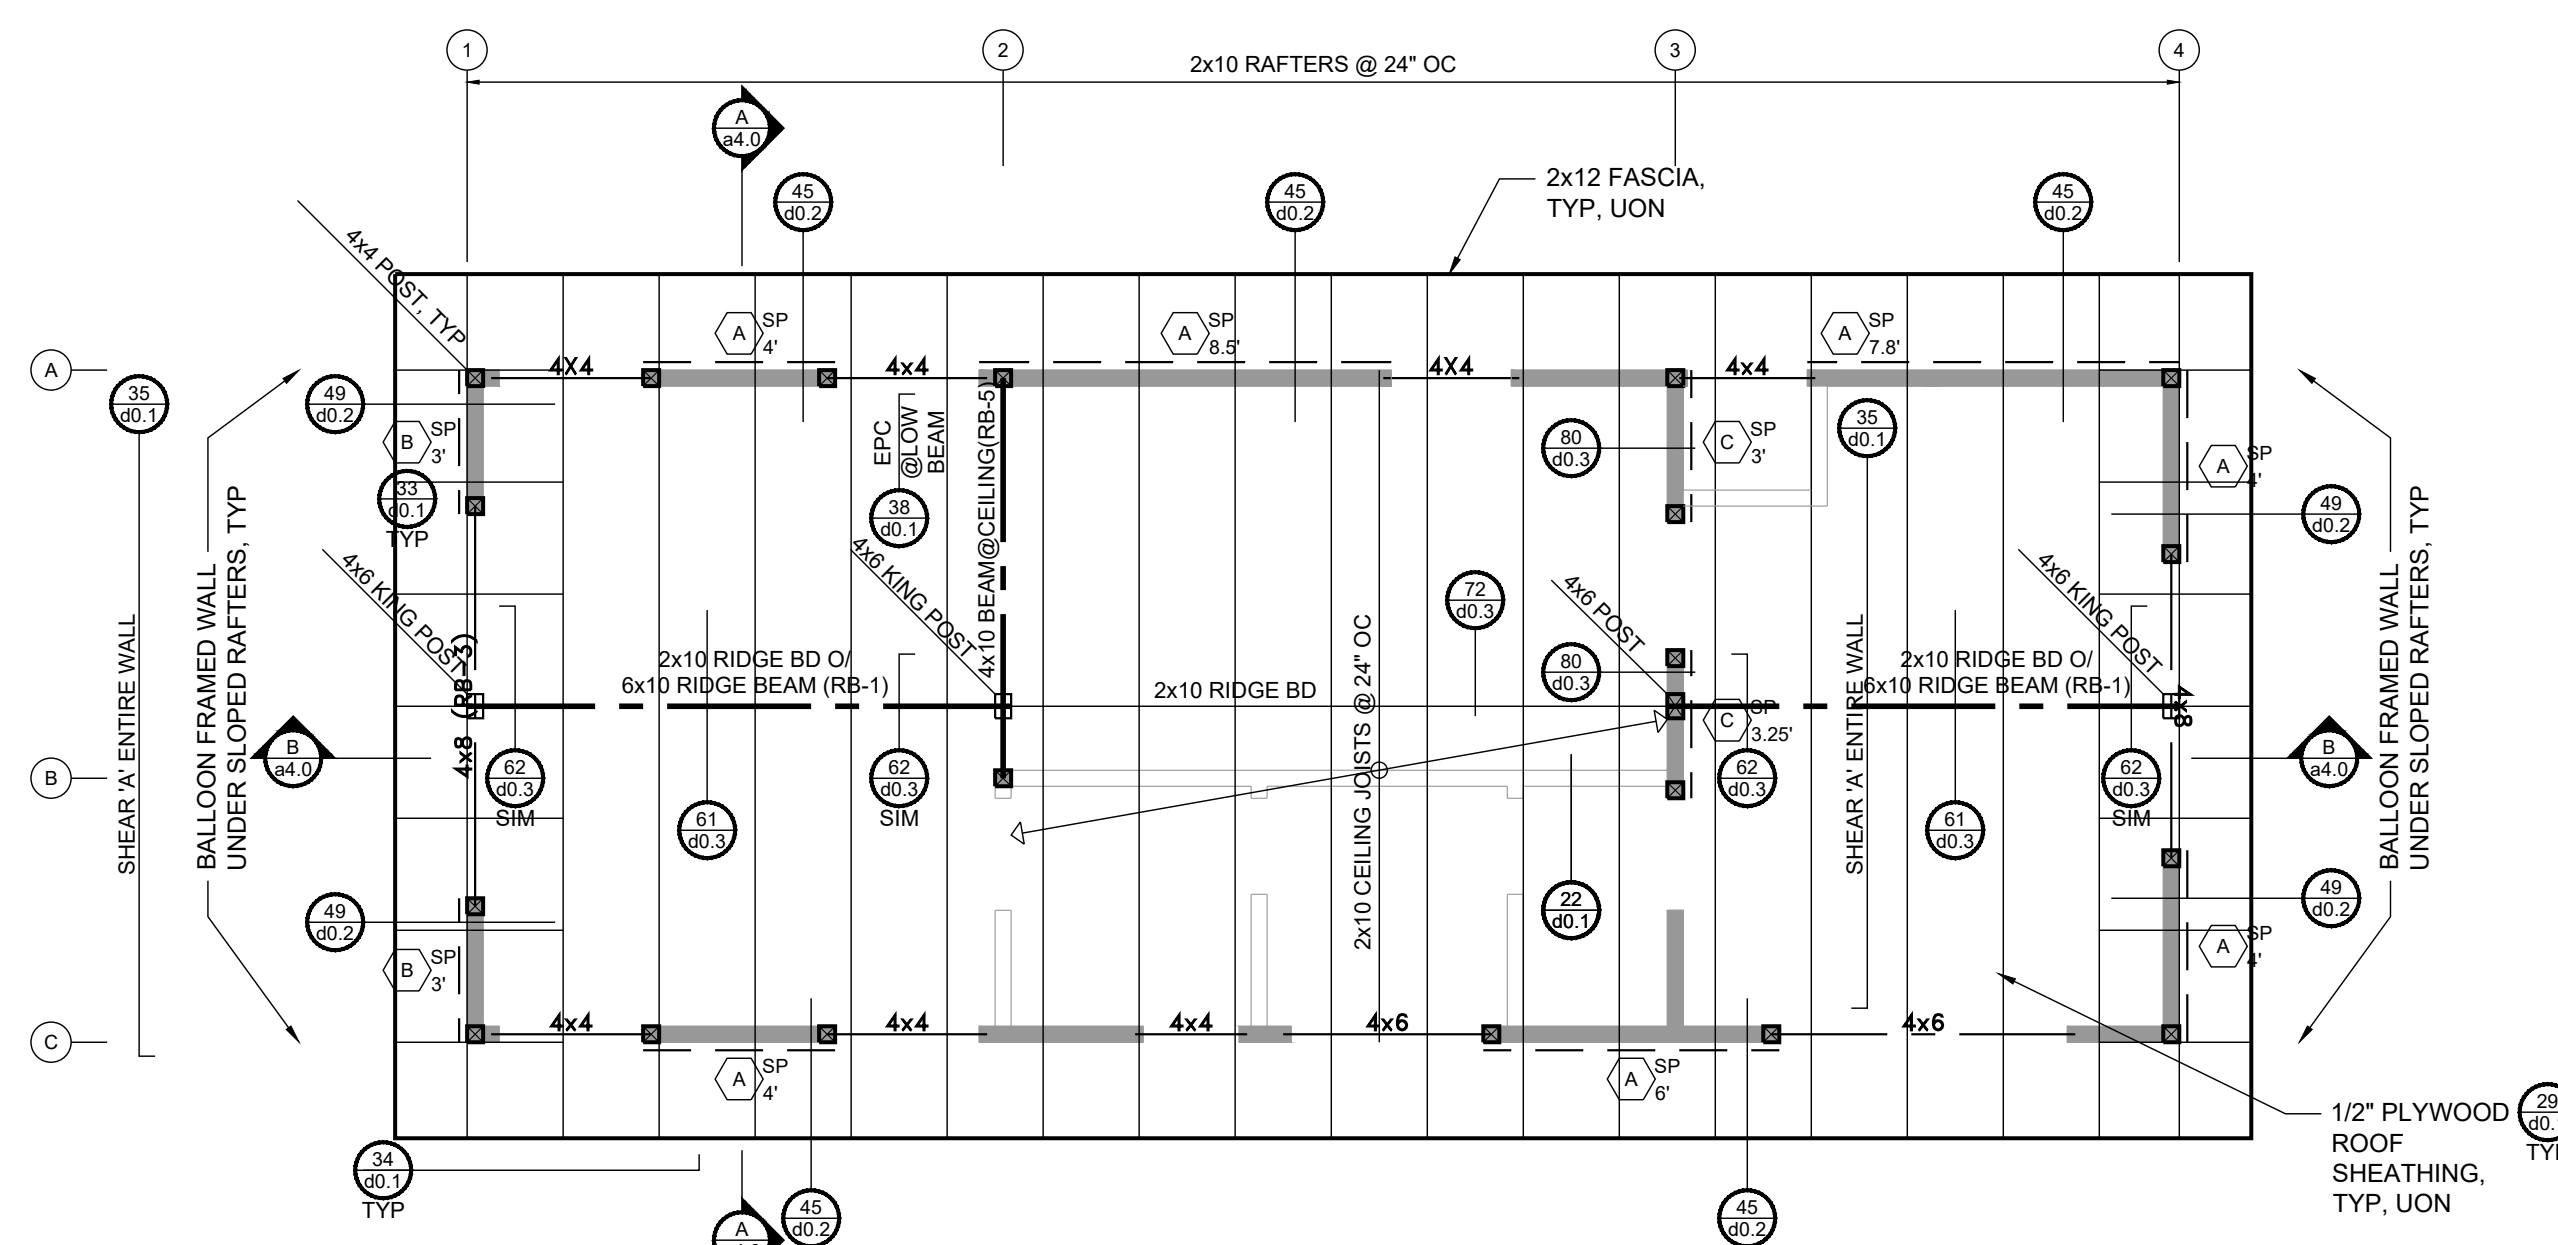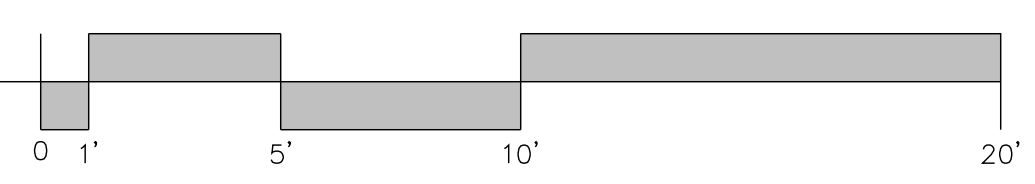

3 roof framing plan a
SCALE: 1/4" = 1'-0"

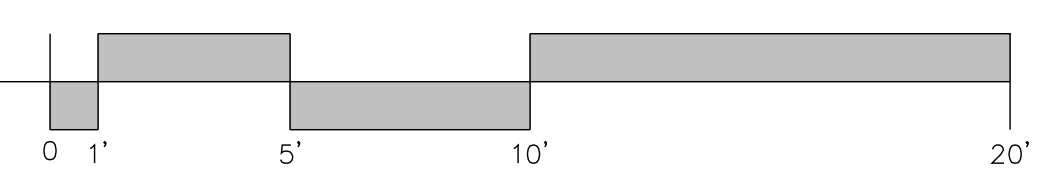

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM

1 BEDROOM PRADU


CITY: ANAHEIM

JOB: 202409R


ROOF FRAMING PLANS

s2.0


MODEL NO.	ANCHOR BOLT	CONNECTION TO POST	EMBEDMENT	EDGE DISTANCE	MIN WD MEMBER THICKNESS
HDU2	5/8" (S51816)	6-SDS 1/2"x2 1/2"	12 3/4"	1 3/4"	3"
HDU4	5/8" (S51820)	10-SDS 1/2"x2 1/2"	16 3/4"	1 3/4"	3"
HDU5	5/8" (S51824)	14-SDS 1/2"x2 1/2"	20 3/4"	1 3/4"	3"
HDU8	5/8" (S51828)	20-SDS 1/2"x2 1/2"	24 3/4"	1 3/4"	3"
HDU11	1" (S81X30)	30-SDS 1/2"x2 1/2"	24"	1 3/4"	5 1/2"
HDU14	1" (S81X30)	36-SDS 1/2"x2 1/2"	24"	1 3/4"	7 1/4"

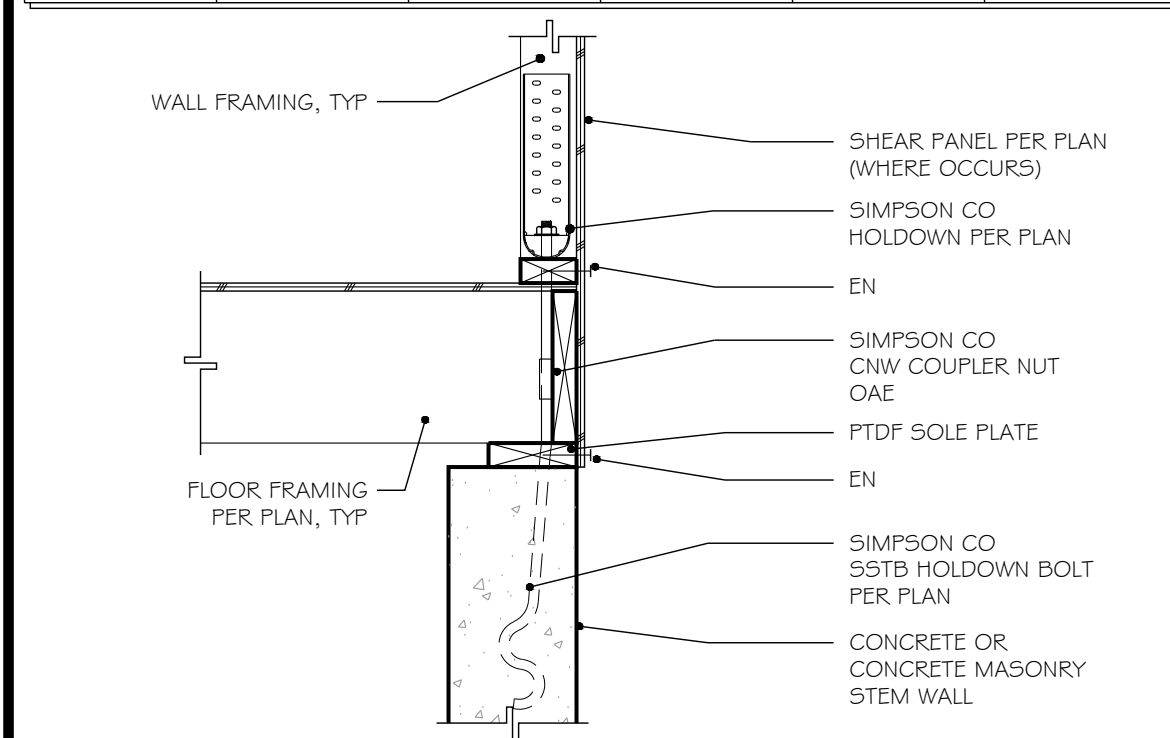


17 HOLDOWN AT STEM WALL FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0096

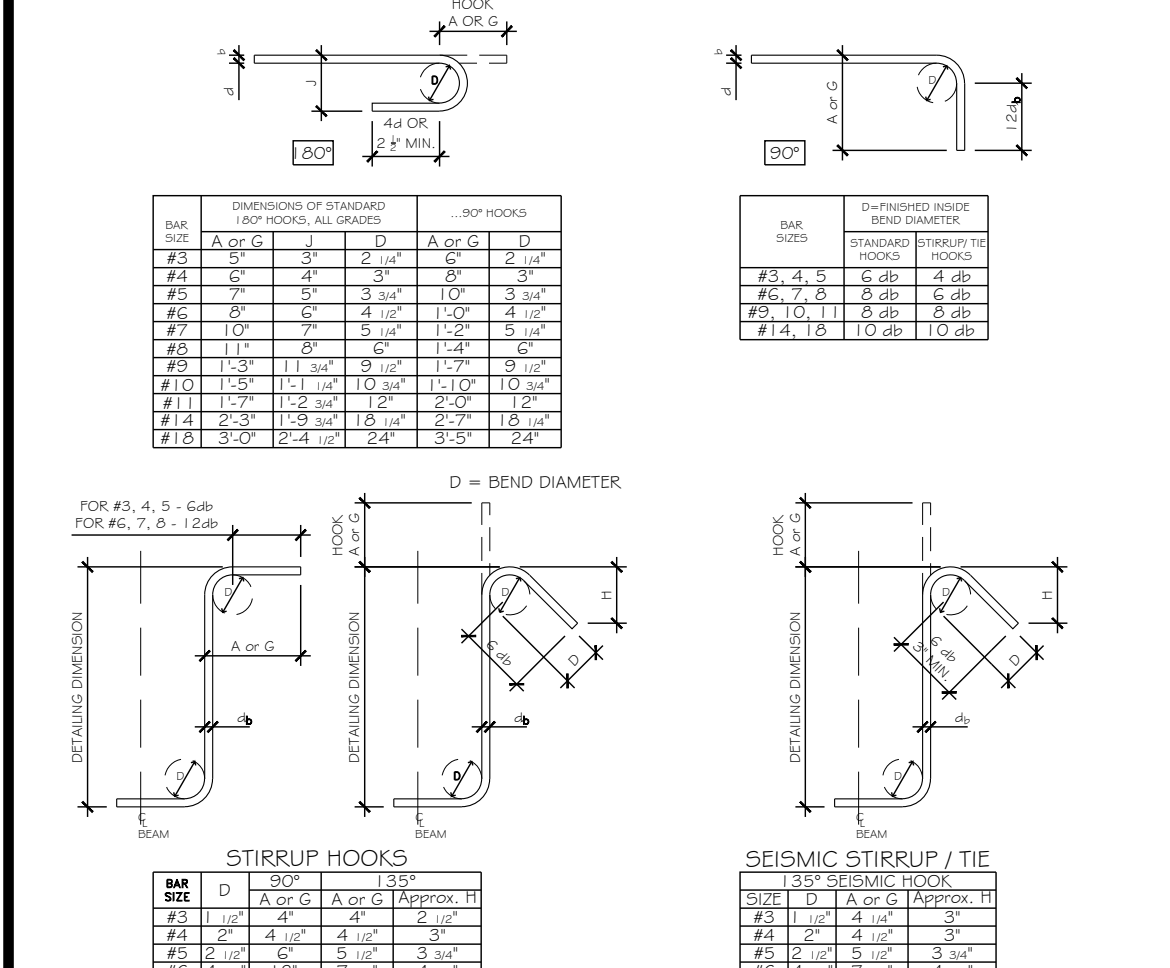


18 STANDARD HOOK DETAILS
SCALE: N.T.S.
A-DT-FDN-SG-0041

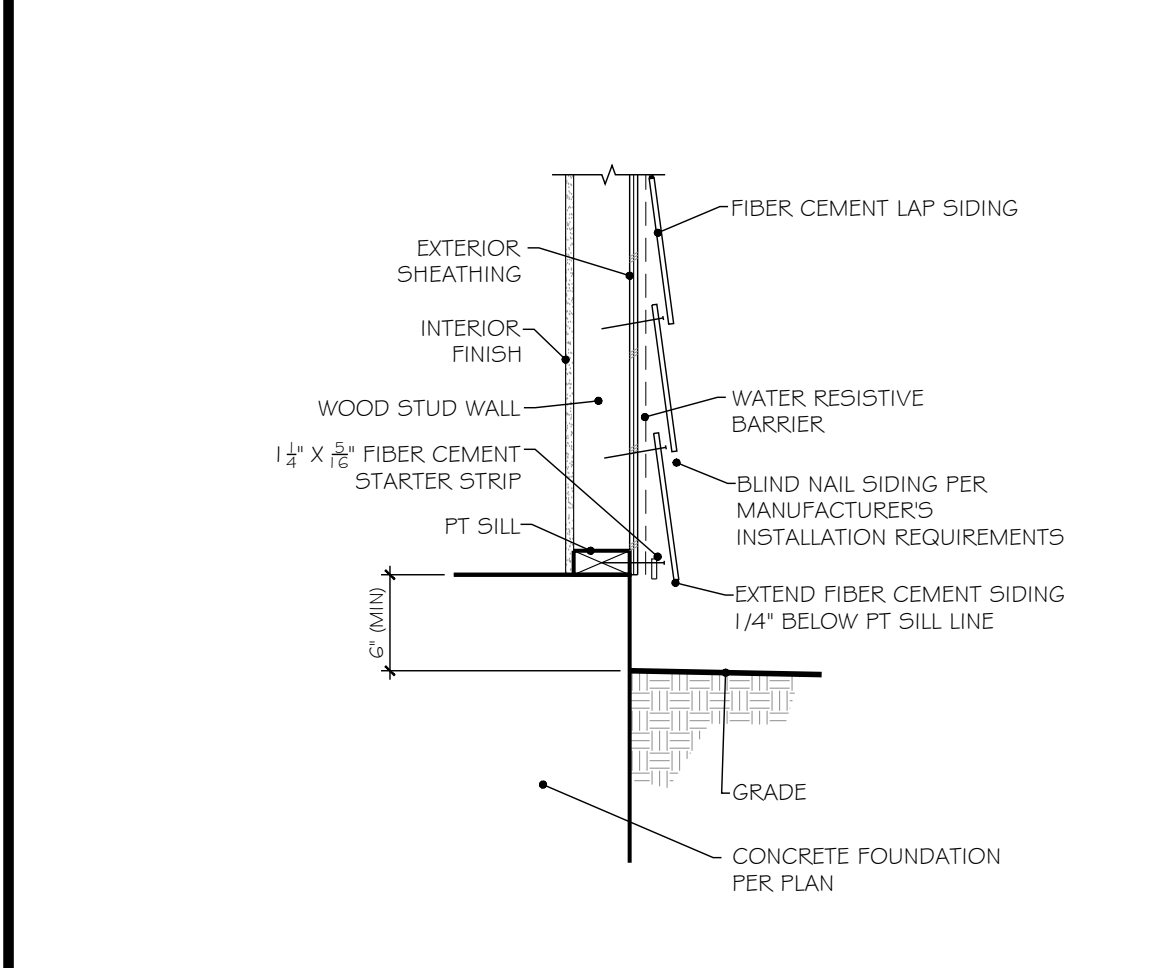

19 LAP SIDING AT FOUNDATION
SCALE: 1" = 1'-0"
A-DT-FIN-FC5-15-0001

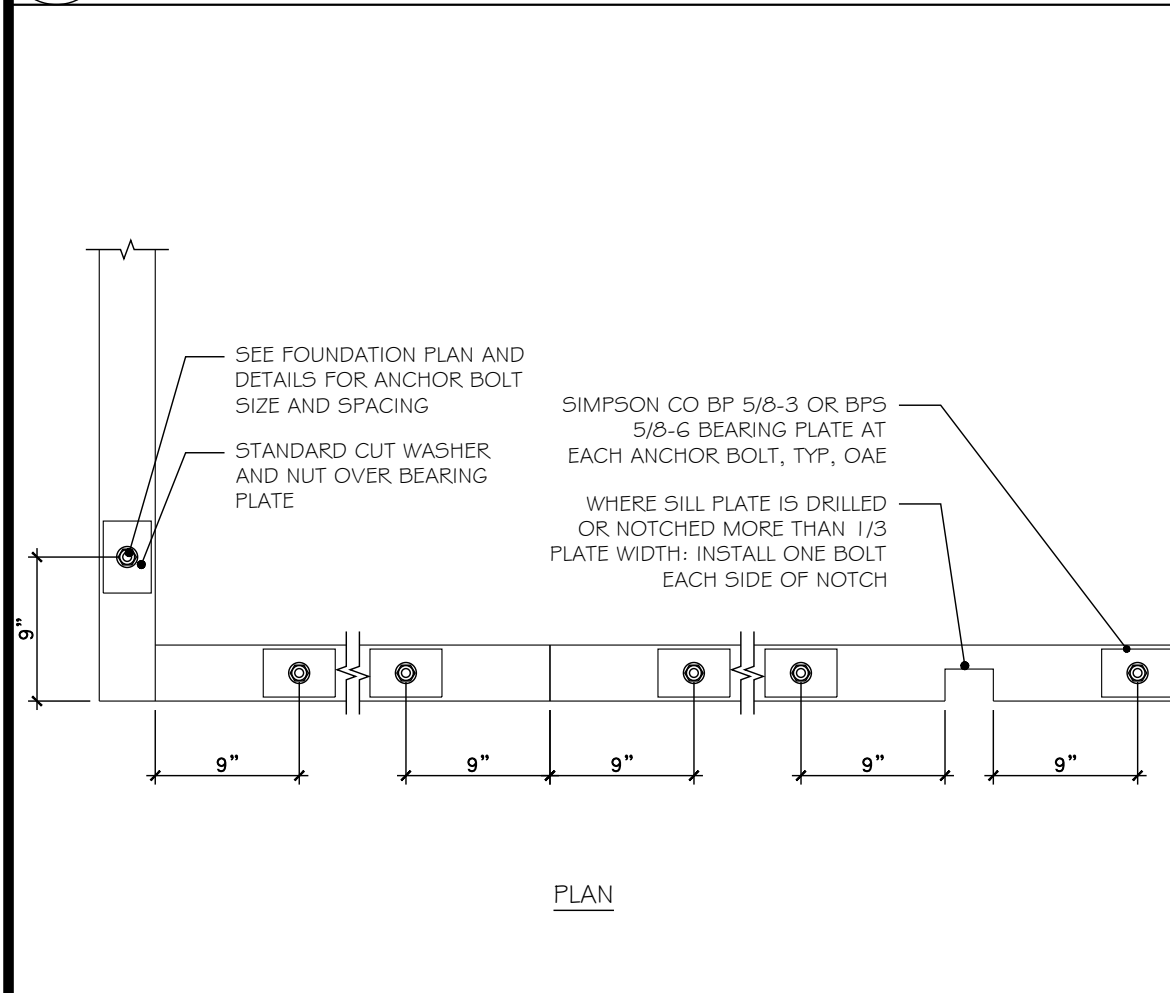


20 SILL PLATE ANCHOR BOLTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-ANC-002

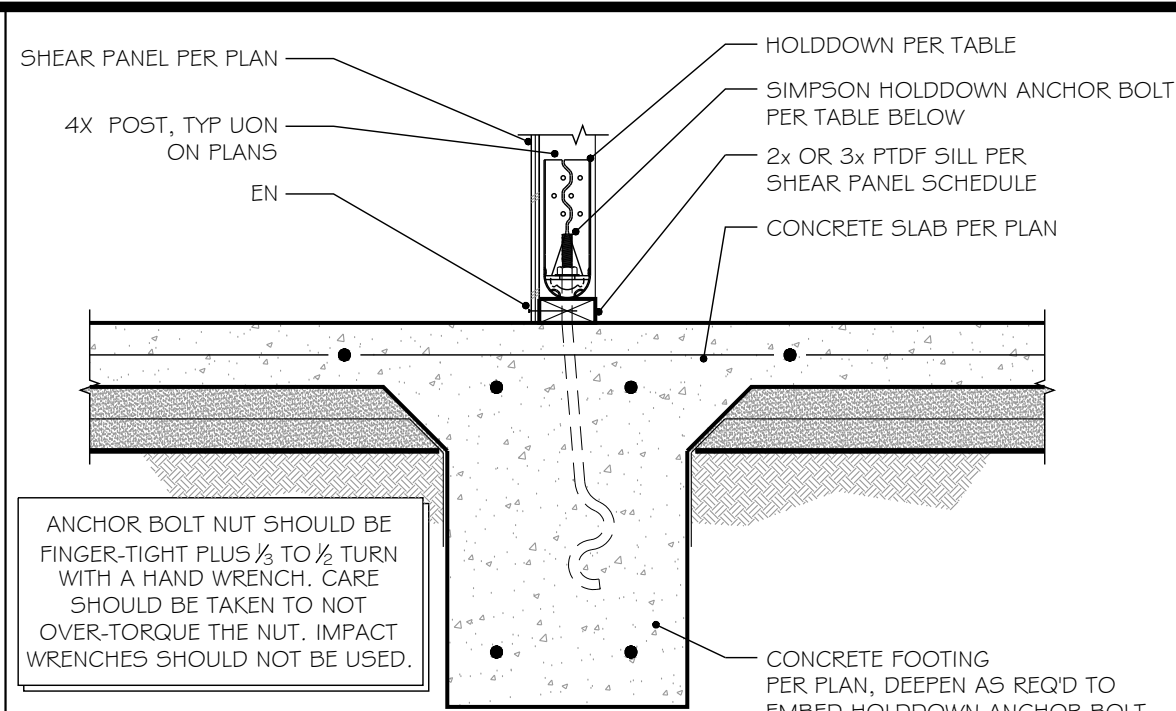


HOLD	ANCHOR Ø	POST SCREWS	EDGE DISTANCE	EMBED	MIN POST
HDU2	5/8" (S51816)	6-SDS 1/2" x 2 1/2"	1 3/4"	16"	4x4
HDU4	5/8" (S51820)	10-SDS 1/2" x 2 1/2"	1 3/4"	16"	4x4
HDU5	5/8" (S51824)	14-SDS 1/2" x 2 1/2"	1 3/4"	20"	4x4
HDU8	5/8" (S51828)	20-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x4
HDU11	1" (S81X30)	30-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x6
HDU14	1" (S81X30)	36-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x8


13 HOLDOWN - INTERIOR FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-ANC-017

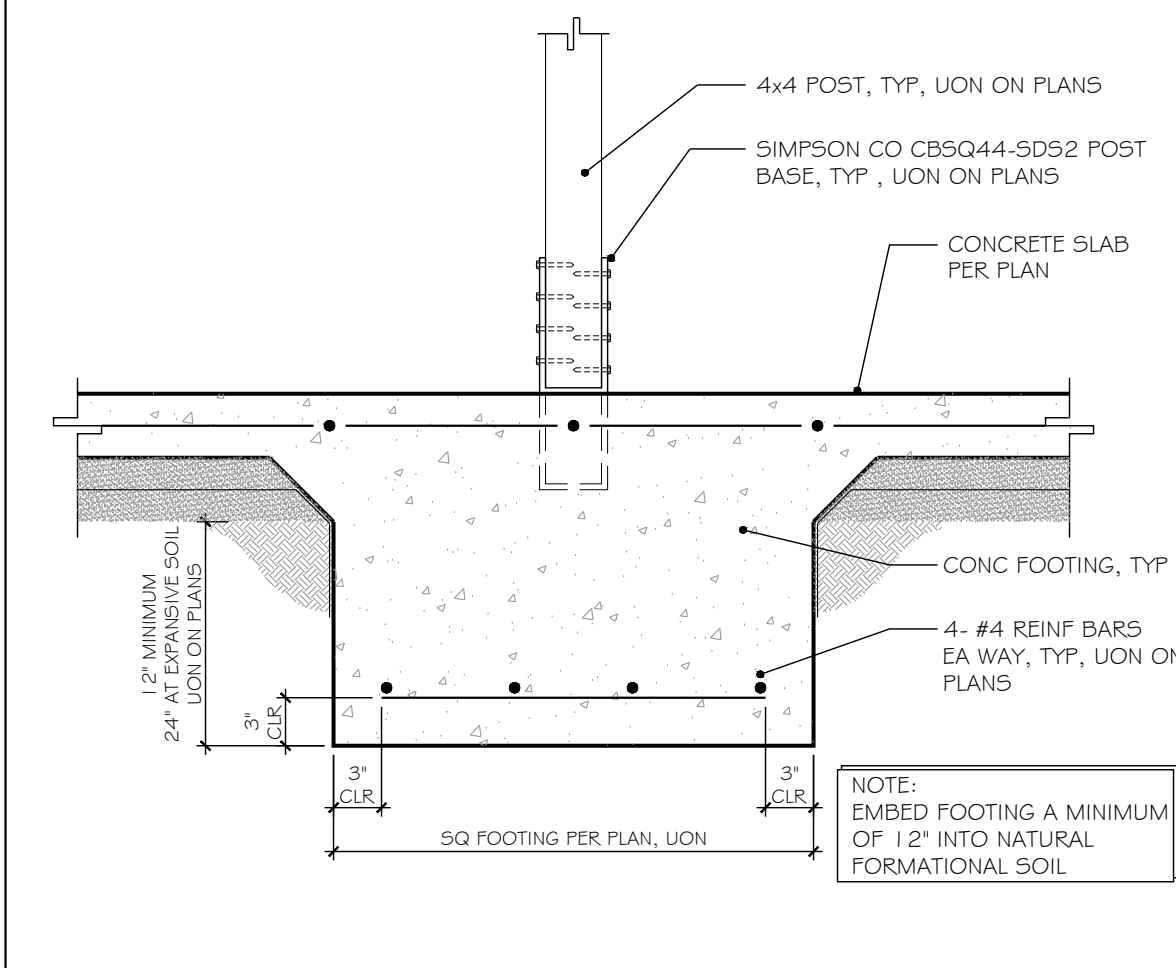


14 POST FOOTING WITHIN SLAB
SCALE: 1" = 1'-0"
A-DT-FDN-CP-0020

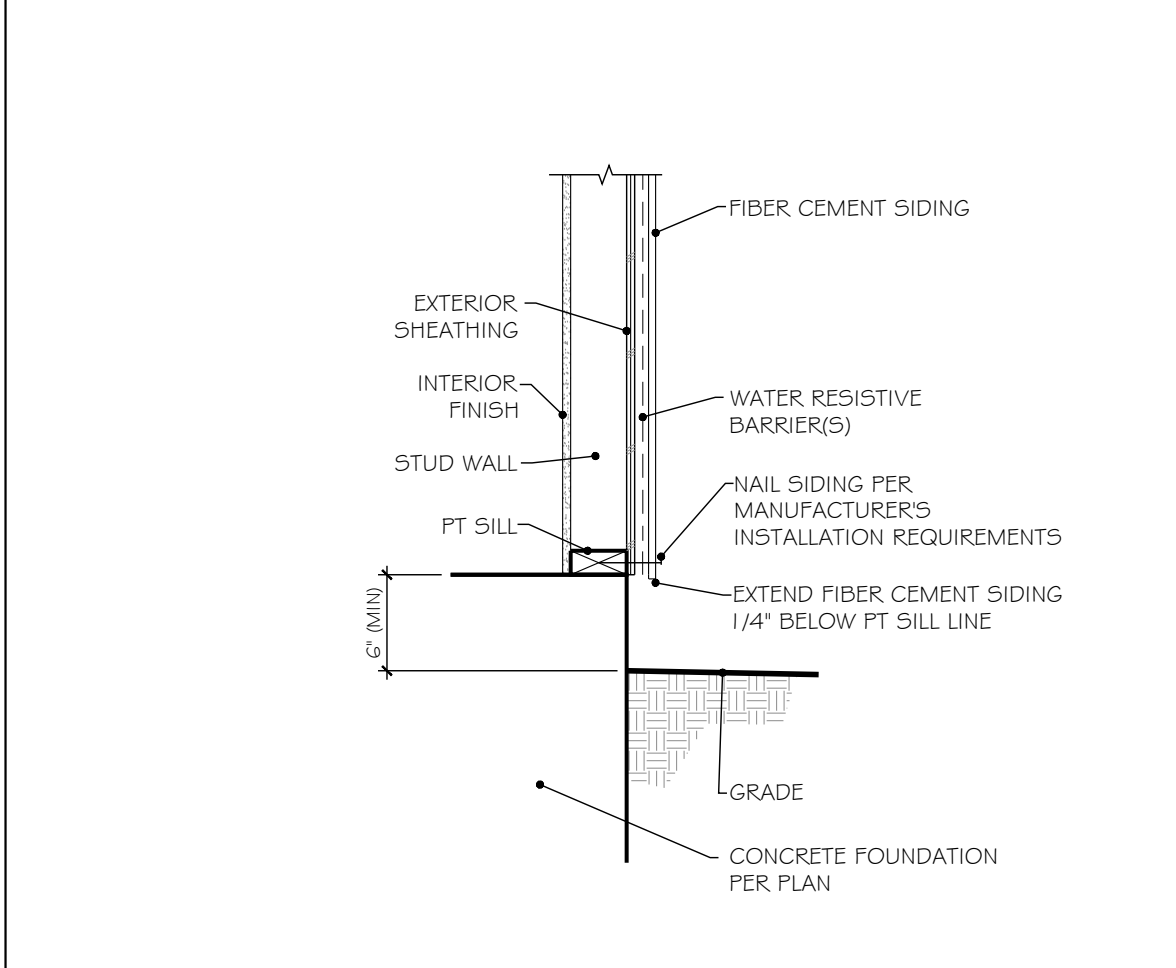

15 BOARD AND BATT SIDING AT FOUNDATION
SCALE: 1" = 1'-0"
A-DT-FIN-FC5-BB-0001

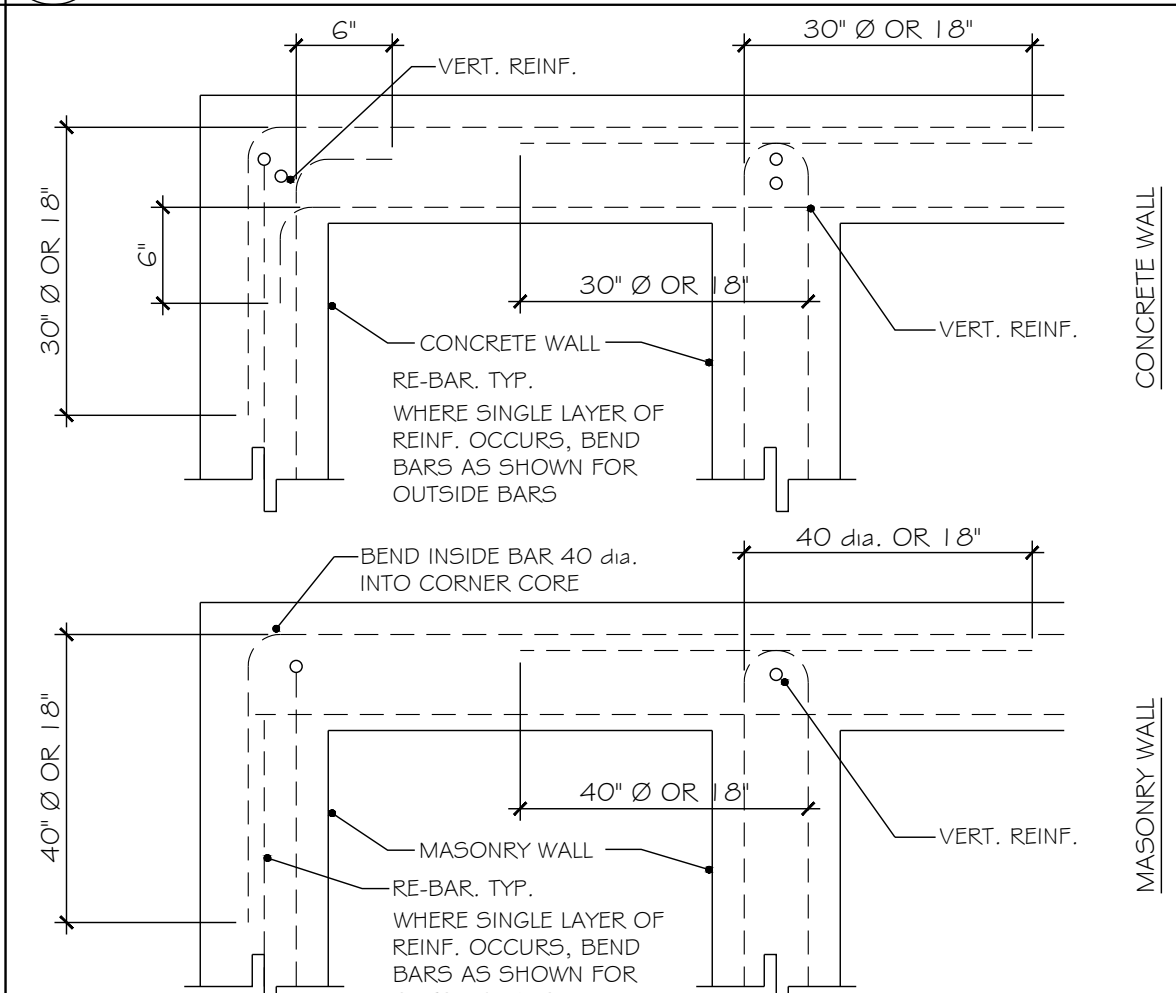


16 TYPICAL CONCRETE / MASONRY WALL REINFORCEMENT
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0021

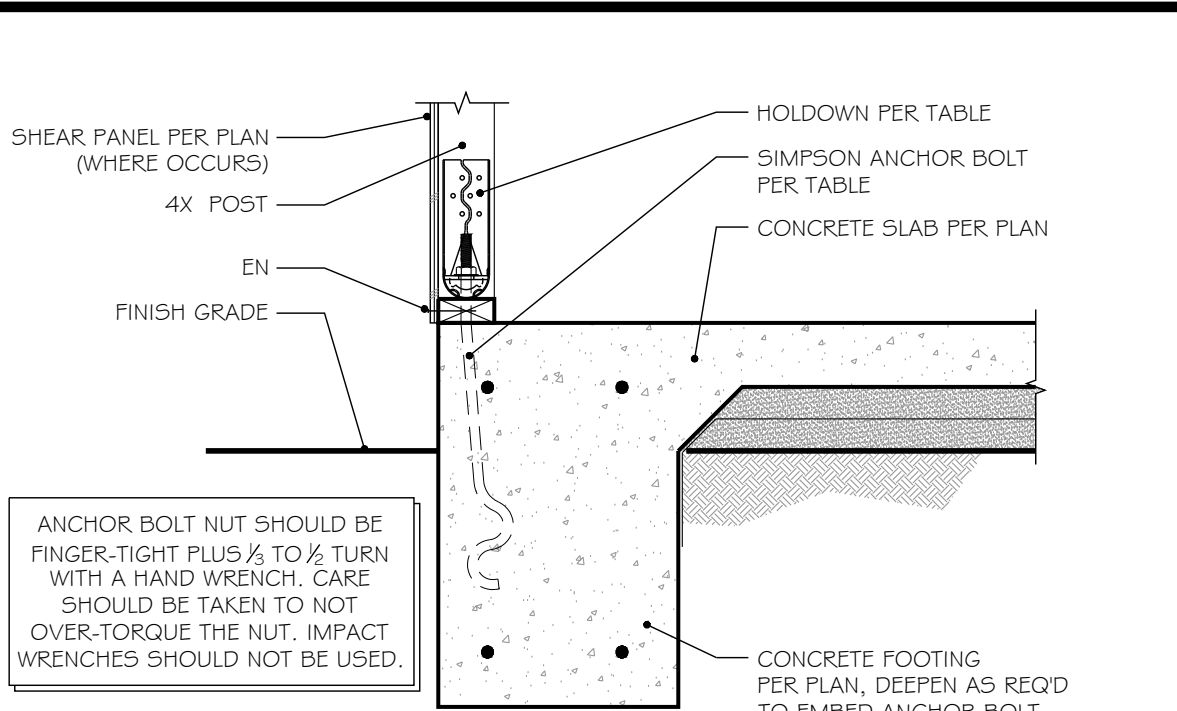


HOLD	ANCHOR Ø	POST SCREWS	EDGE DISTANCE	EMBED	MIN POST
HDU2	5/8" (S51816)	6-SDS 1/2" x 2 1/2"	1 3/4"	16"	4x4
HDU4	5/8" (S51820)	10-SDS 1/2" x 2 1/2"	1 3/4"	16"	4x4
HDU5	5/8" (S51824)	14-SDS 1/2" x 2 1/2"	1 3/4"	20"	4x4
HDU8	5/8" (S51828)	20-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x4
HDU11	1" (S81X30)	30-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x6
HDU14	1" (S81X30)	36-SDS 1/2" x 2 1/2"	1 3/4"	24"	4x8


9 HOLDOWN - PERIMETER FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-ANC-013

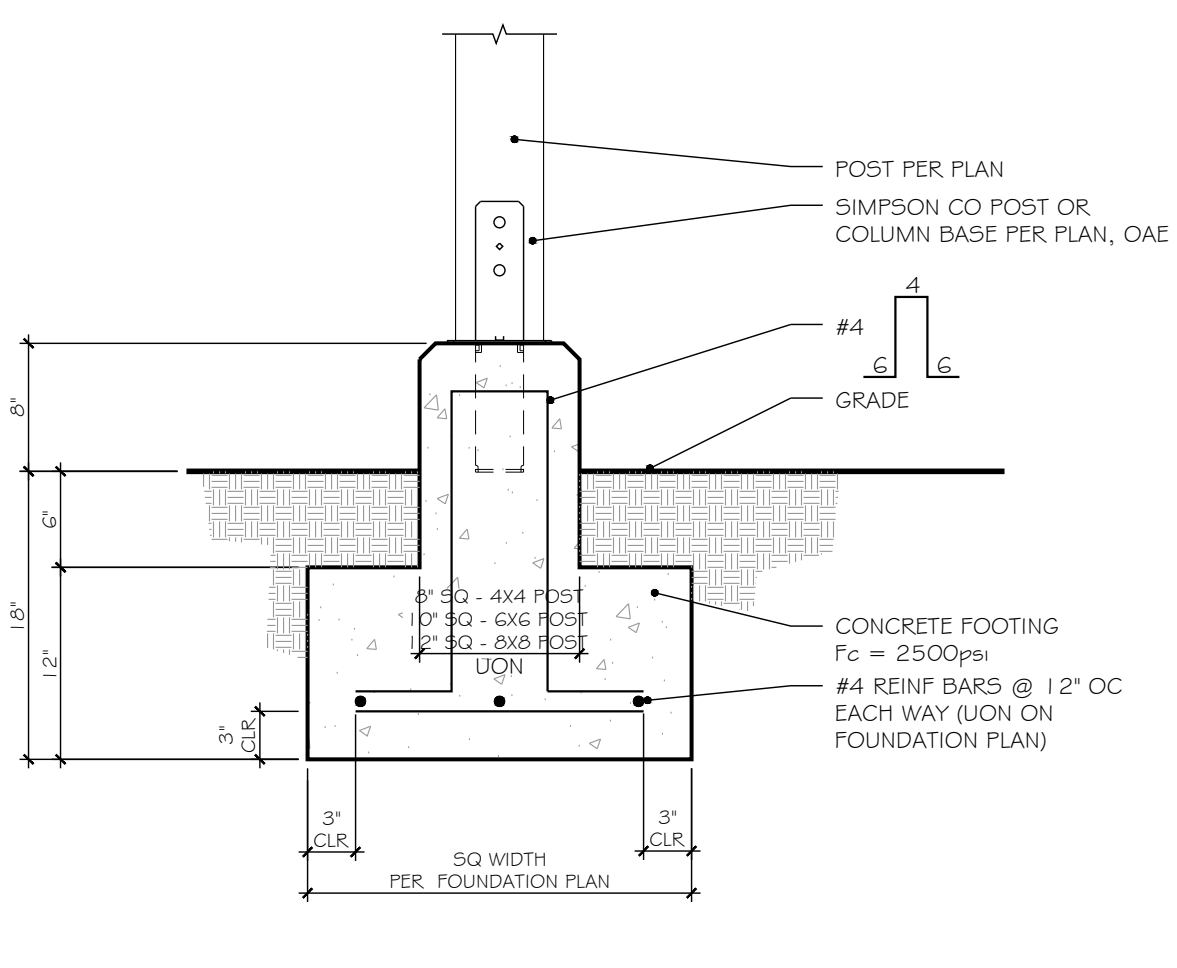


10 TYPICAL POST FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-CP-0003

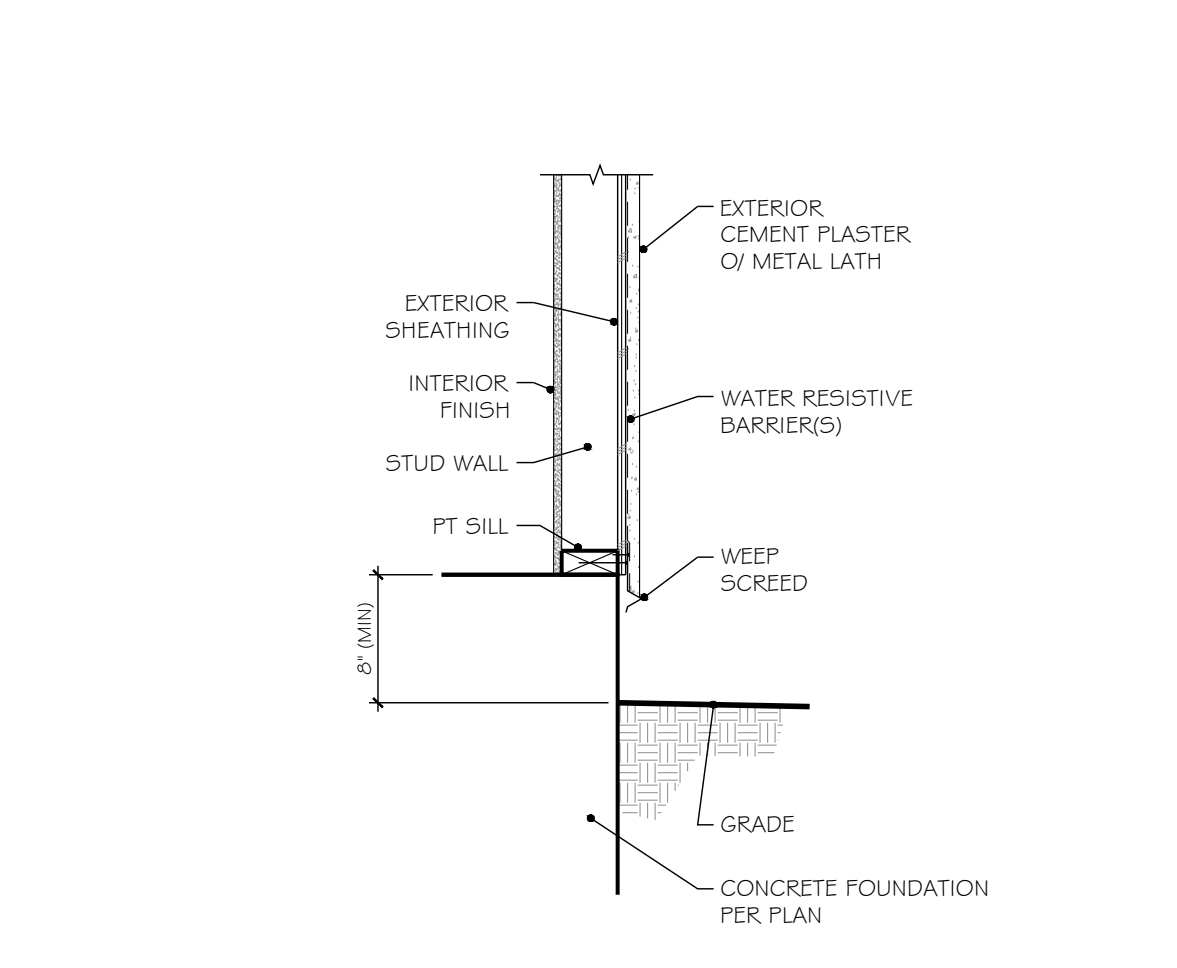


11 CEMENT PLASTER WEEP SCREED AT FOUNDATION
SCALE: 1" = 1'-0"
A-DT-FIN-PL-0001

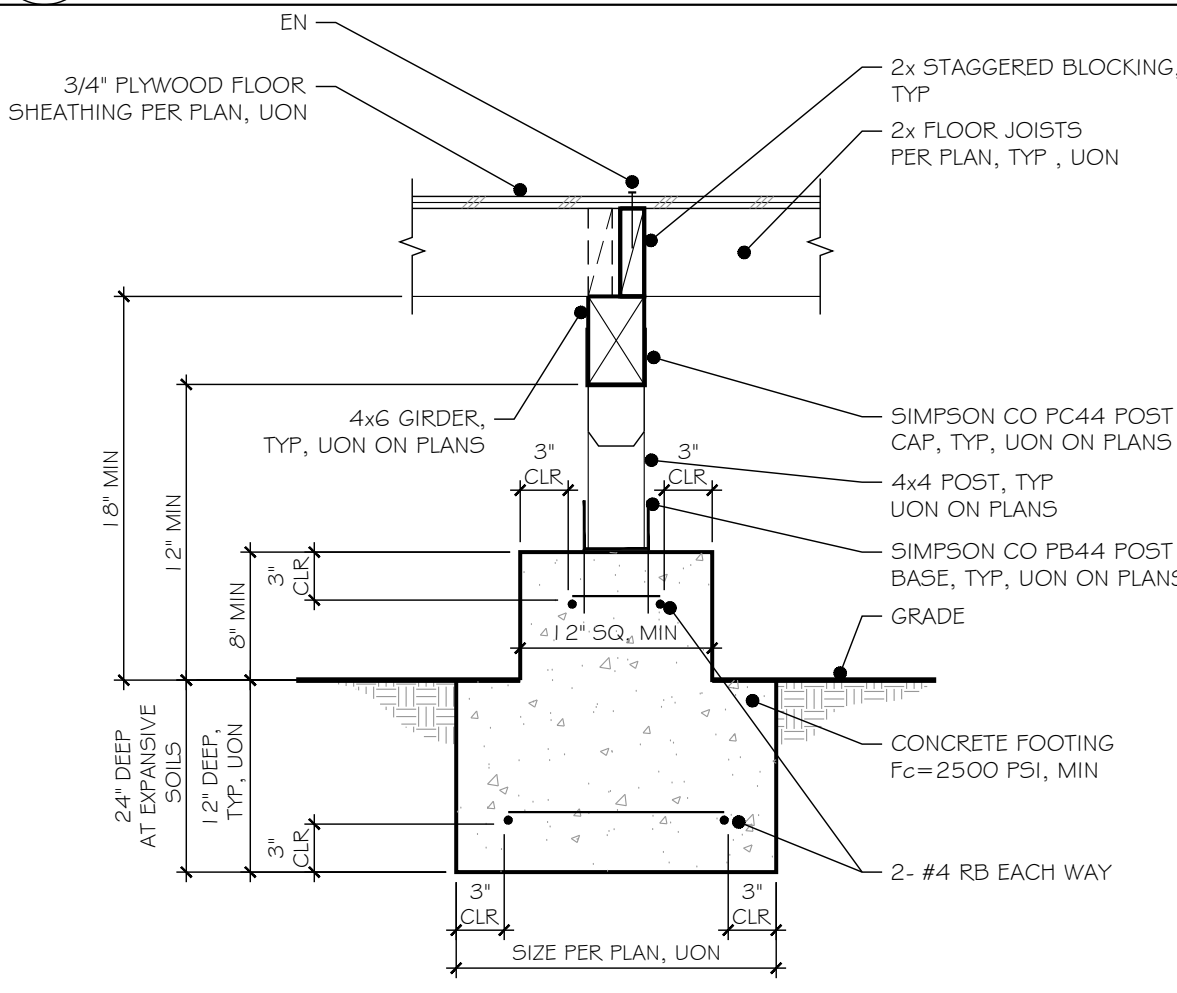


12 FLOOR JOIST AND GIRDER BEAMS AT PAD FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0133

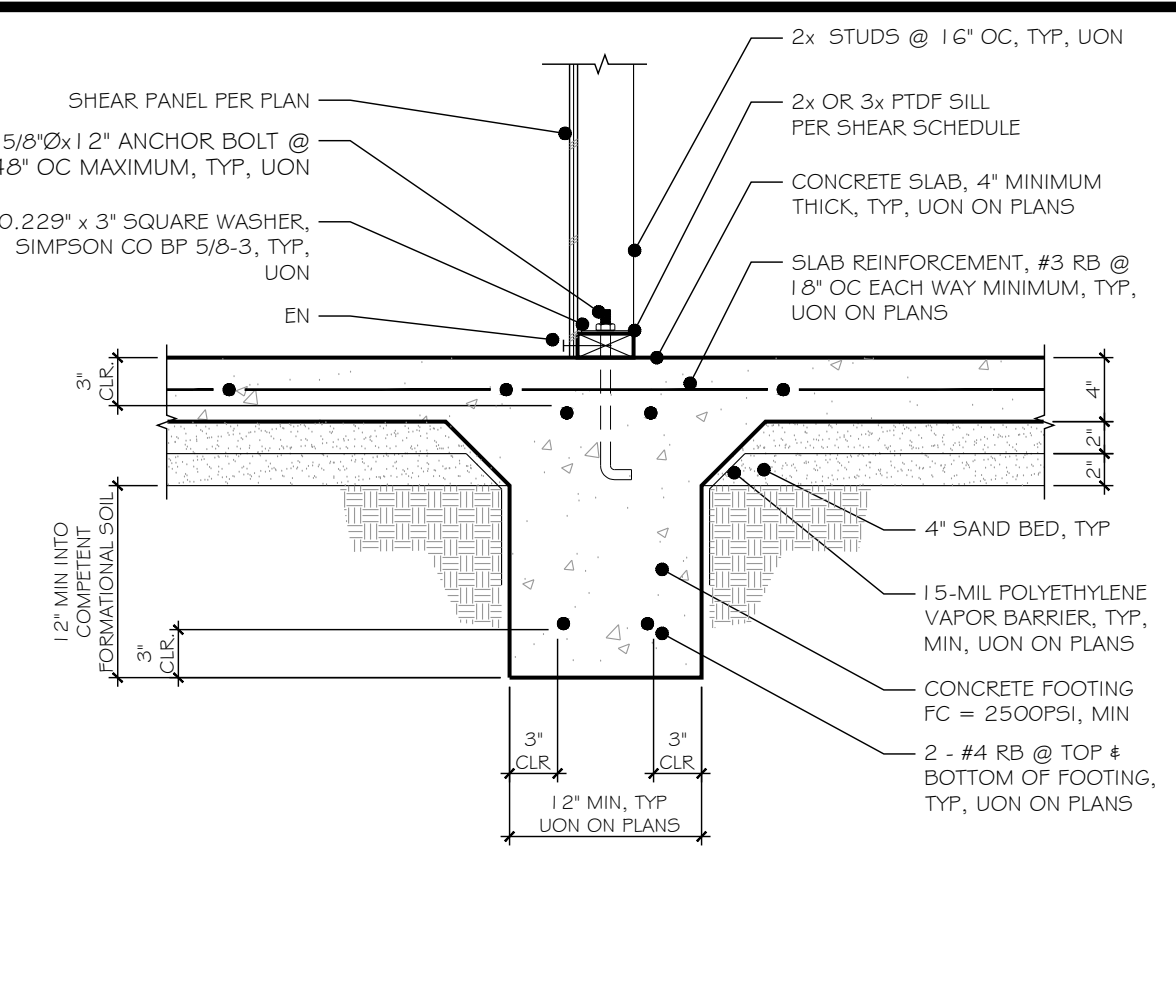


5 SLAB ON GRADE ONE STORY INTERIOR FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-INT-014

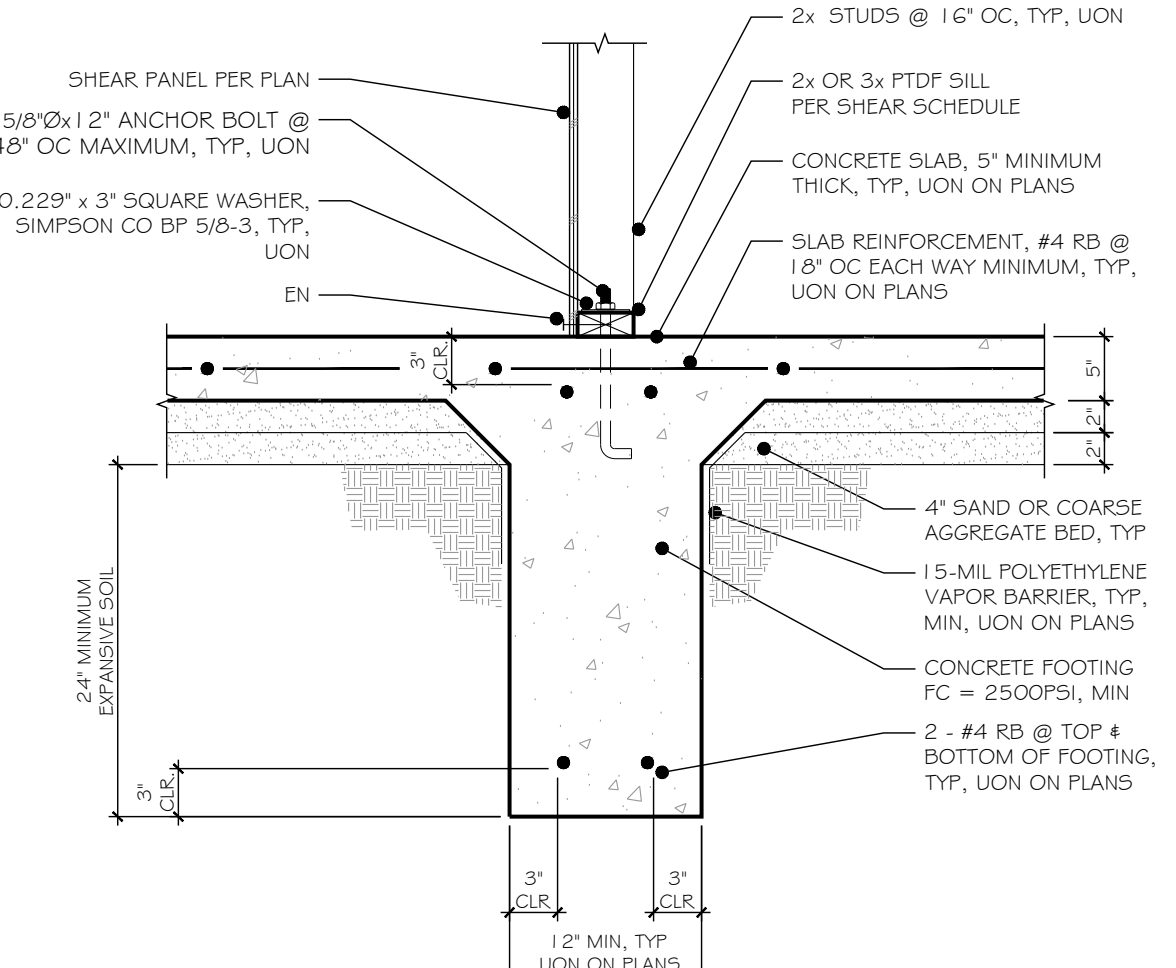


6 ONE STORY INTERIOR EXPANSIVE SOIL FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-INT-015

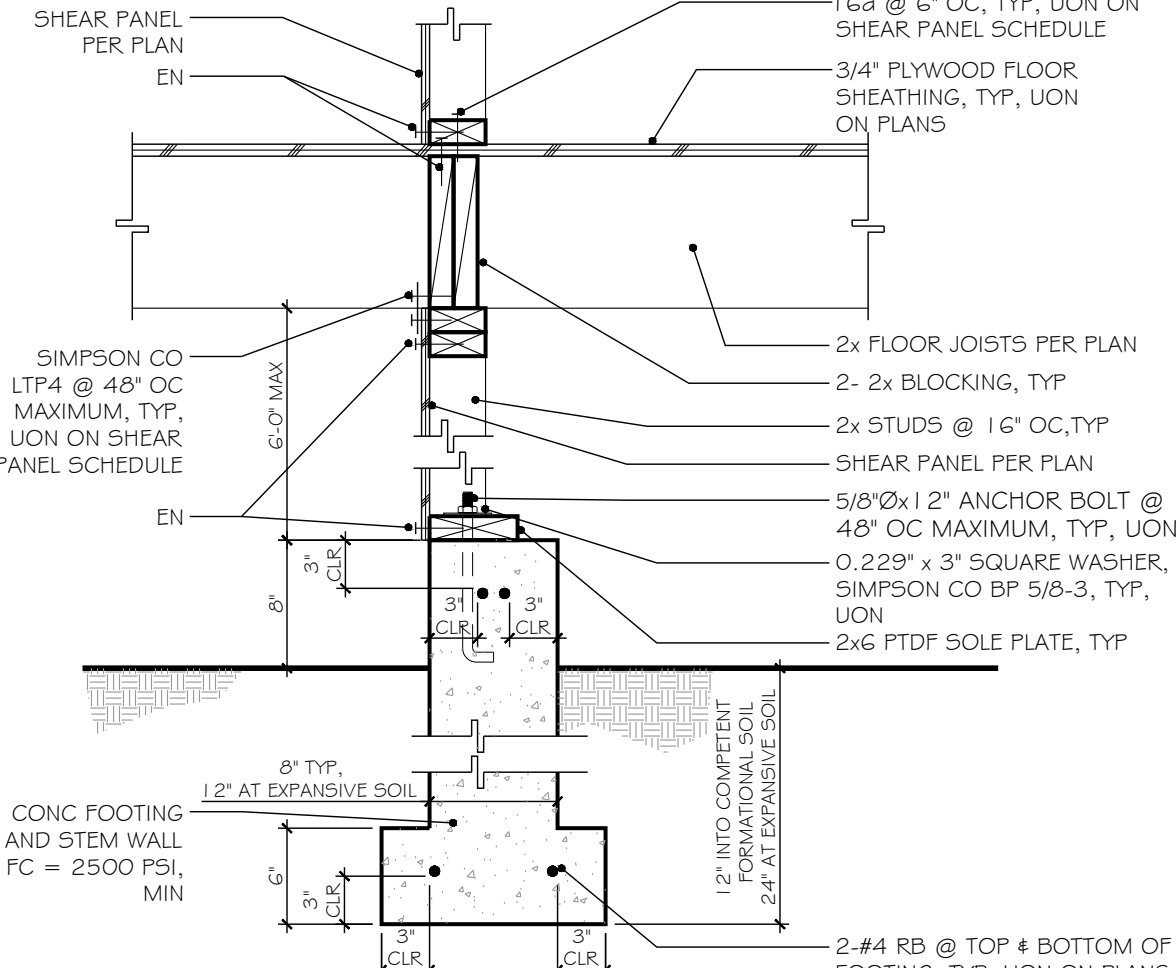


7 ONE-STORY INTERIOR STEM WALL FOOTING - PERPENDICULAR
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0073

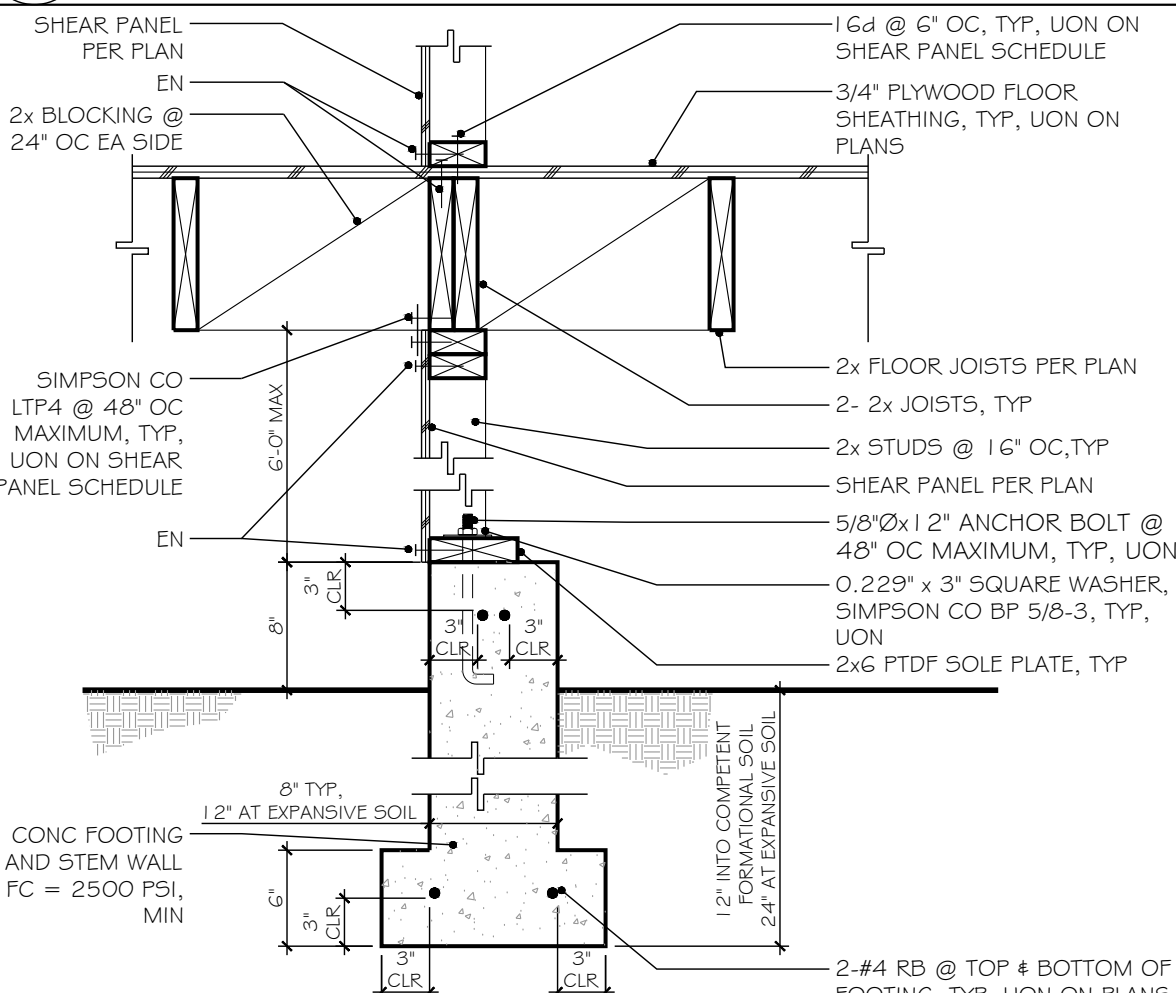


8 ONE-STORY INTERIOR STEM WALL FOOTING - PARALLEL
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0134

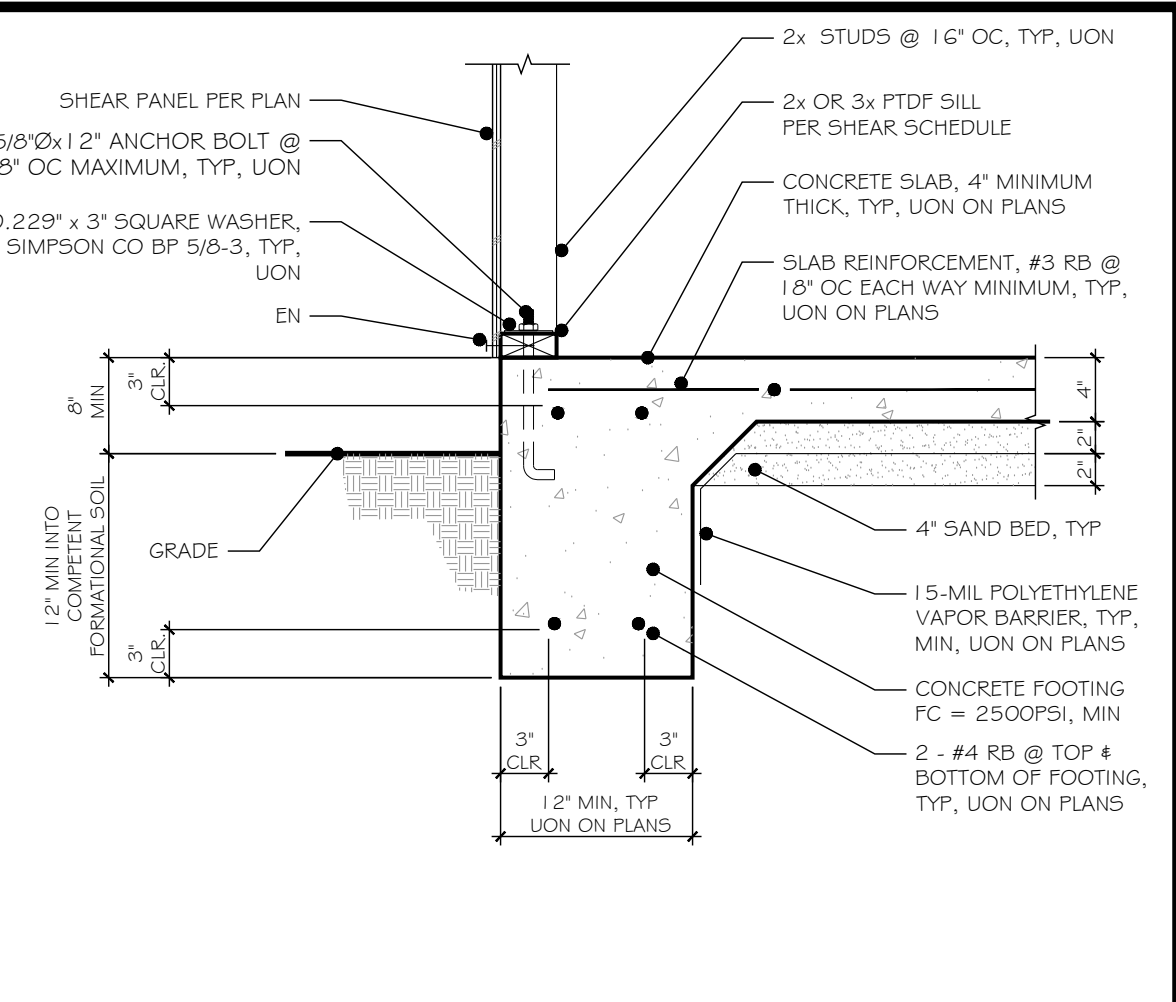


1 SLAB ON GRADE ONE STORY PERIMETER FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-PTR-025

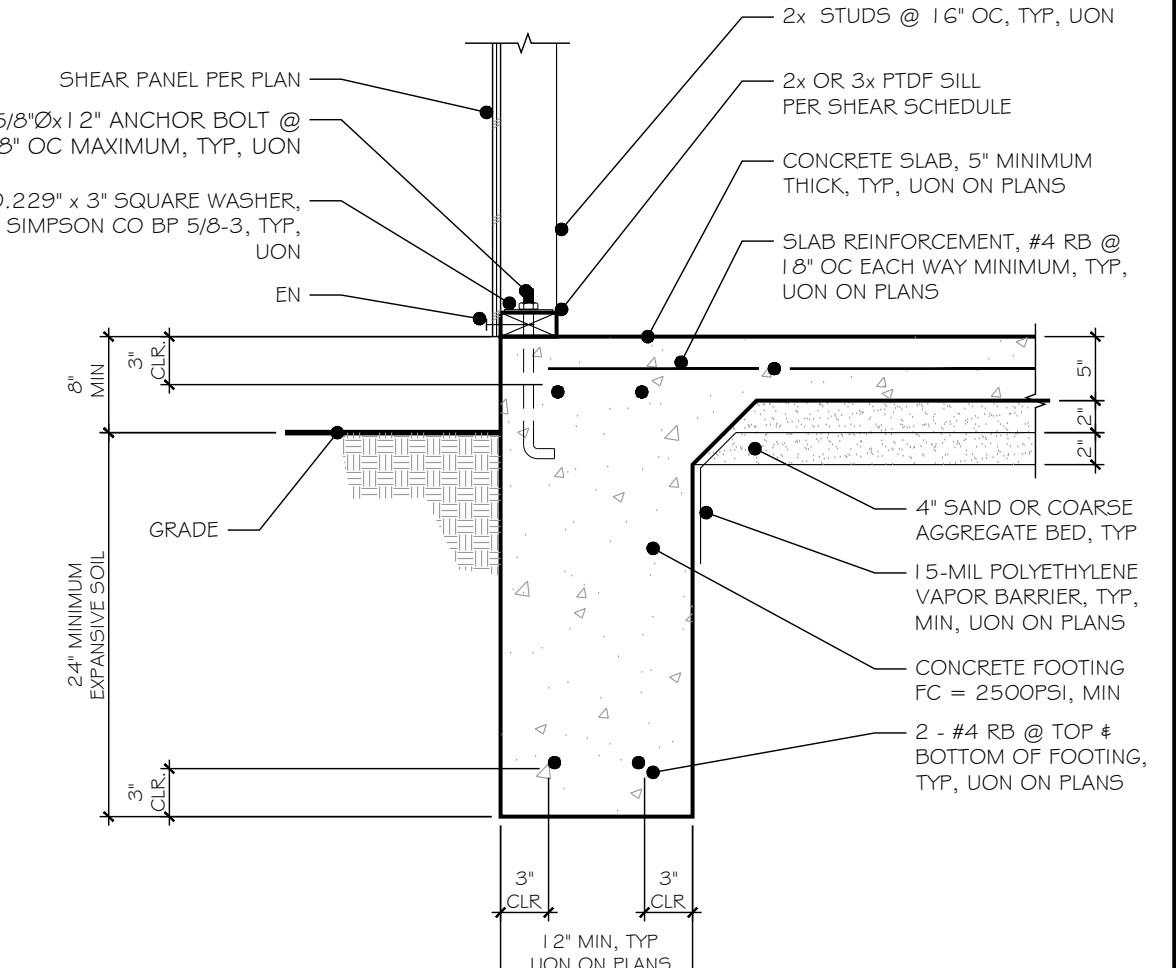

2 ONE STORY PERIMETER EXPANSIVE SOIL FOOTING
SCALE: 1" = 1'-0"
A-DT-FDN-SG-PTR-026

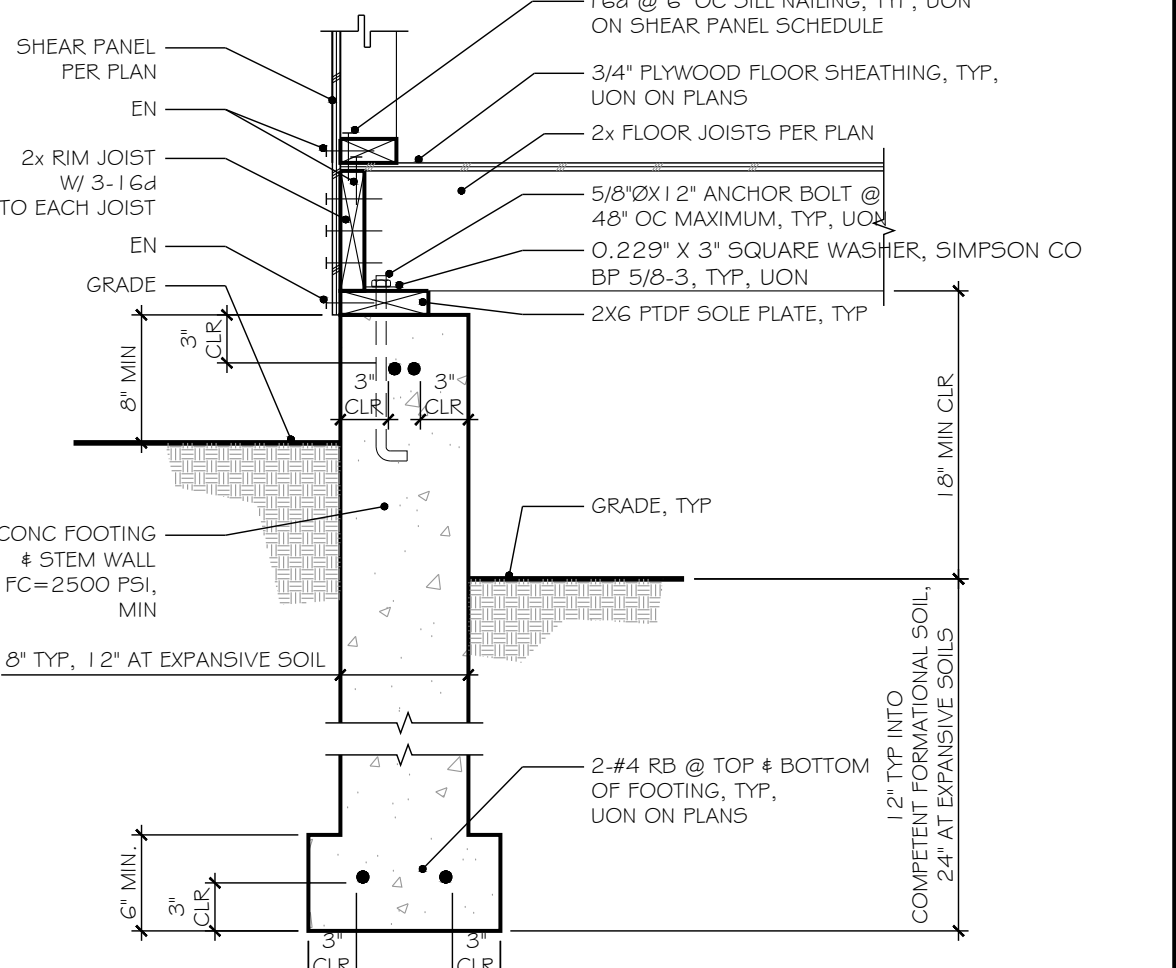

3 ONE STORY EXTERIOR STEM WALL FOOTING-PERPENDICULAR
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0002

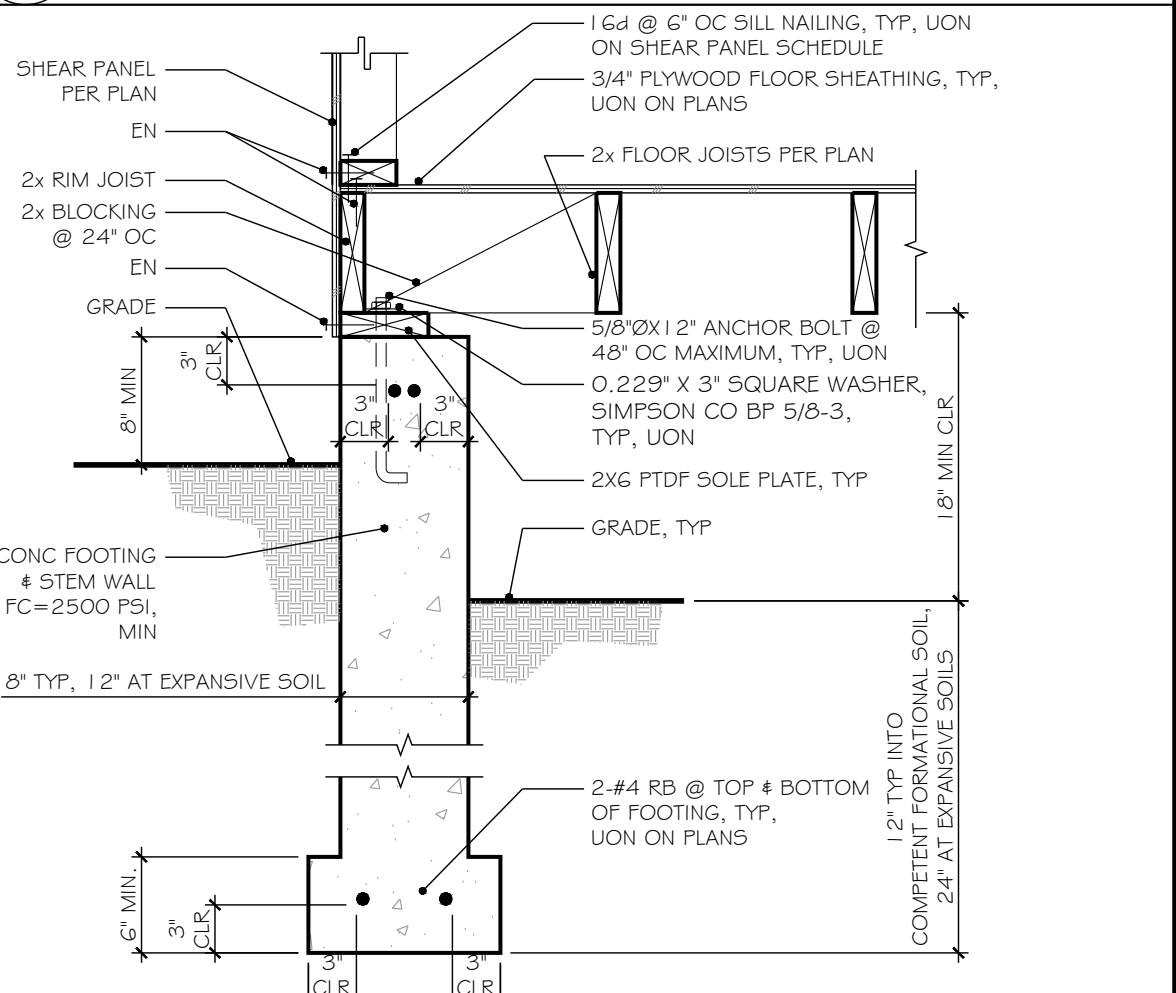

4 ONE STORY EXTERIOR STEM WALL FOOTING-PARALLEL
SCALE: 1" = 1'-0"
A-DT-FDN-SW-0135

PREPARER SIGNATURE

FOR CITY STAMPS


BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


ANAHEIM PRADU
CITY: ANAHEIM

JOB: 202409R


DETAILS
d0.0

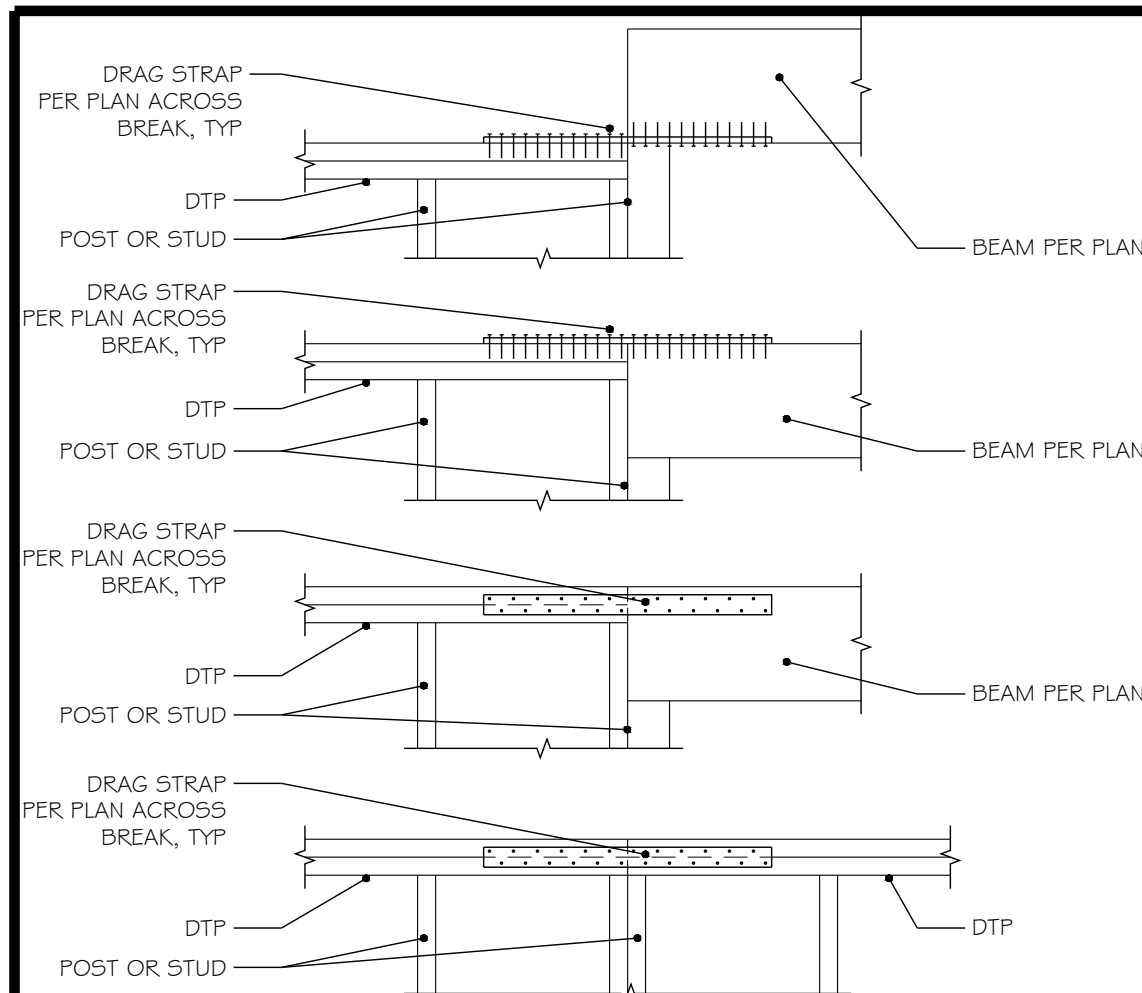


37 DRAG STRAP AT TOP PLATE TO BEAM OR TOP PLATE
SCALE: 3/4" = 1'-0"
A-DT-FMG-WF-0013

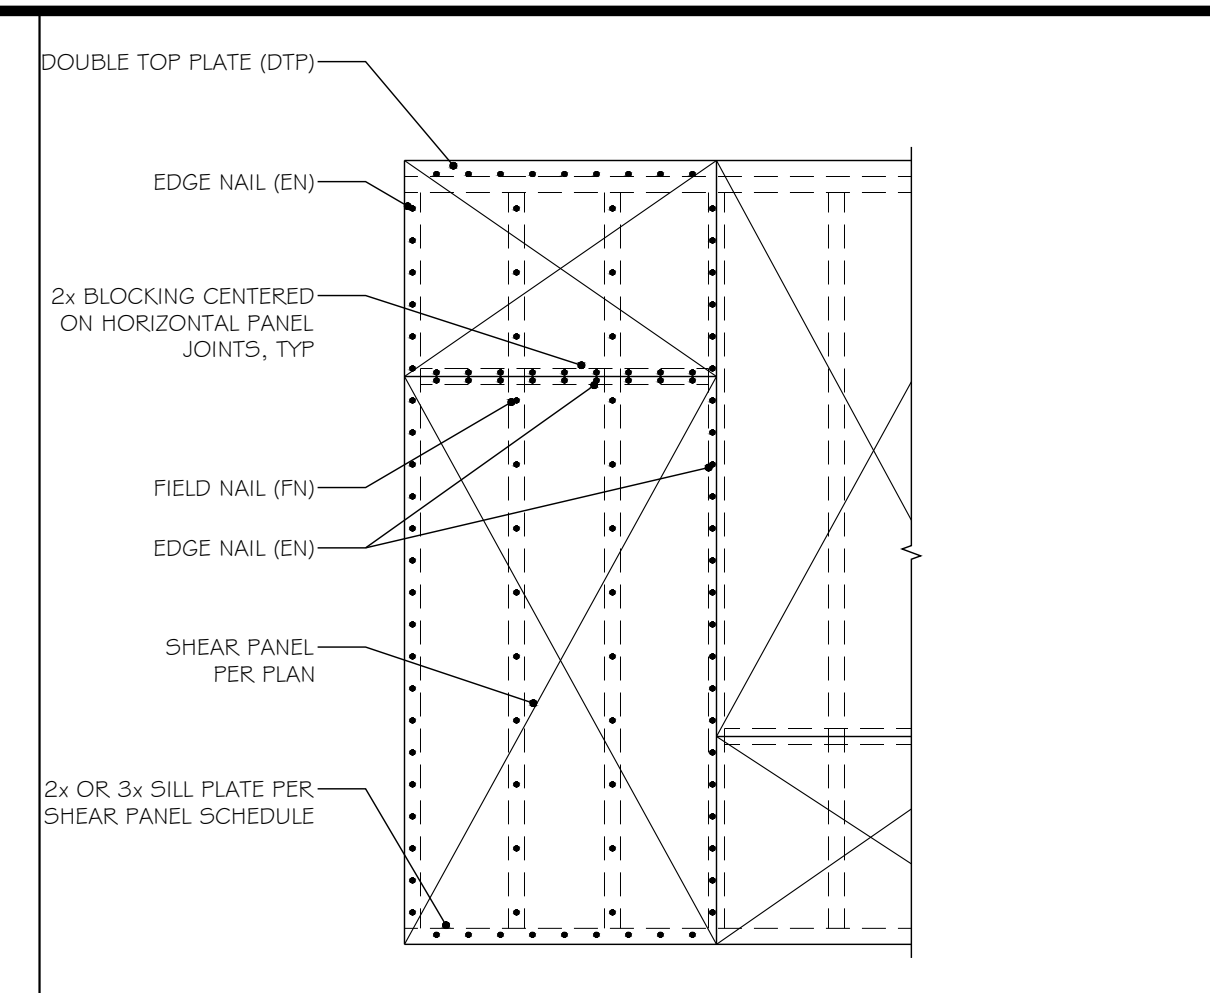


33 TYPICAL SHEAR PANEL
SCALE: N.T.S.
A-DT-FMG-WF-0018

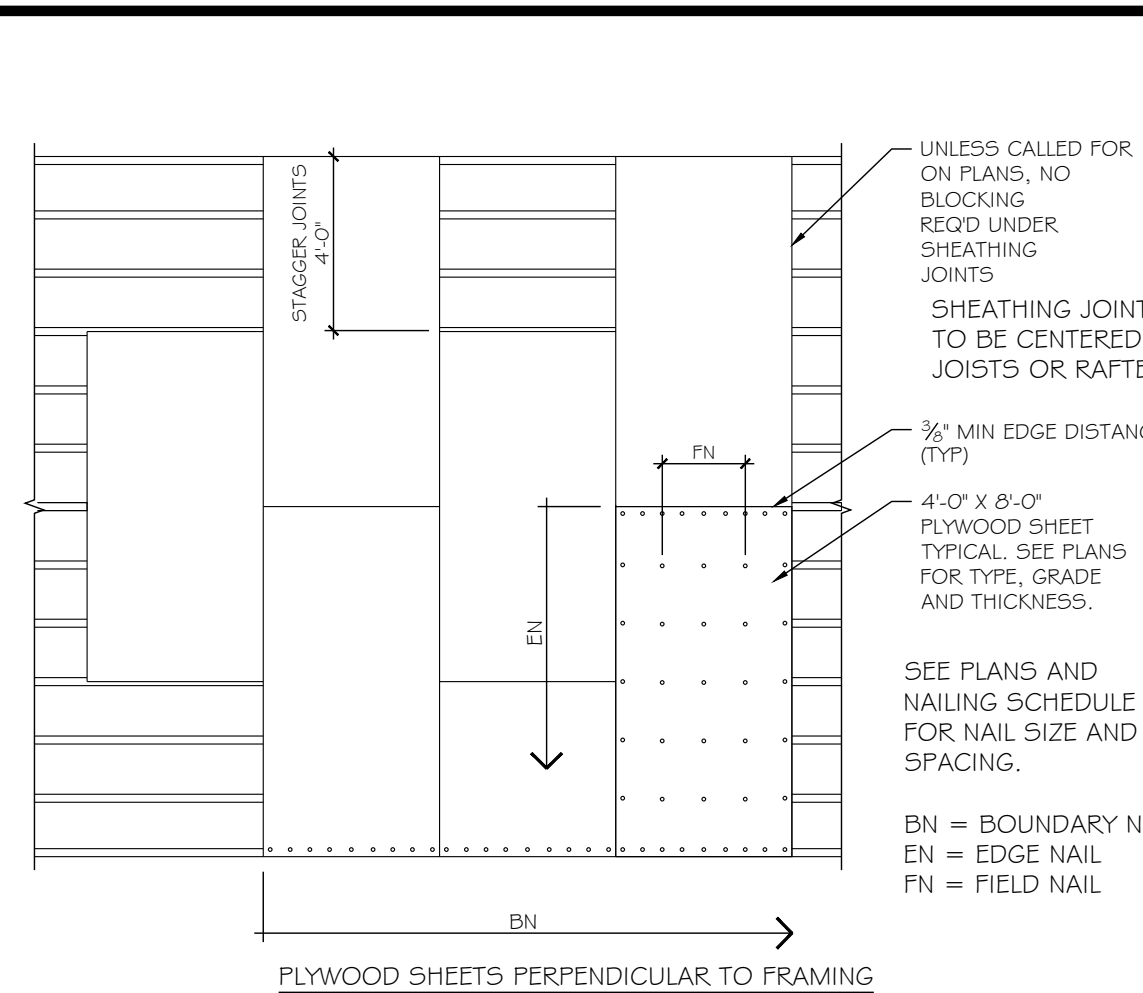


29 WOOD ROOF AND FLOOR SHEATHING LAYOUT
SCALE: 1" = 1'-0"
A-DT-FMG-FF-0002

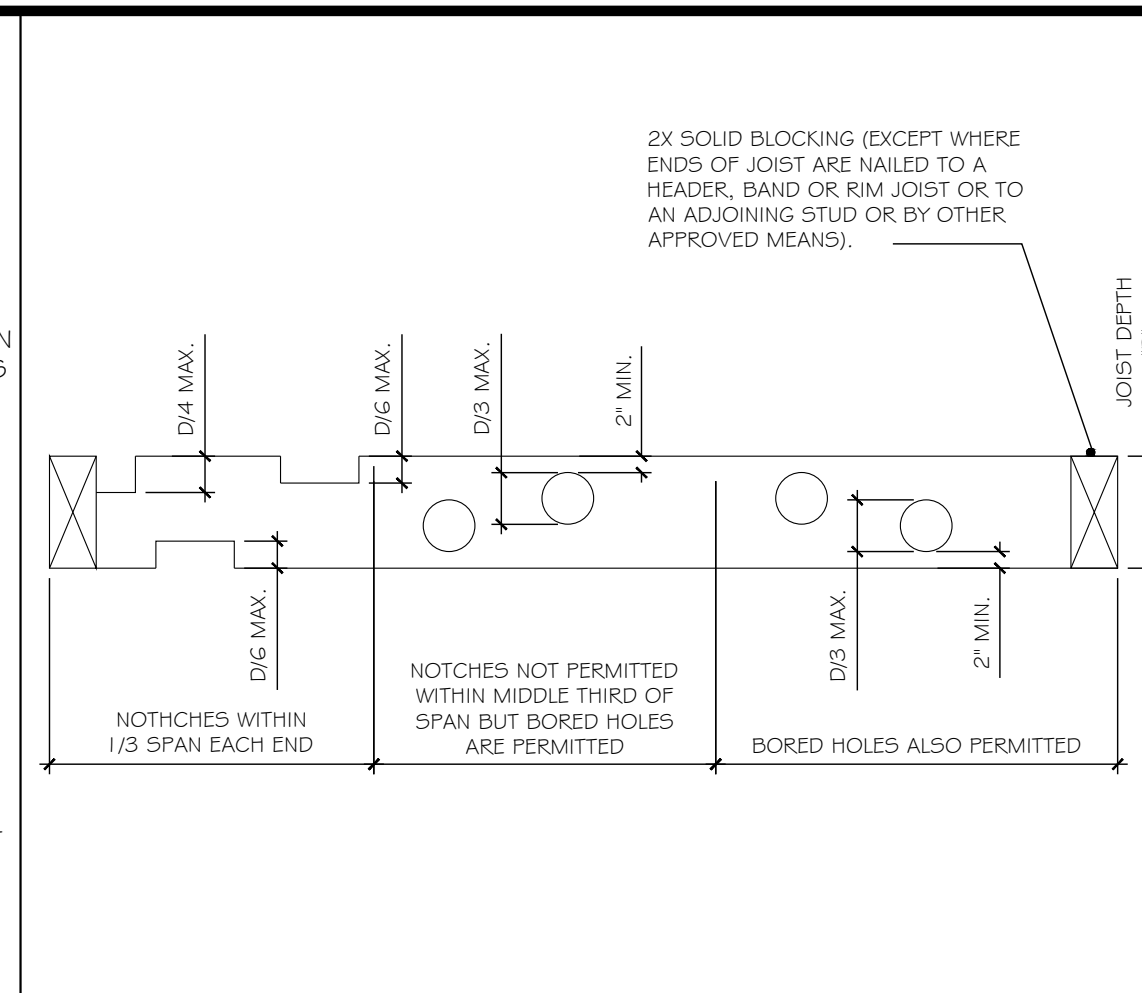


25 JOIST CUTTING, BORING AND NOTCHING
SCALE: N.T.S.
A-DT-FMG-FF-0001

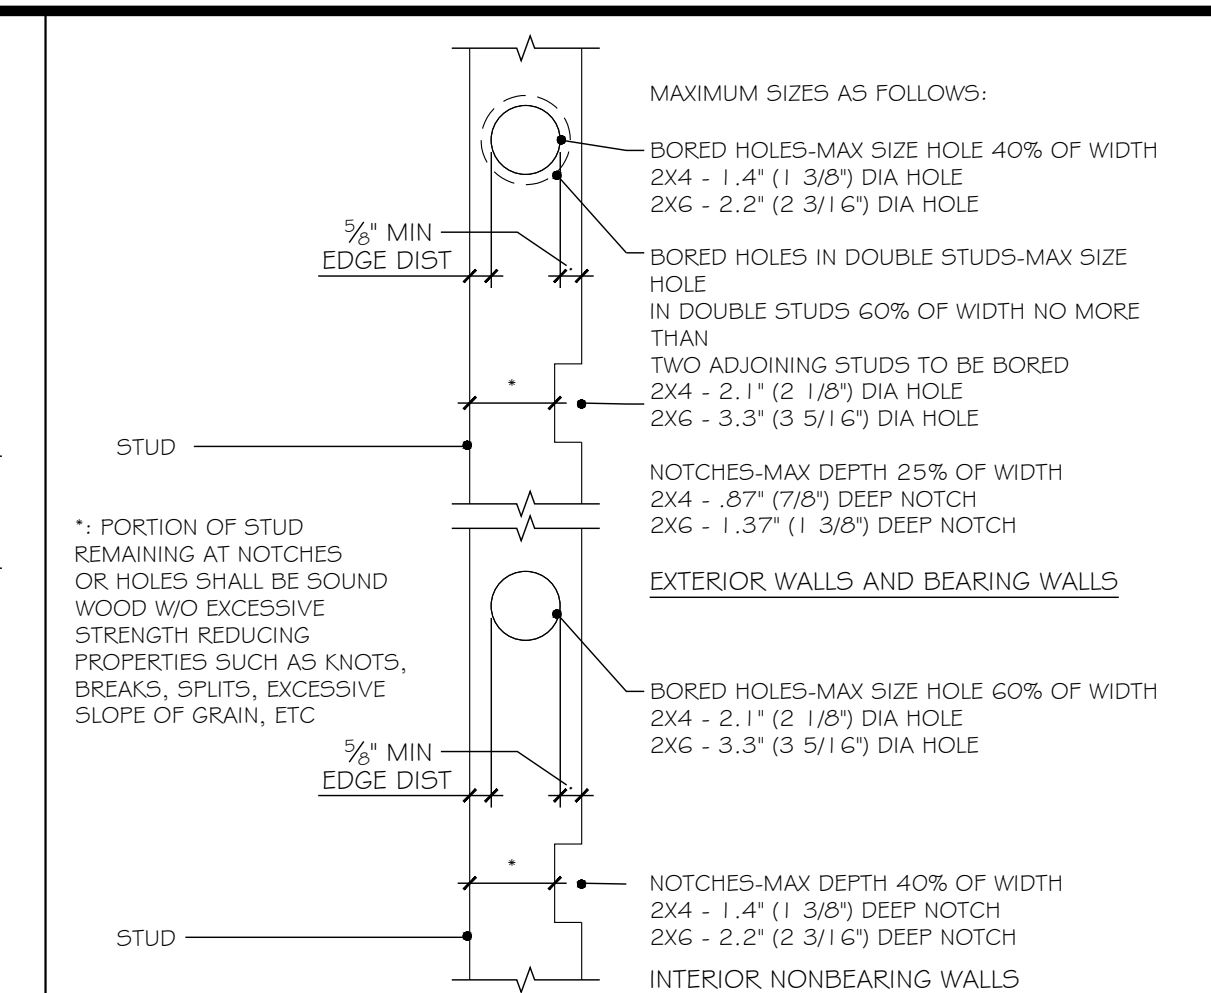


21 STUD CUTTING, BORING AND NOTCHING
SCALE: N.T.S.
A-DT-FMG-WF-0004

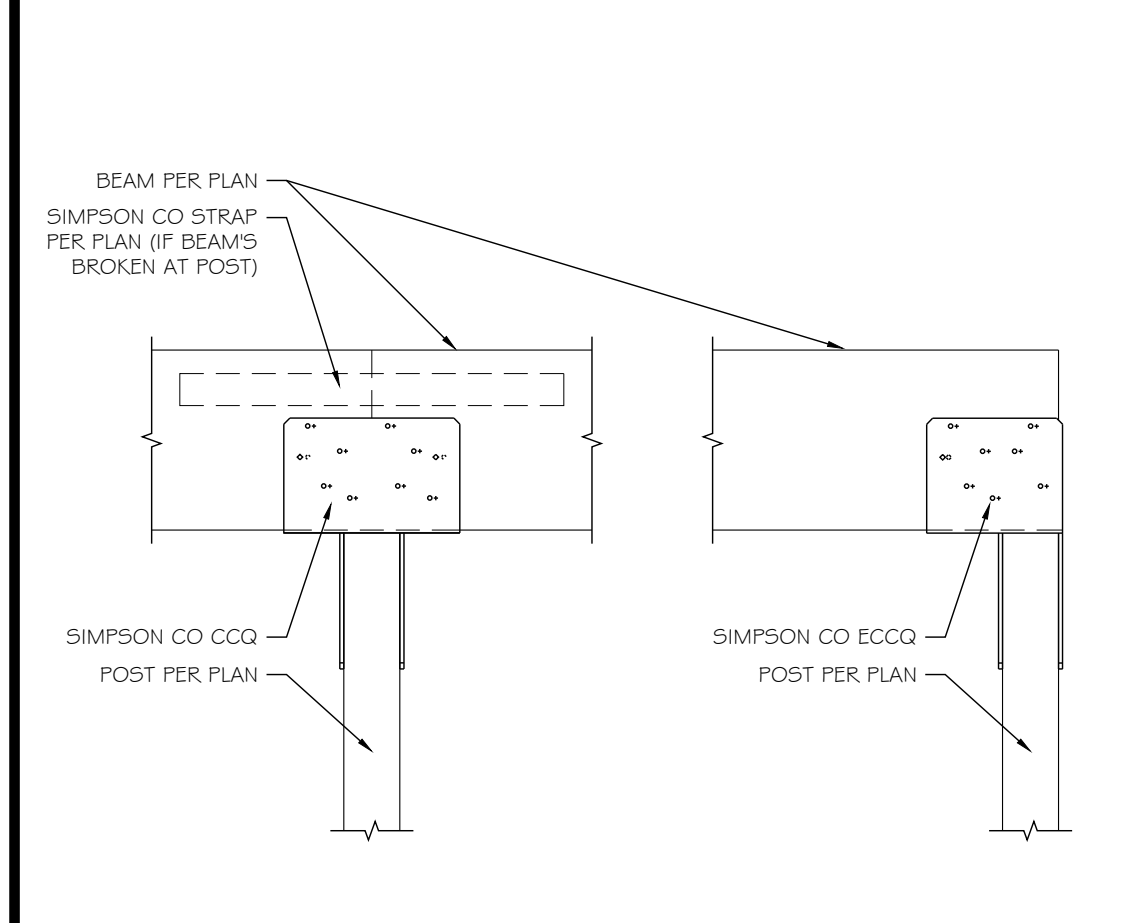


38 POST TO BEAM WITH CCQ/ECCQ
SCALE: 1" = 1'-0"
A-DT-FMG-PB-0007

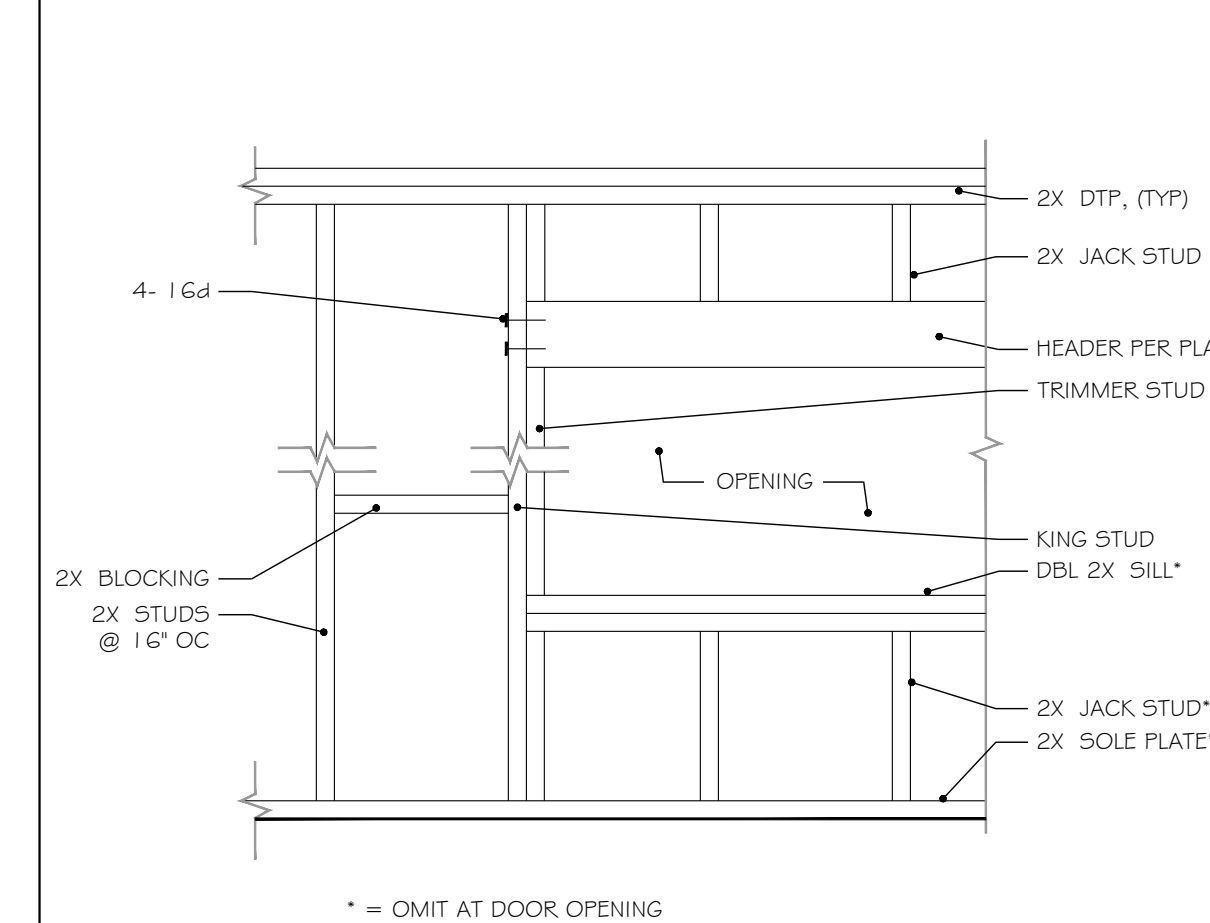


34 FRAMING FOR ROUGH WINDOW OR DOOR OPENING
SCALE: 1/2" = 1'-0"
A-DT-FMG-WF-0006

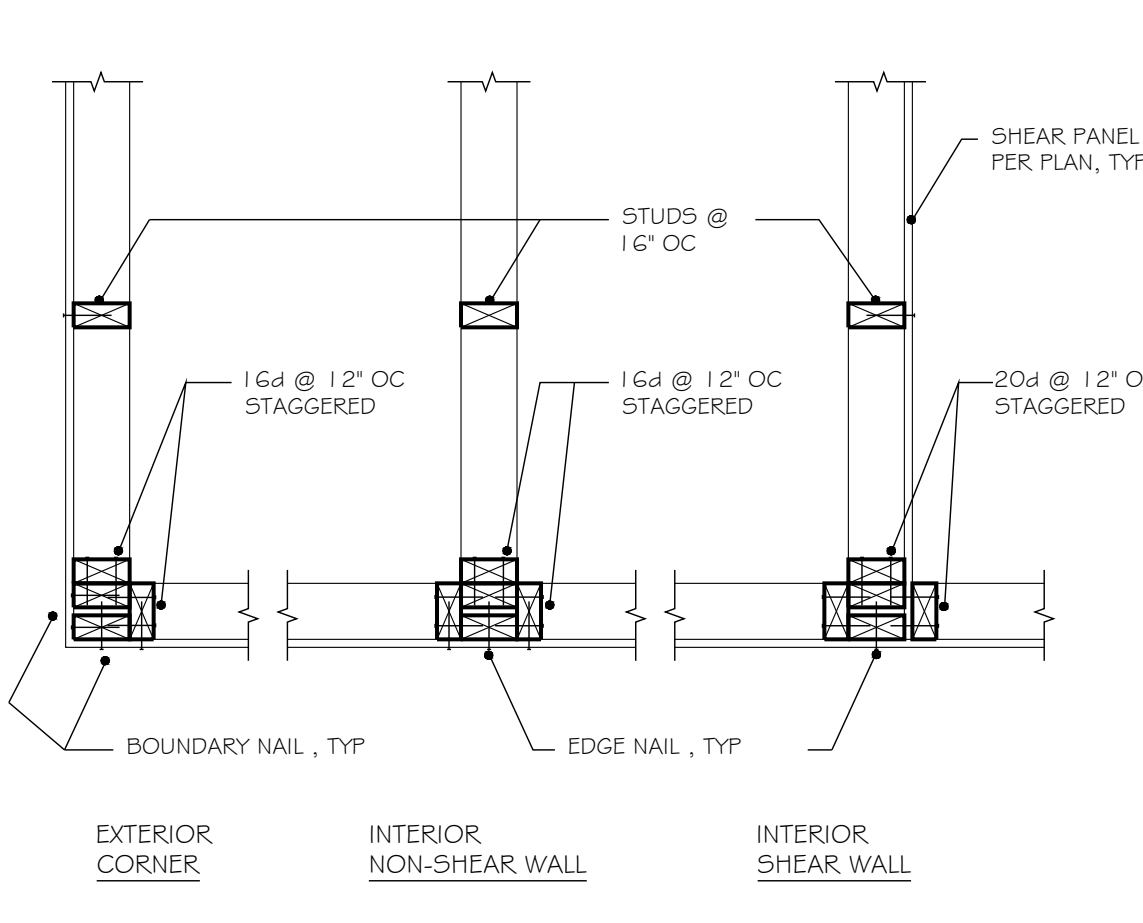


30 STUD WALL INTERSECTION
SCALE: 1" = 1'-0"
A-DT-FMG-WF-0005

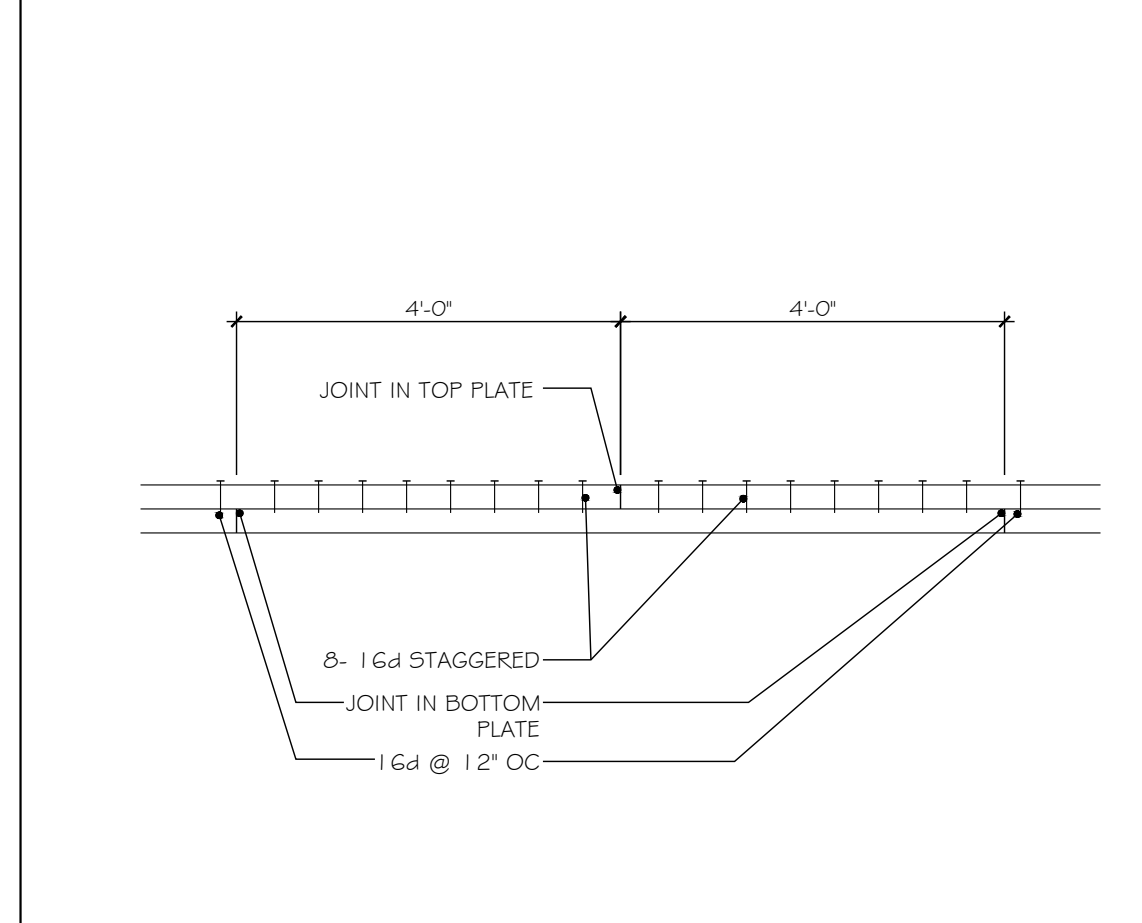


26 DOUBLE TOP-PLATE SPLICE
SCALE: N.T.S.
A-DT-FMG-WF-0019

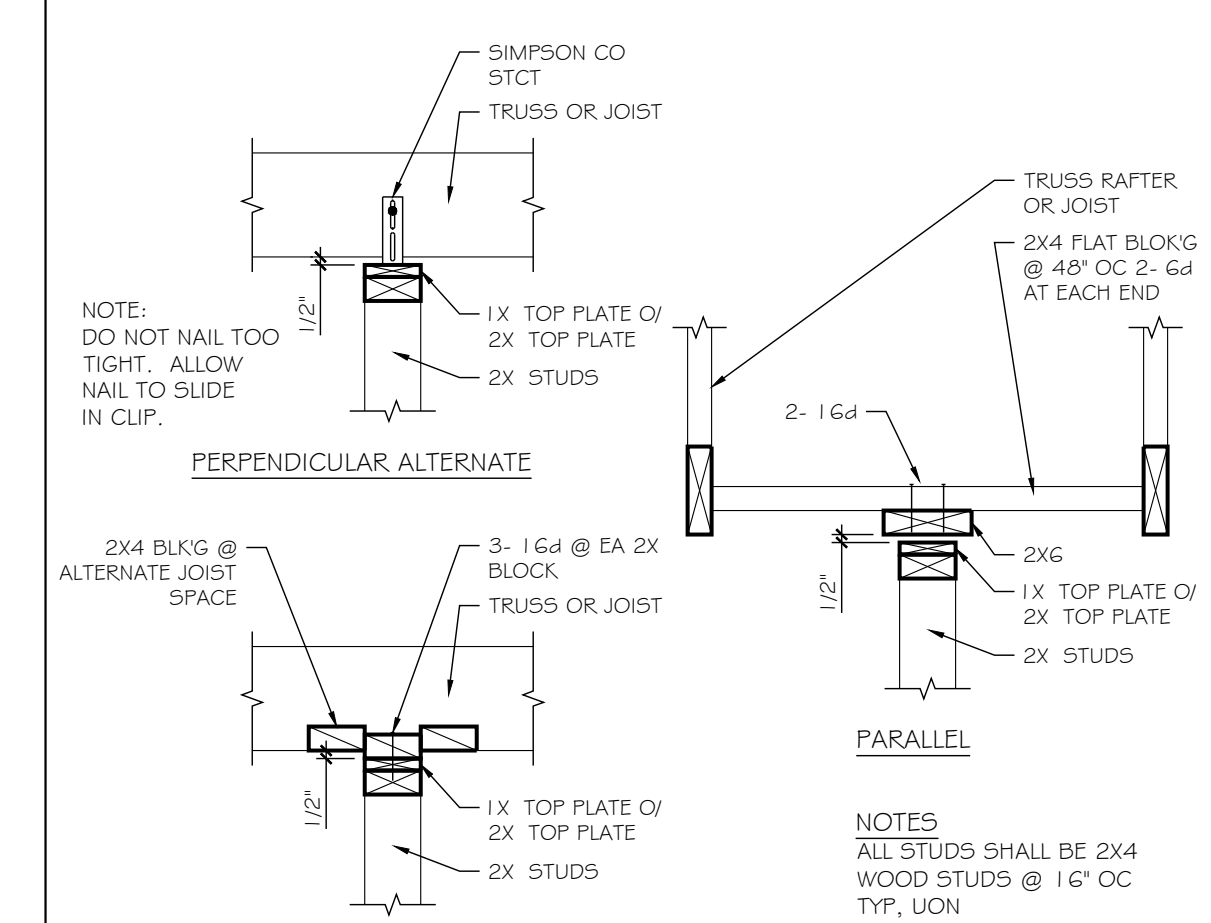


22 NON-BEARING/NON-SHEAR PARTITIONS AT TOP
SCALE: 1" = 1'-0"
A-DT-FMG-WF-0008

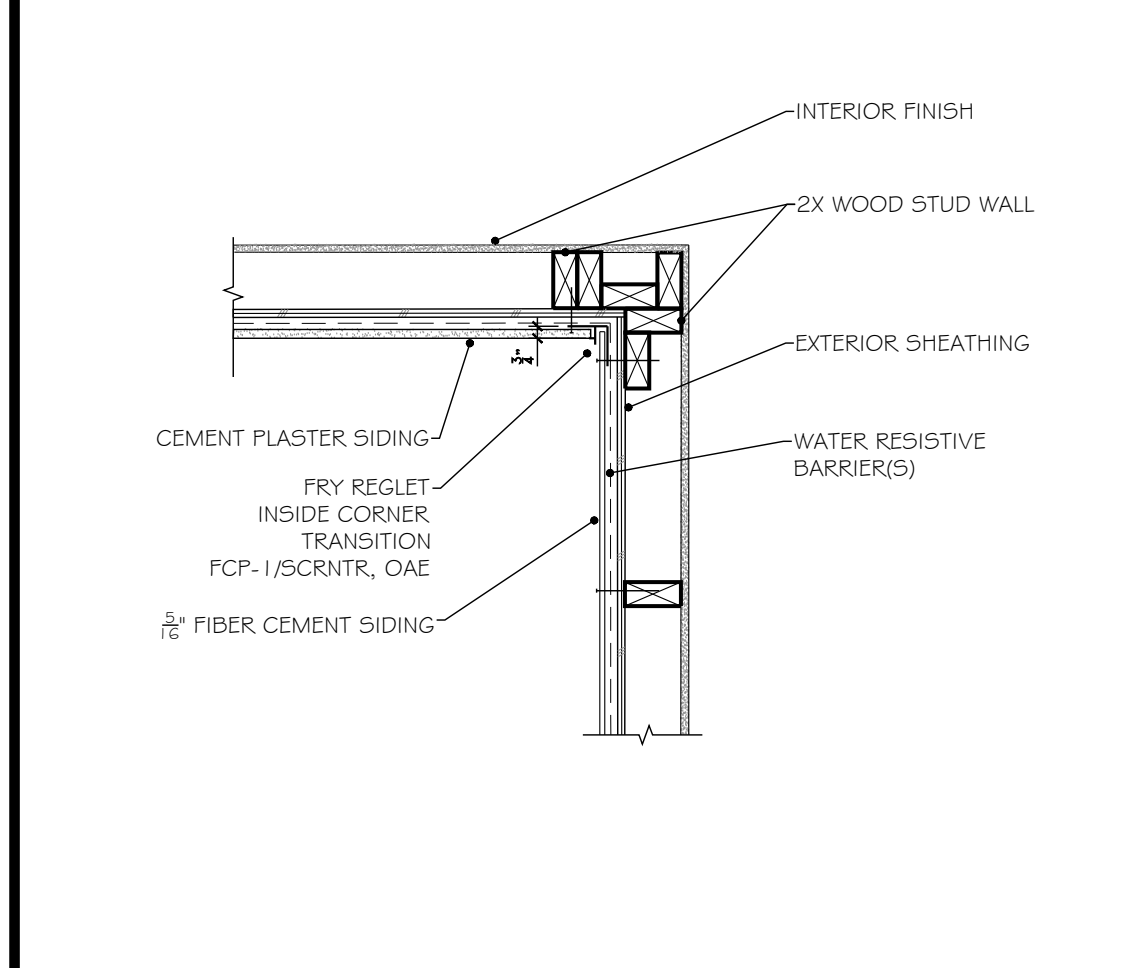


39 SIDING TO PLASTER AT INSIDE CORNER
SCALE: 1" = 1'-0"
A-DT-FIN-FC5-BB-0004

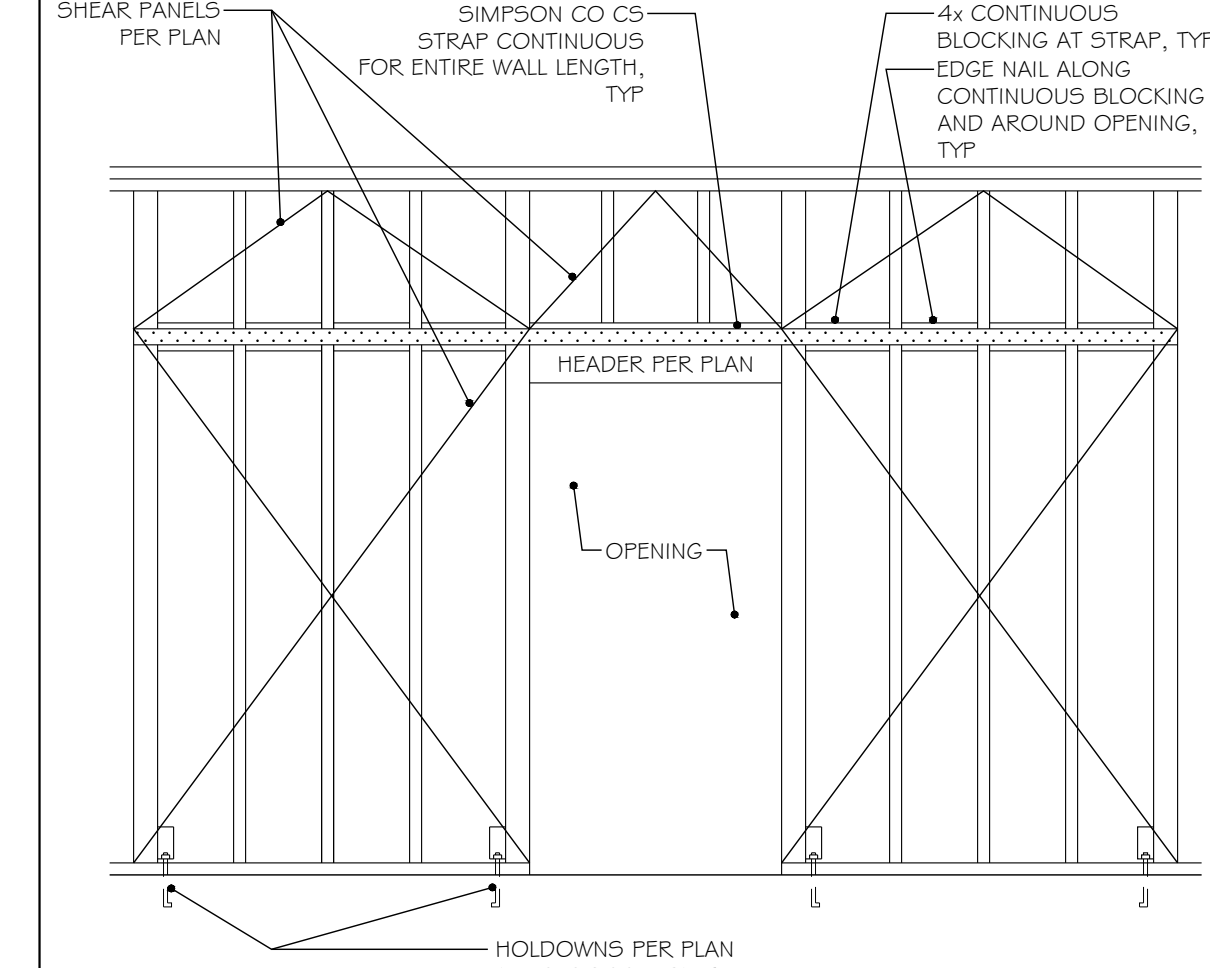


35 SHEAR WALL DETAIL
SCALE: N.T.S.
A-DT-FMG-WF-0020

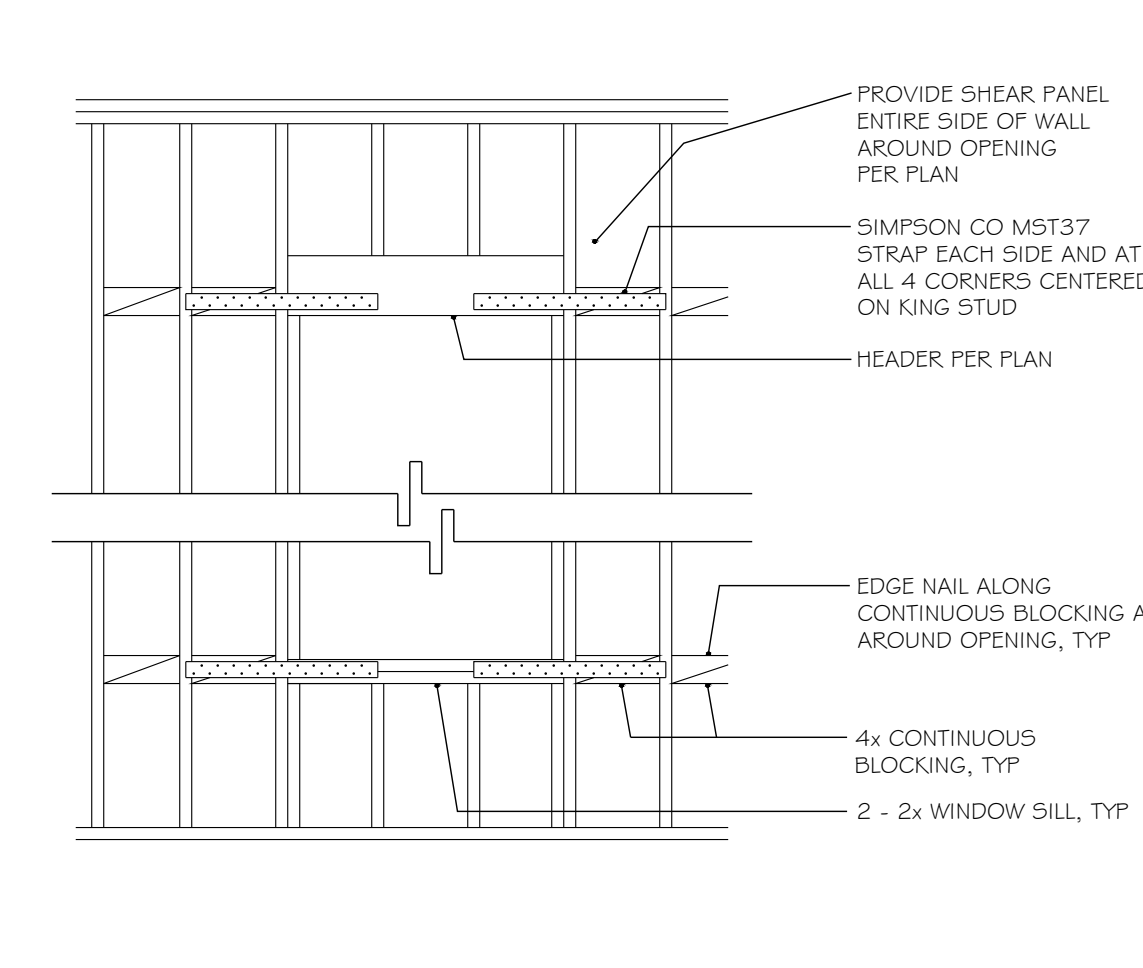


31 OPENING BLOCKING AND STRAPPING IN SHEAR PANEL
SCALE: 1/2" = 1'-0"
A-DT-FMG-WF-0009

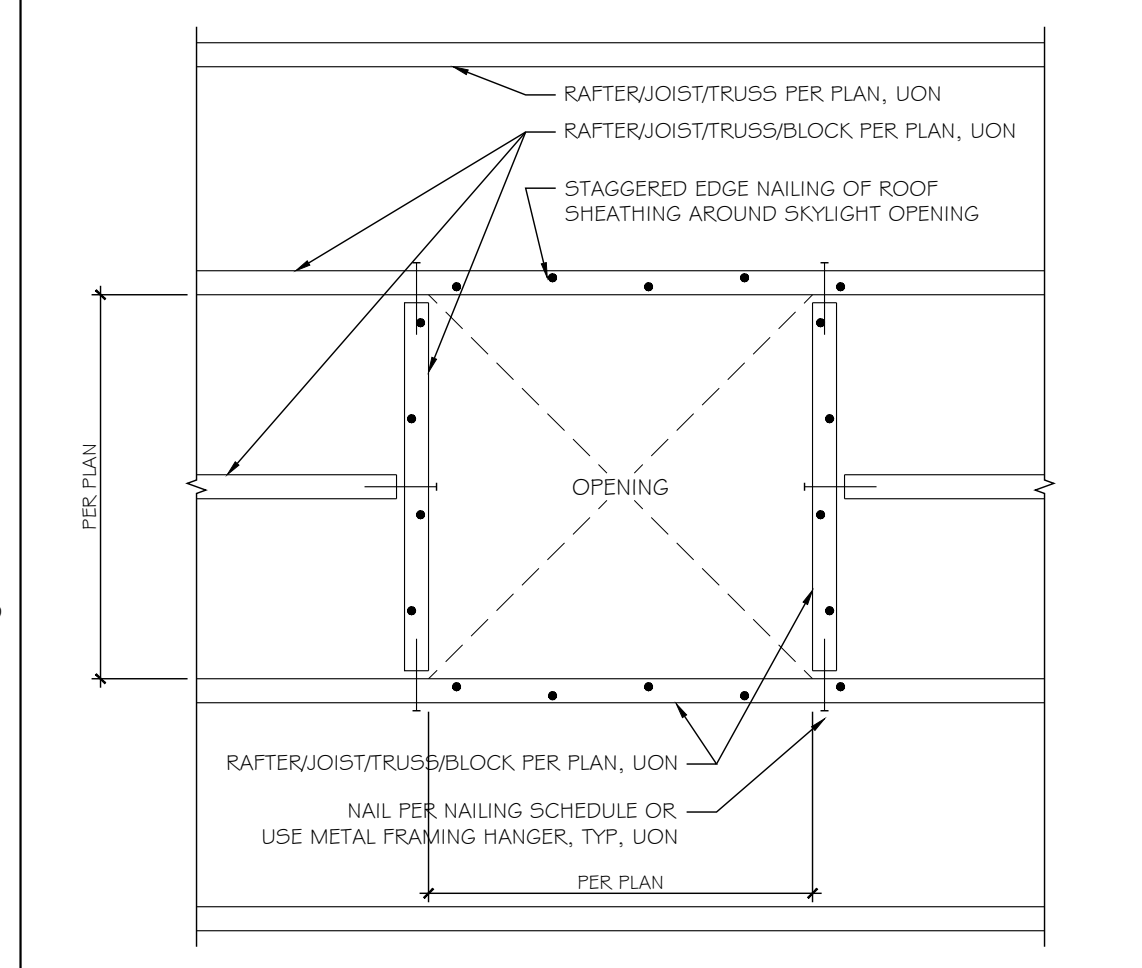


27 DIAPHRAGM OPENING AT SKYLIGHT
SCALE: 1" = 1'-0"
A-DT-FEN-SL-0007

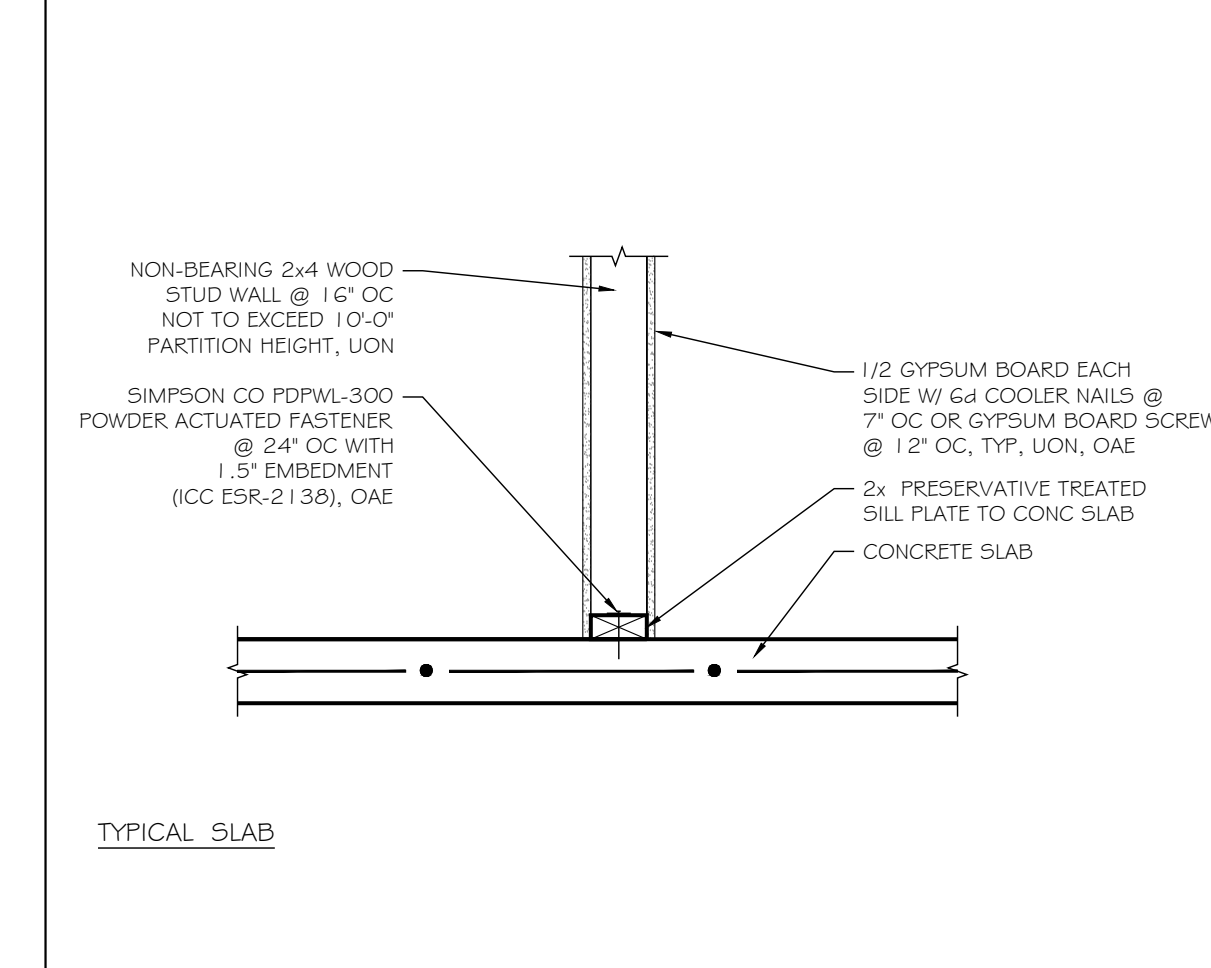


23 NON-BEARING INTERIOR STUD WALL TO CONCRETE SLAB
SCALE: 1" = 1'-0"
A-DT-FMG-WF-COM-0005

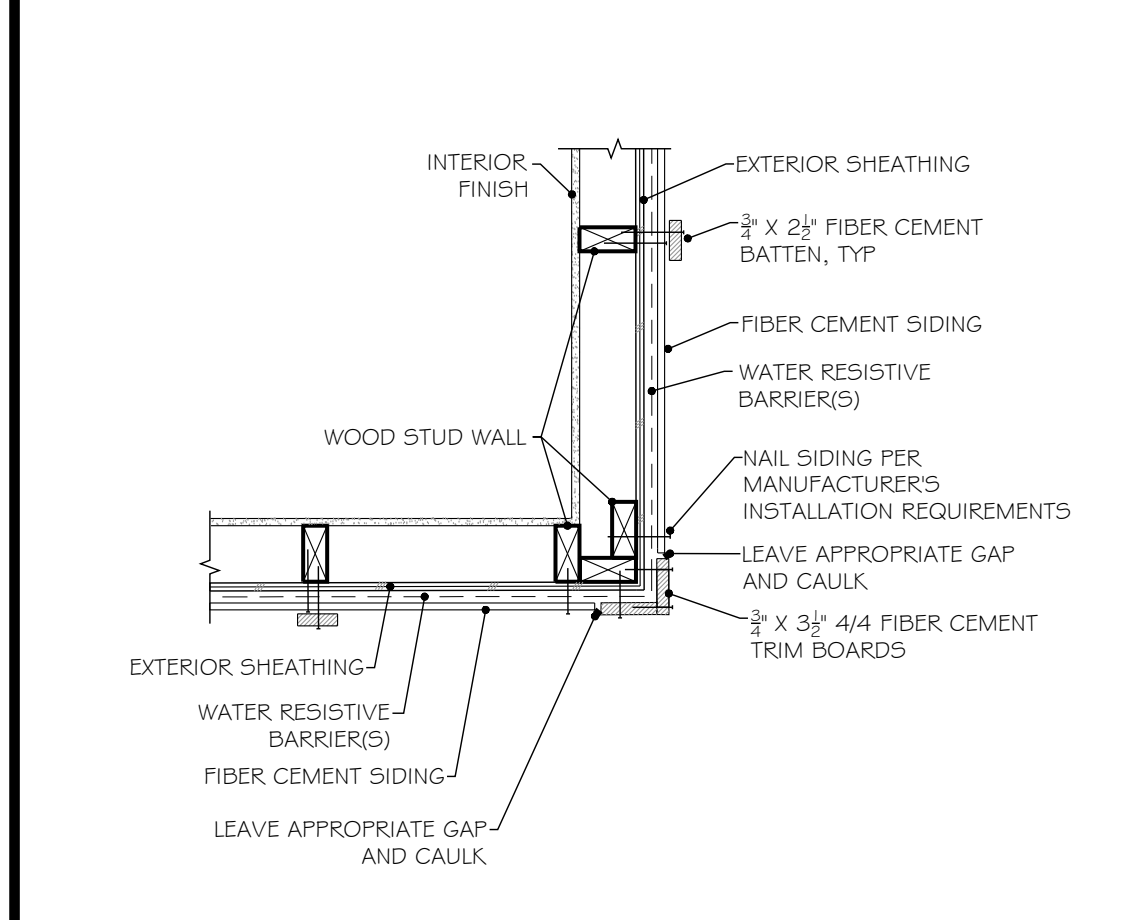


40 SIDING AT OUTSIDE CORNER
SCALE: 1" = 1'-0"
A-DT-FIN-FC5-BB-0002

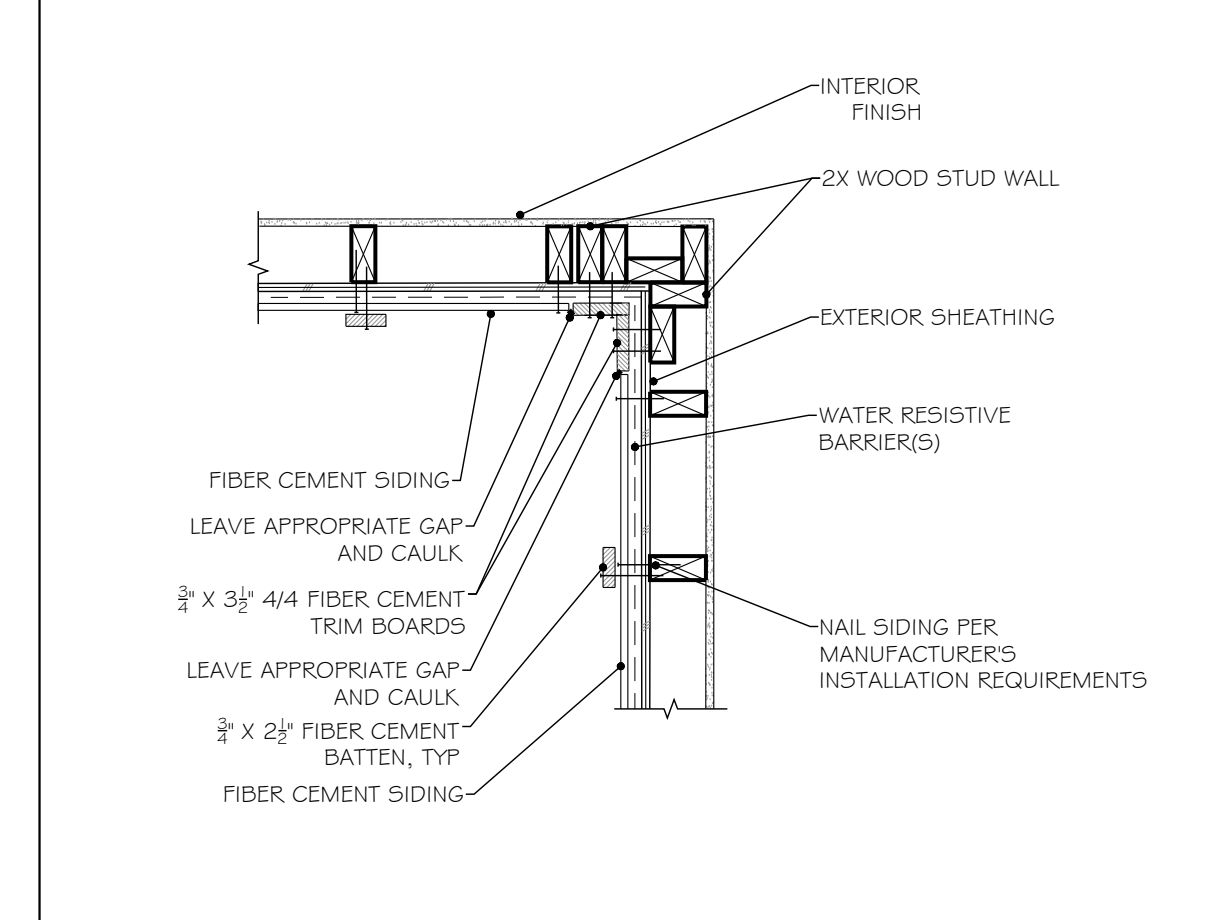


36 SIDING AT INSIDE CORNER
SCALE: 1" = 1'-0"
A-DT-FIN-FC5-BB-0003

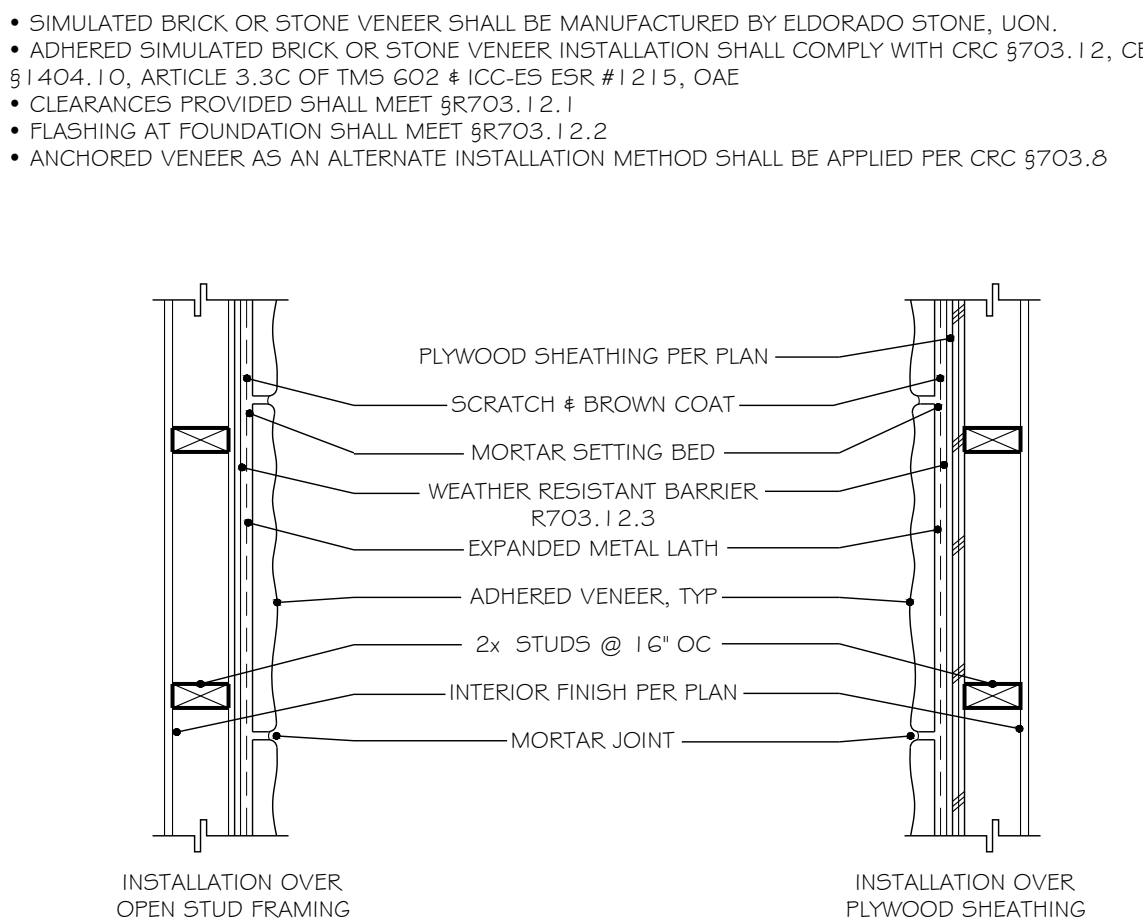

32 ADHERED SIMULATED BRICK OR STONE VENEER AT STUD WALL
SCALE: 1" = 1'-0"
A-DT-FMG-WF-0026

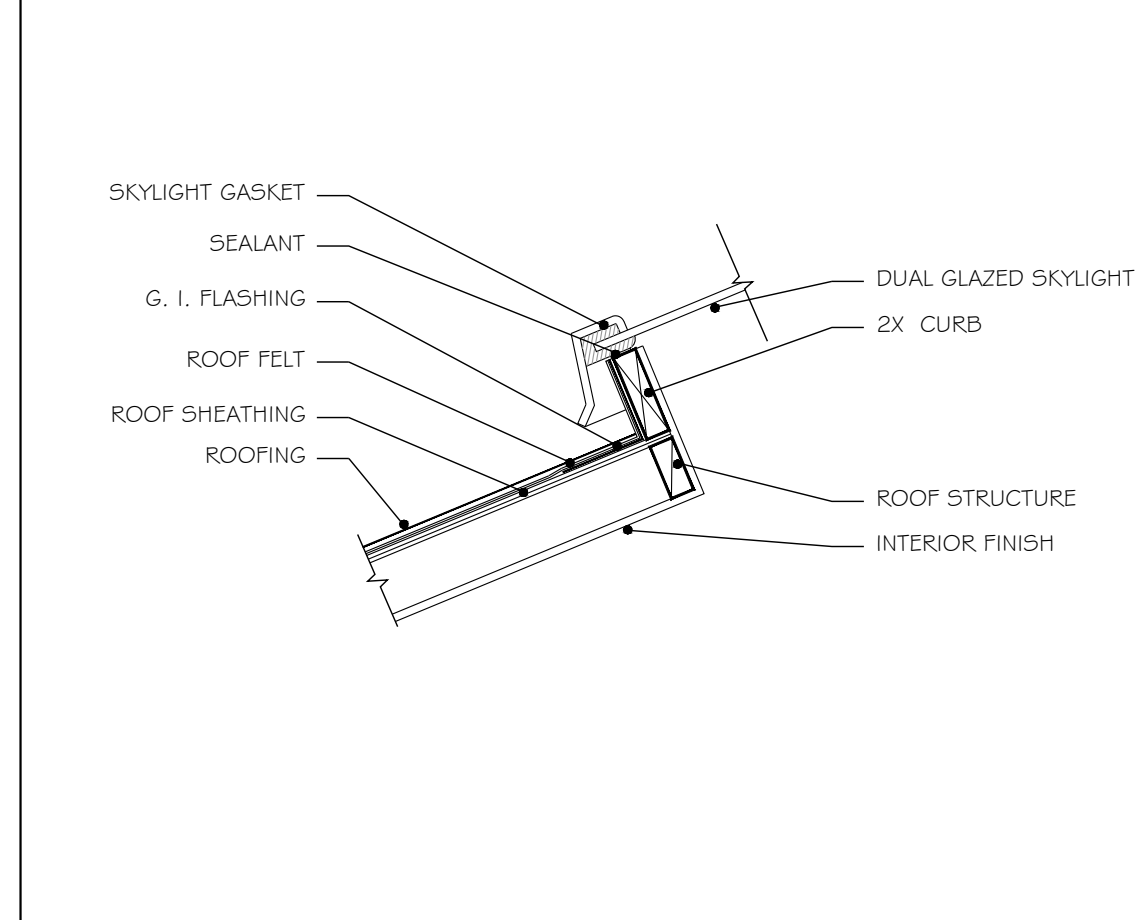

28 CURB MOUNTED SKYLIGHT AT SLOPED ROOF
SCALE: 1" = 1'-0"
A-DT-FEN-SL-0001

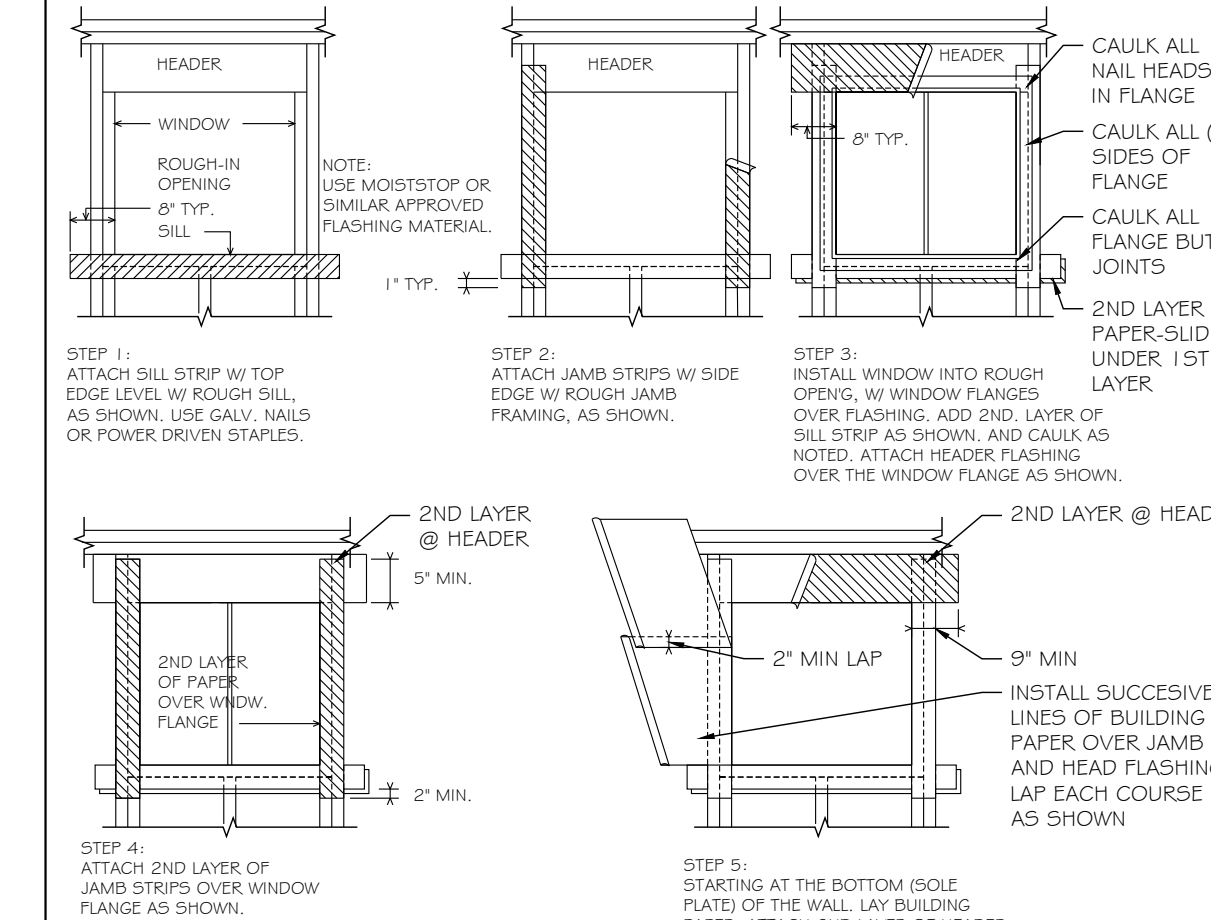

24 WINDOW FLASHING
SCALE: 1/2" = 1'-0"
A-DT-FEN-WD-0002

PREPARER SIGNATURE

FOR CITY STAMPS

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


ANAHEIM PRADU

CITY: ANAHEIM


JOB: 202409R

DETAILS


d0.1

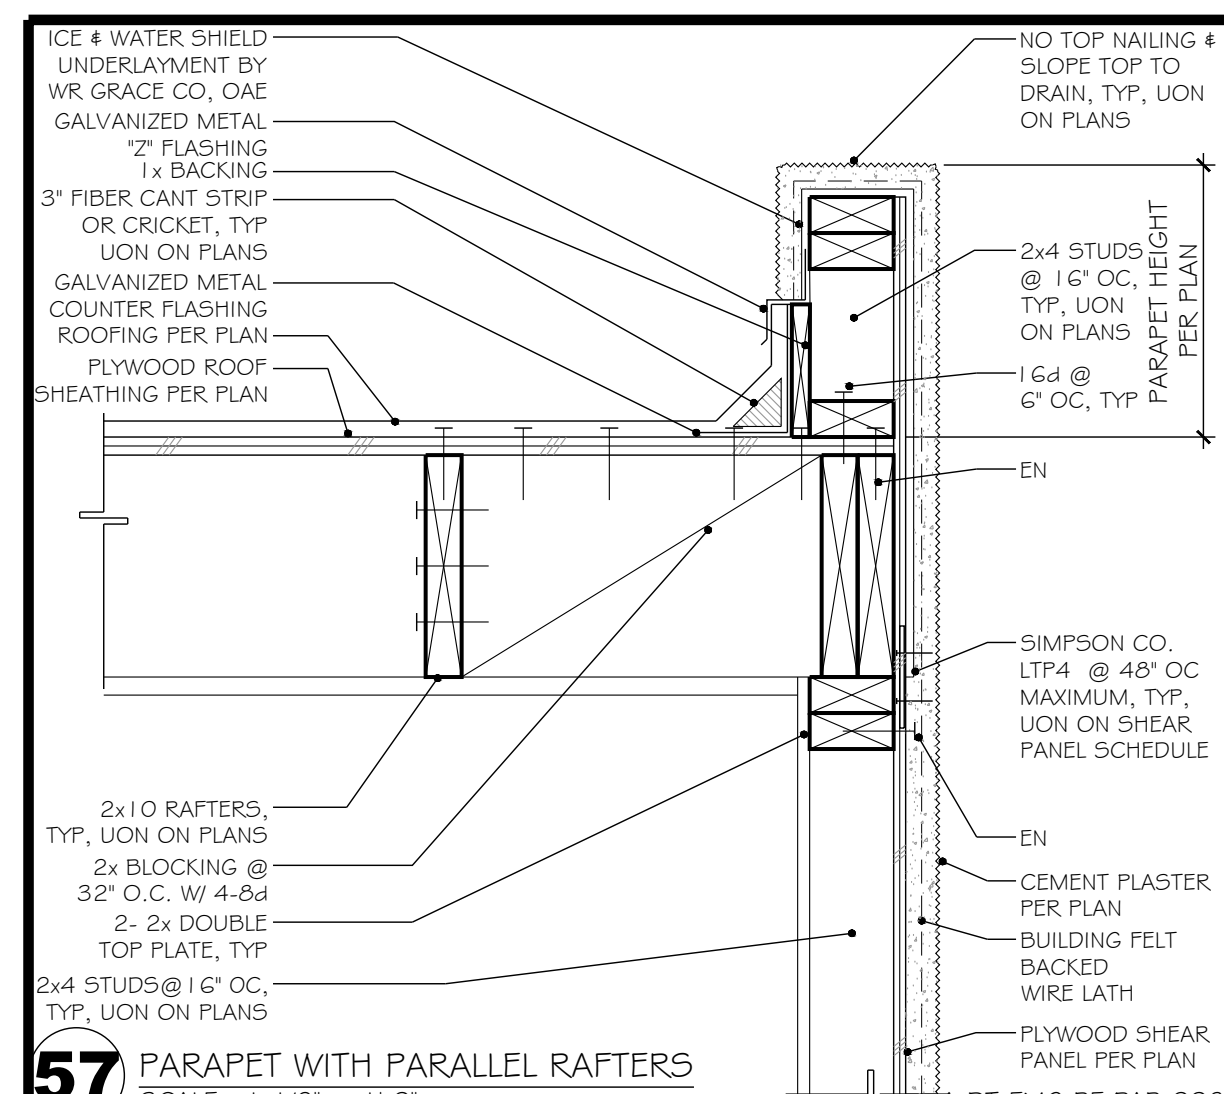


57 PARAPET WITH PARALLEL RAFTERS
SCALE: 1/2" = 1'-0"

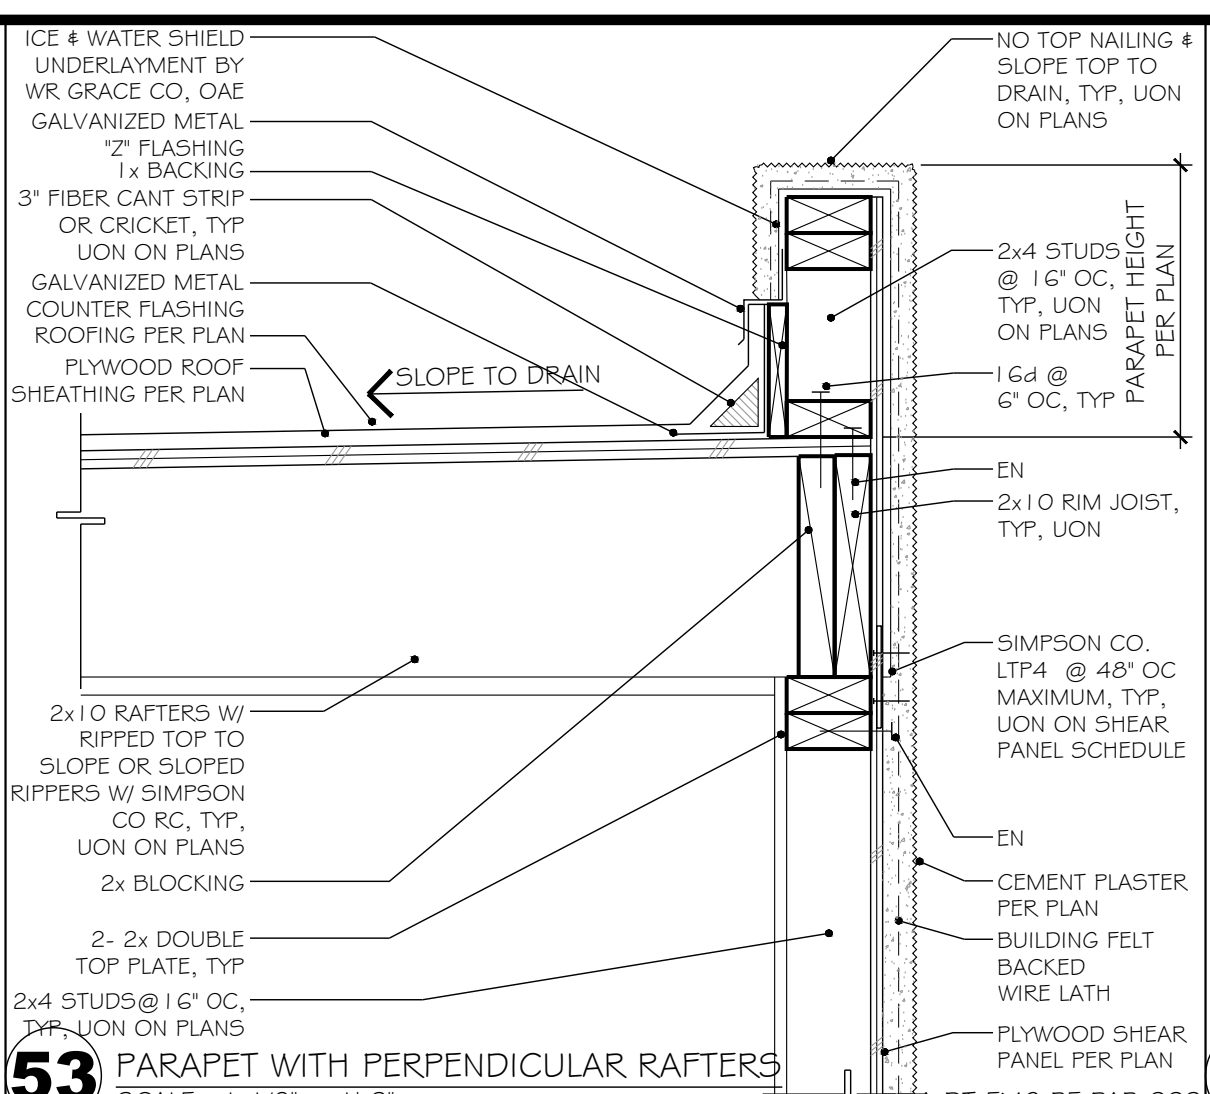


53 PARAPET WITH PERPENDICULAR RAFTERS
SCALE: 1/2" = 1'-0"

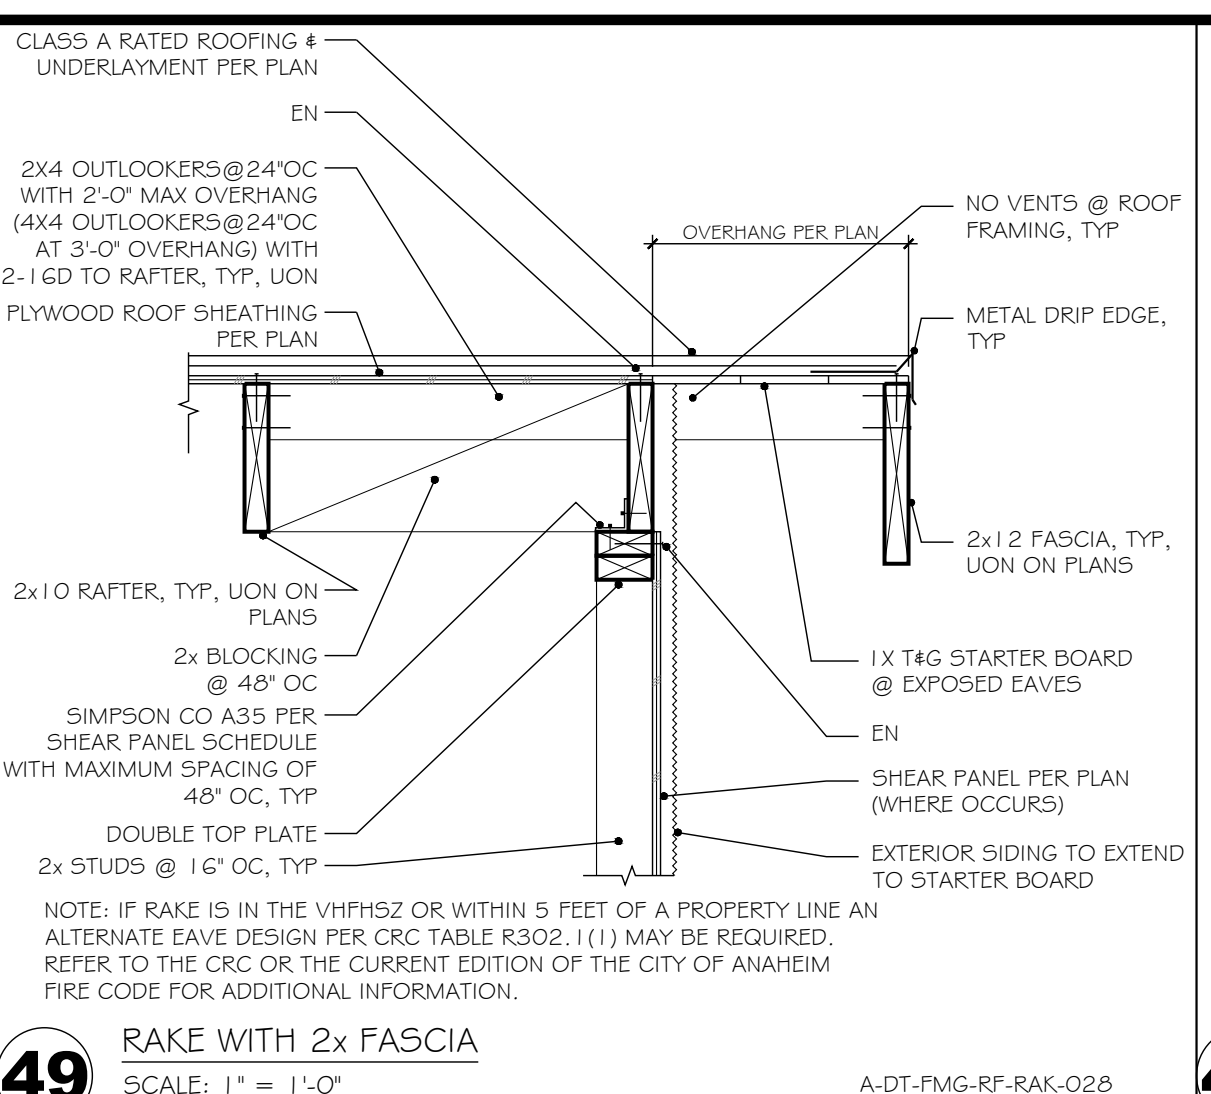


49 RAKE WITH 2x FASCIA
SCALE: 1" = 1'-0"

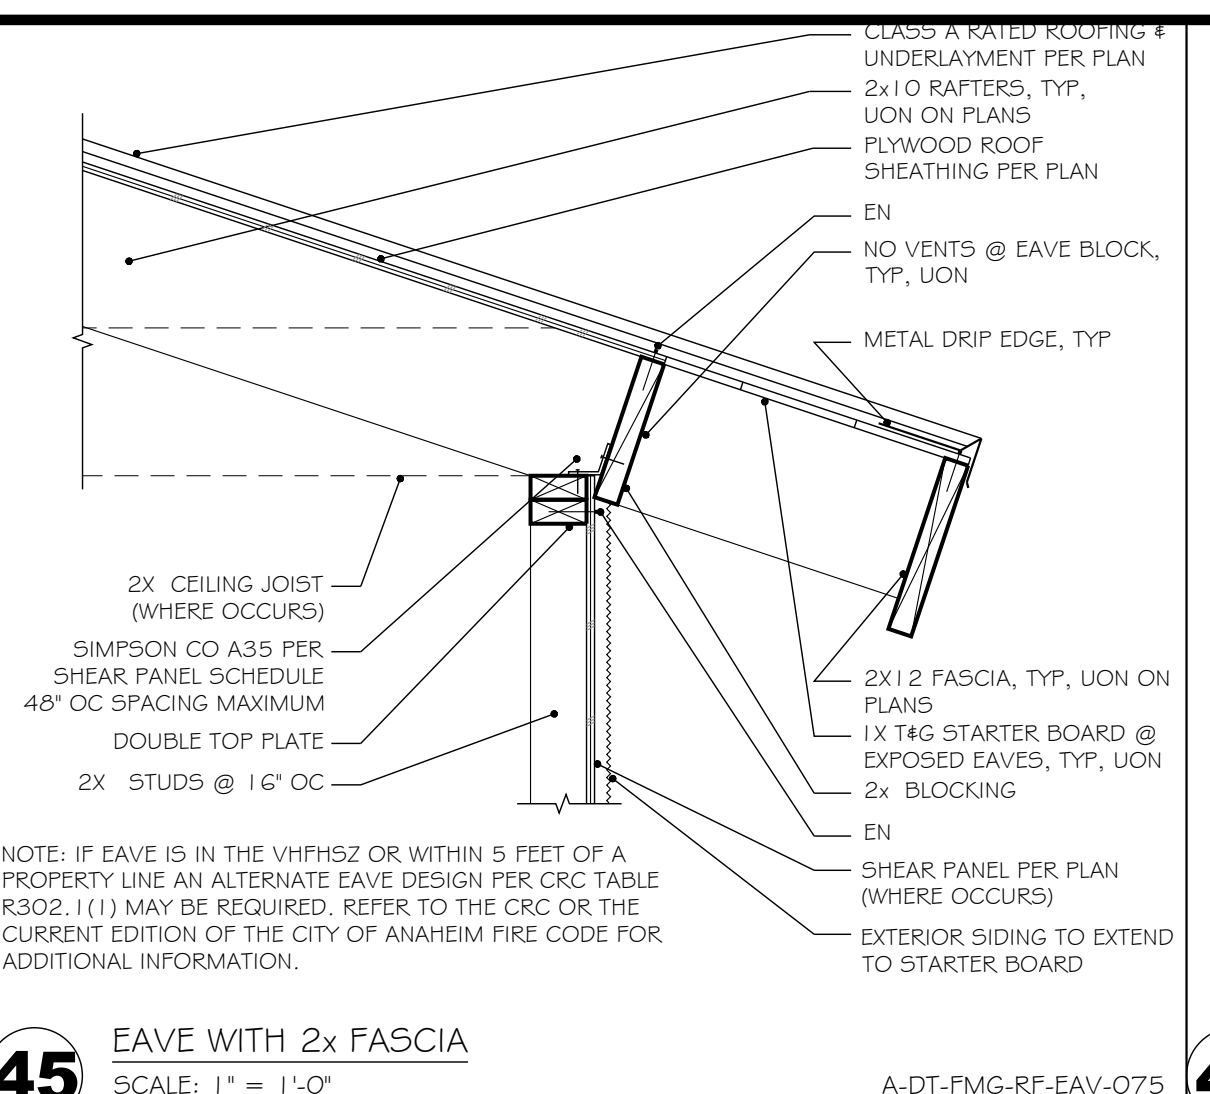


45 EAVE WITH 2x FASCIA
SCALE: 1" = 1'-0"

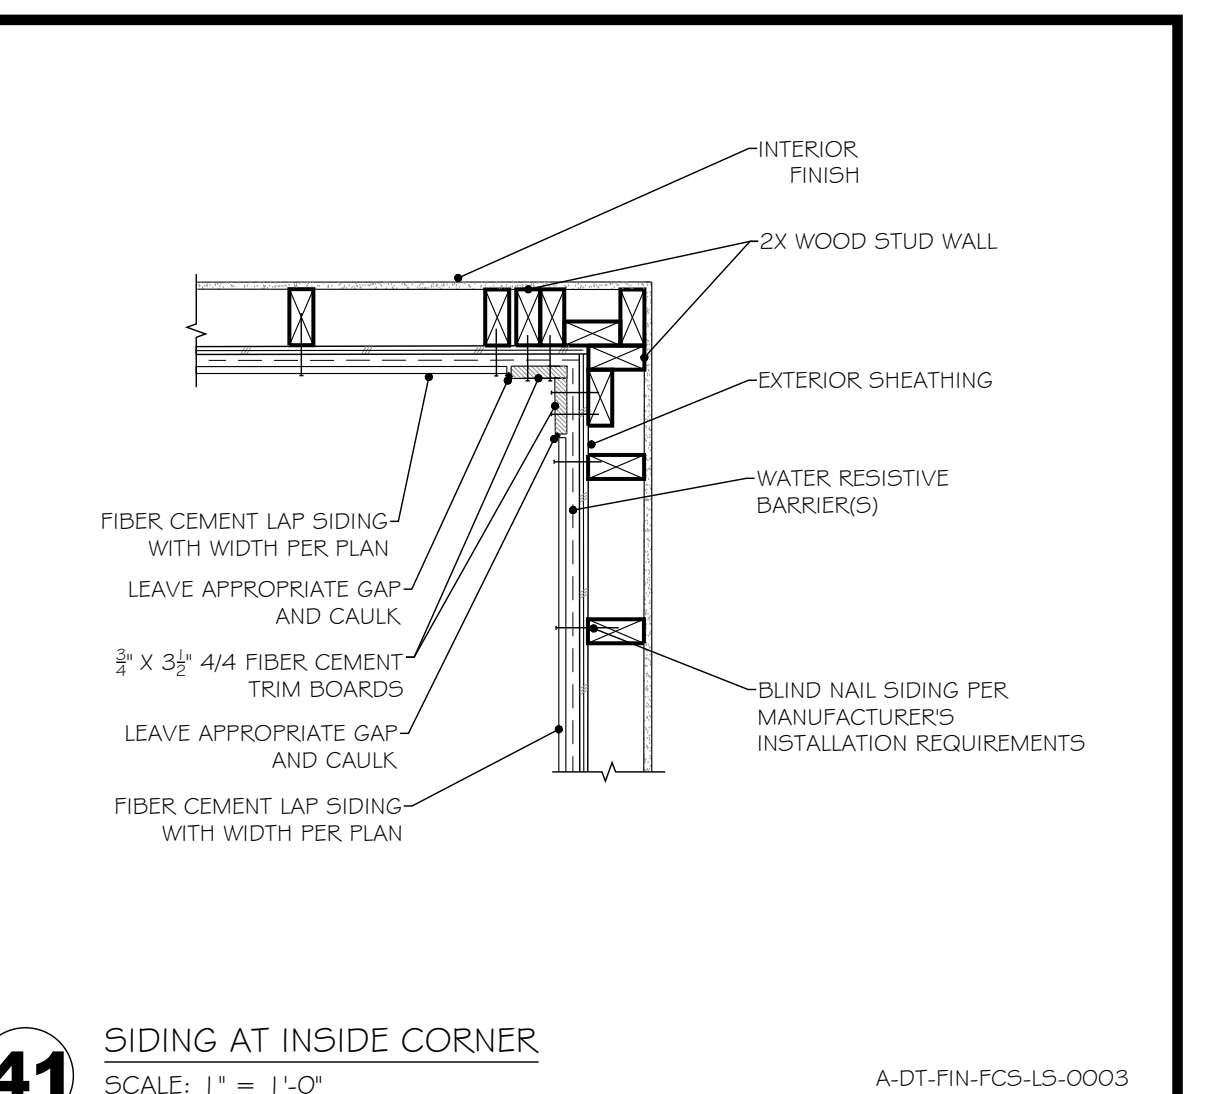


41 SIDING AT INSIDE CORNER
SCALE: 1" = 1'-0"

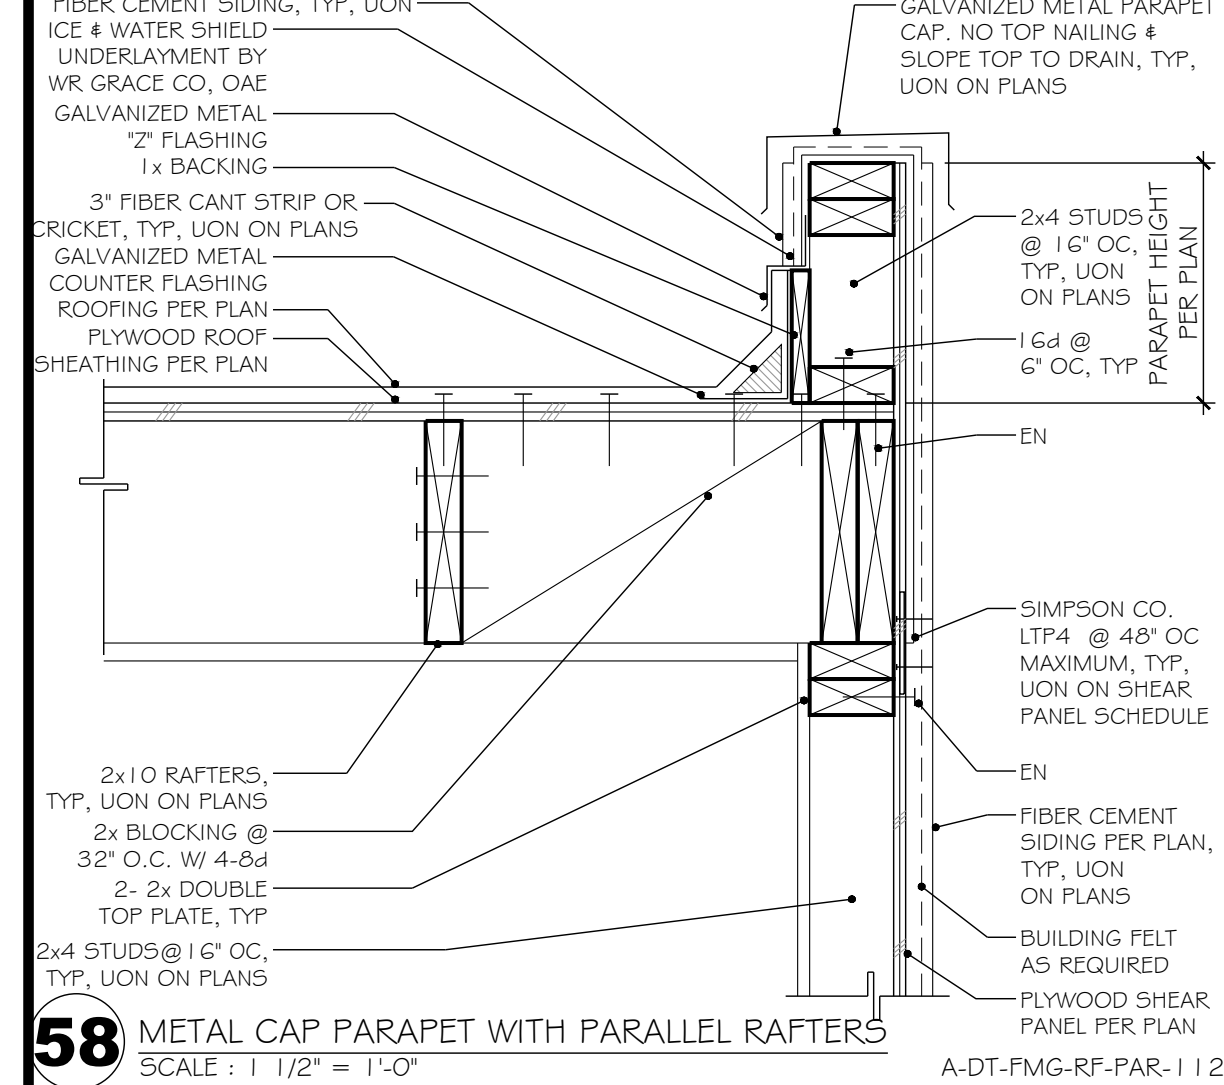


58 METAL CAP PARAPET WITH PARALLEL RAFTERS
SCALE: 1/2" = 1'-0"

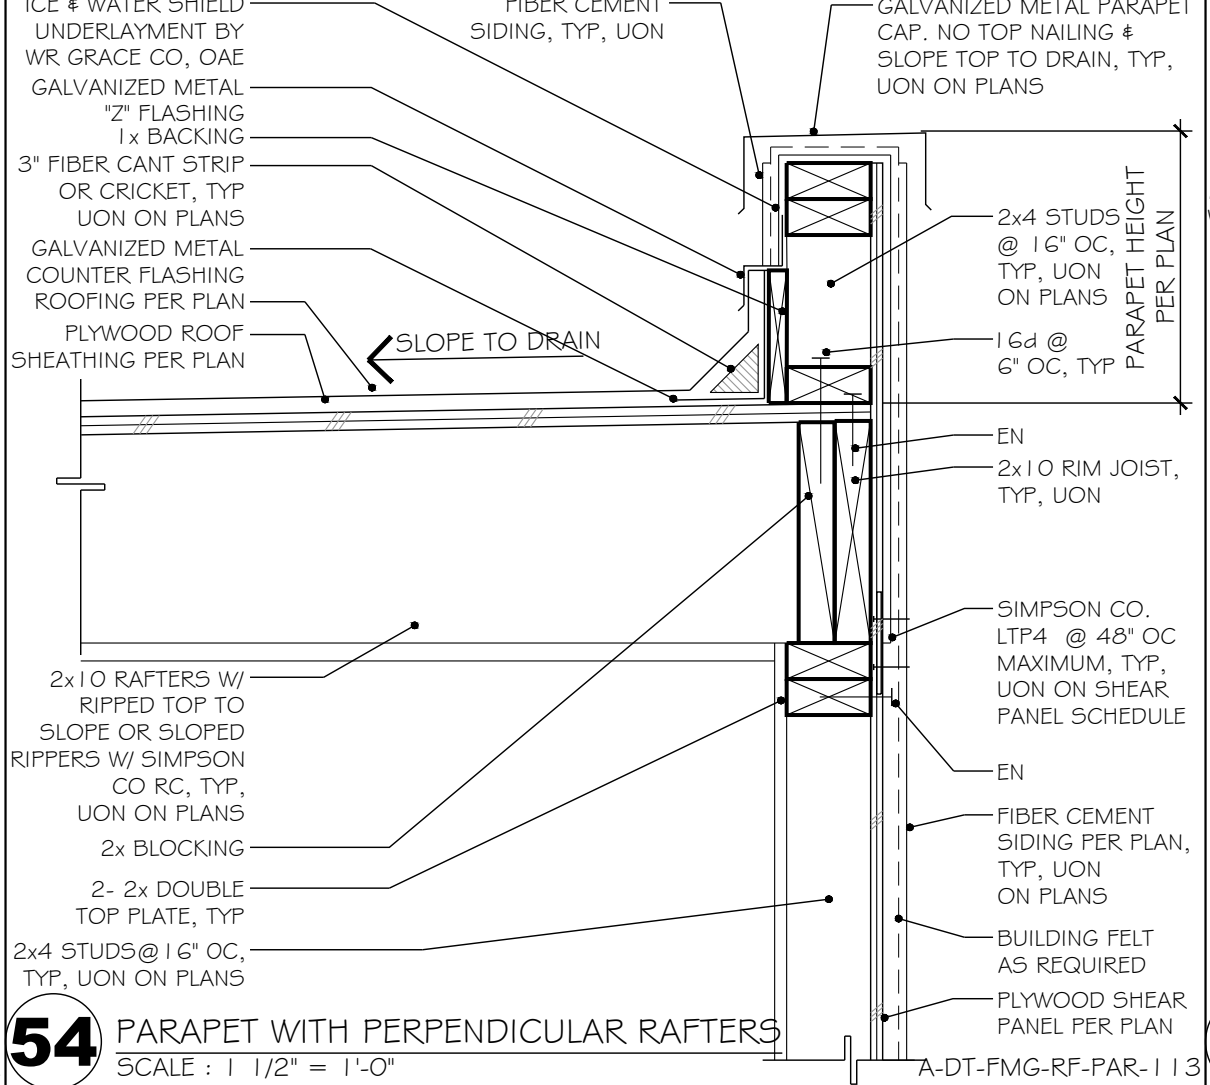


54 PARAPET WITH PERPENDICULAR RAFTERS
SCALE: 1/2" = 1'-0"

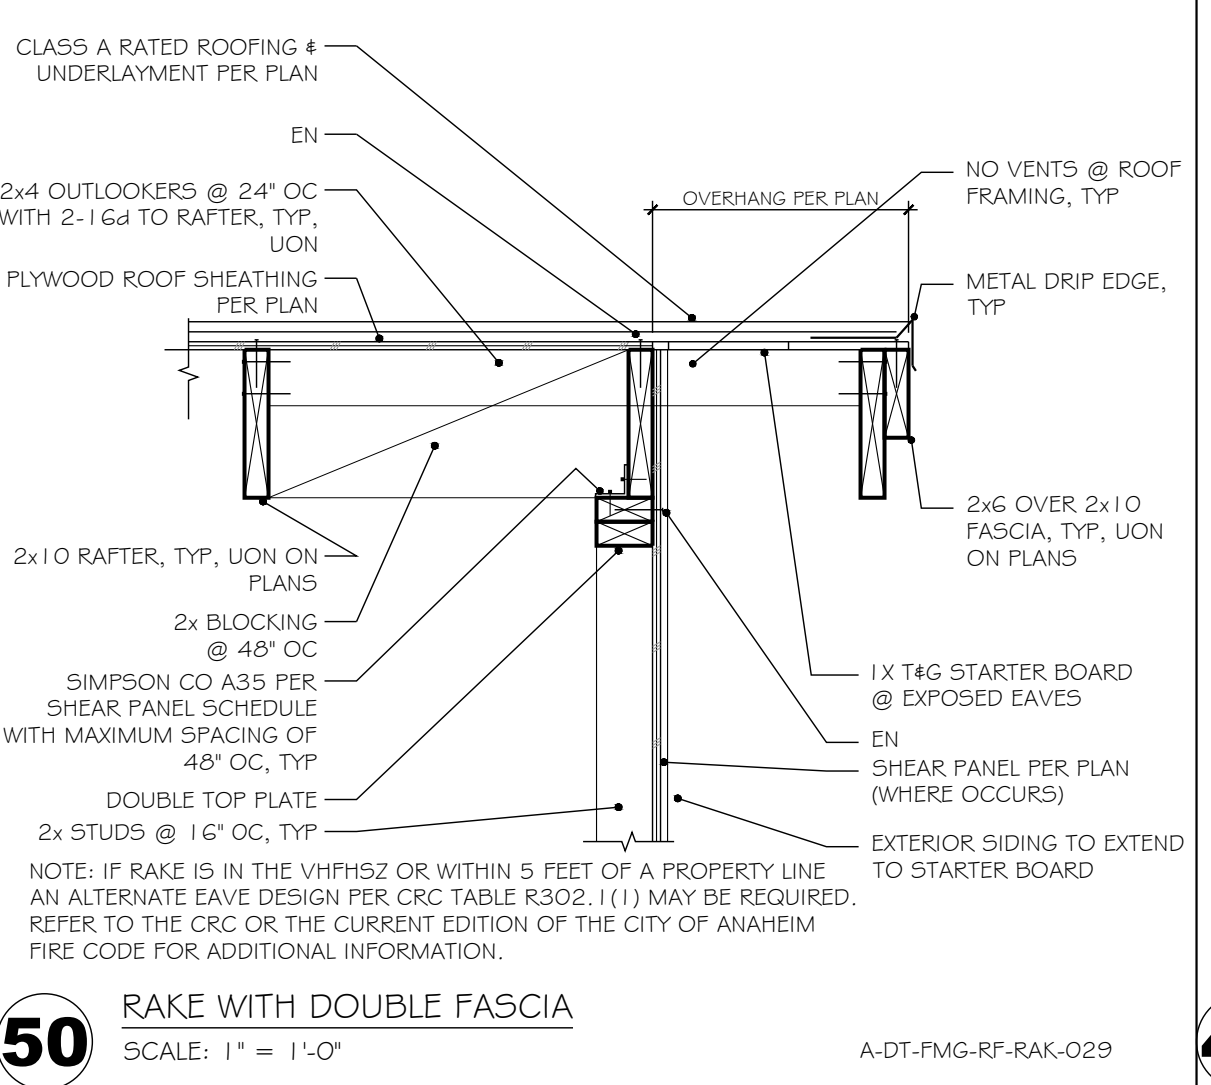


50 RAKE WITH DOUBLE FASCIA
SCALE: 1" = 1'-0"

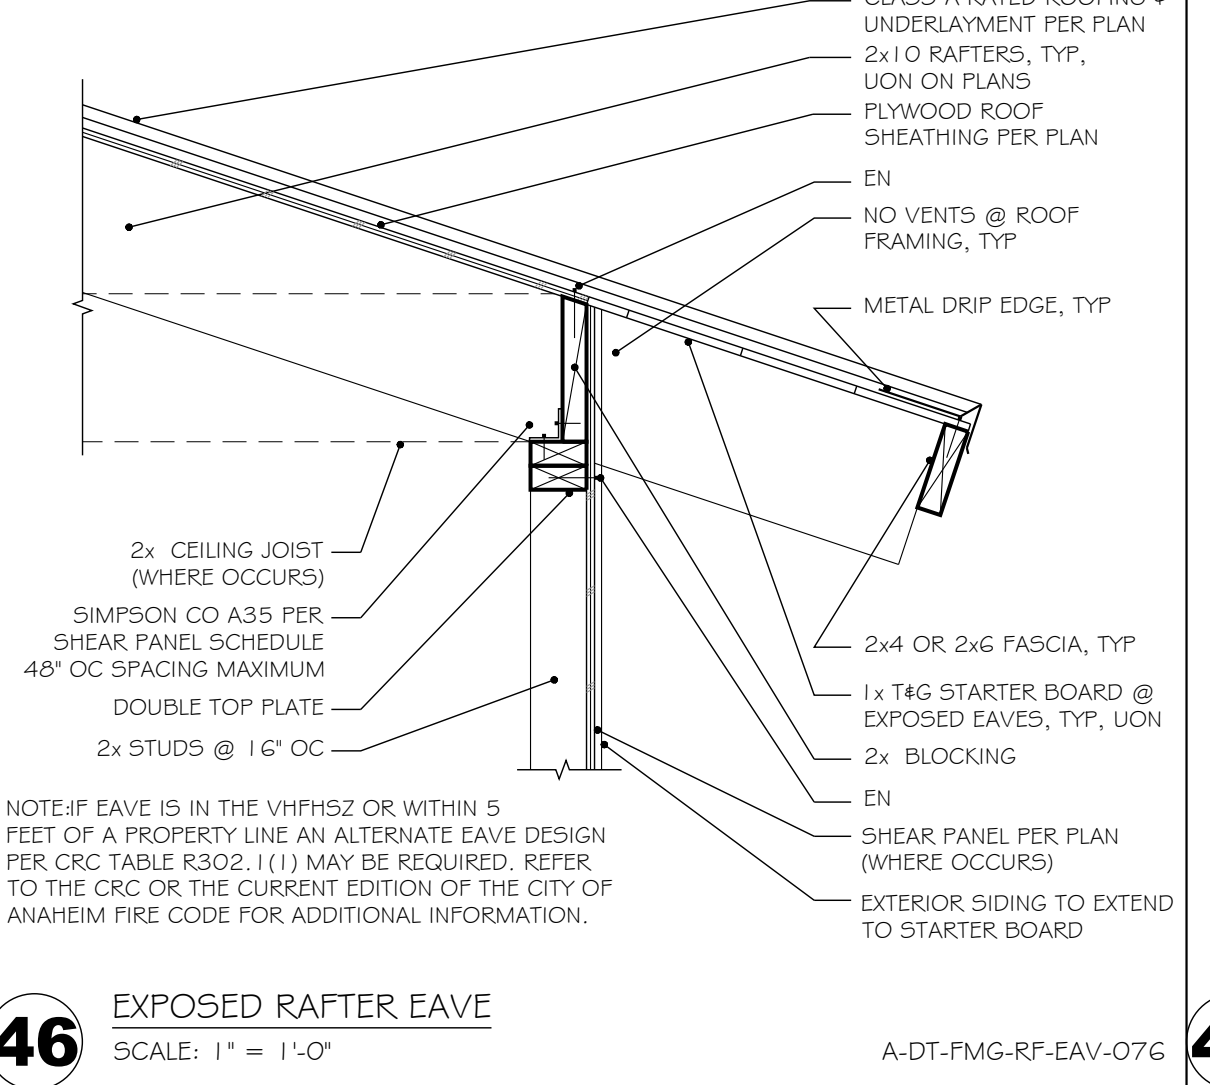


46 EXPOSED RAFTER EAVE
SCALE: 1" = 1'-0"

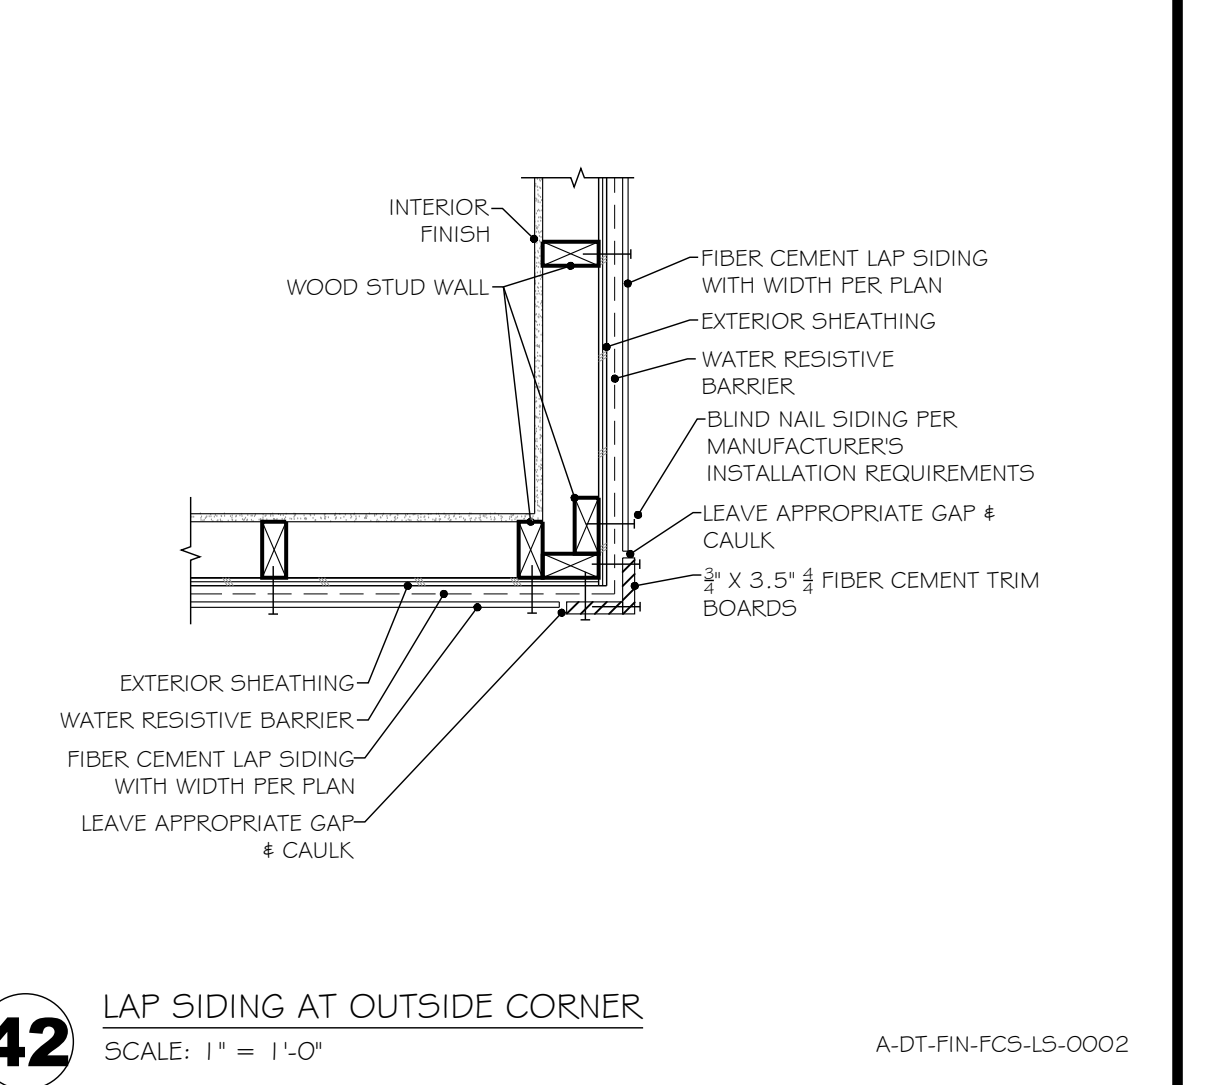


42 LAP SIDING AT OUTSIDE CORNER
SCALE: 1" = 1'-0"

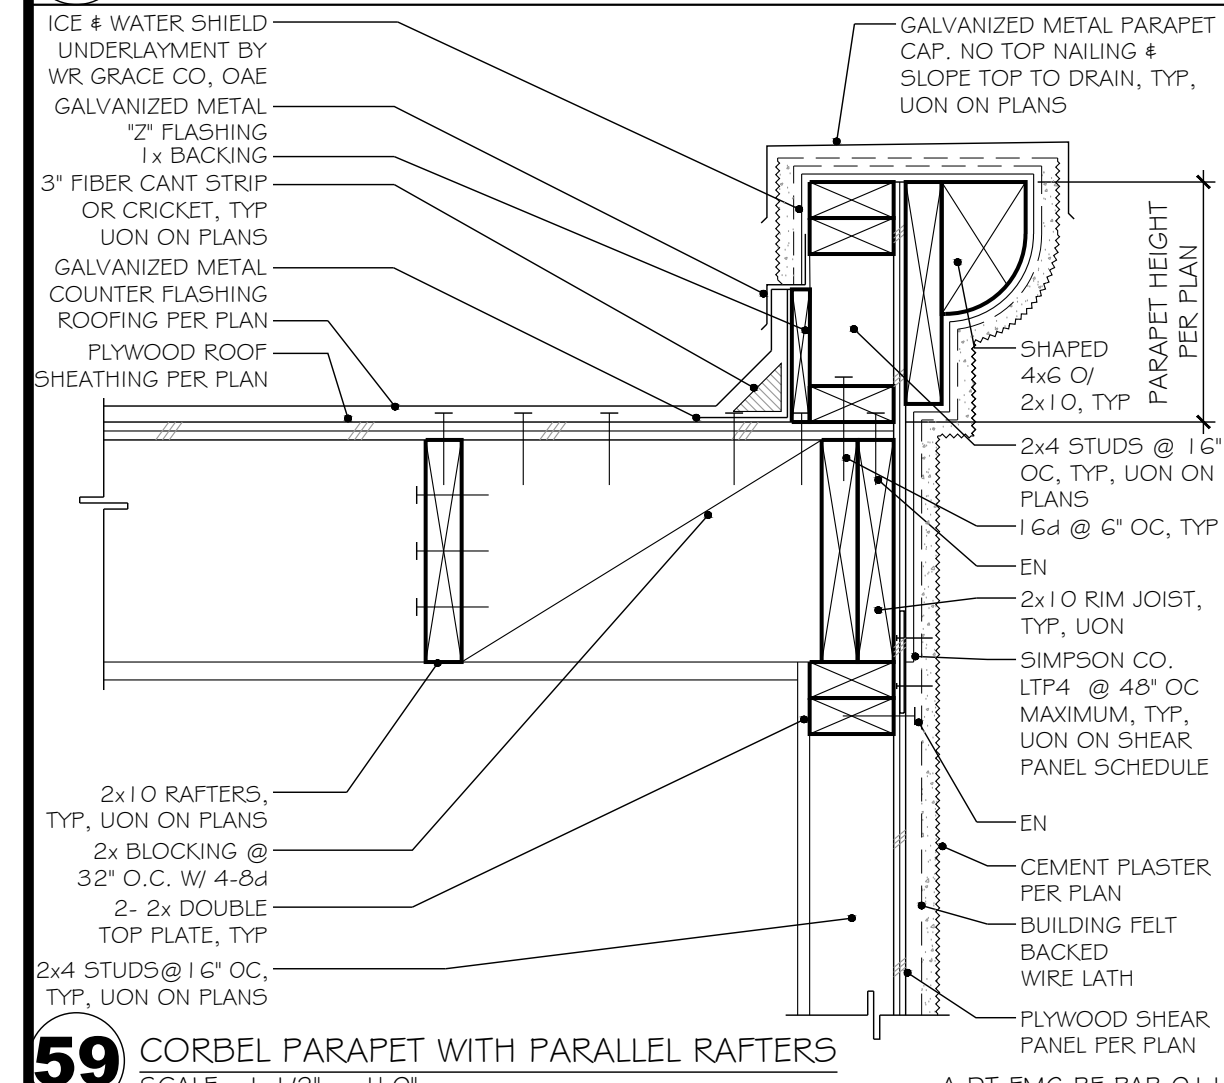


59 CORBEL PARAPET WITH PARALLEL RAFTERS
SCALE: 1/2" = 1'-0"

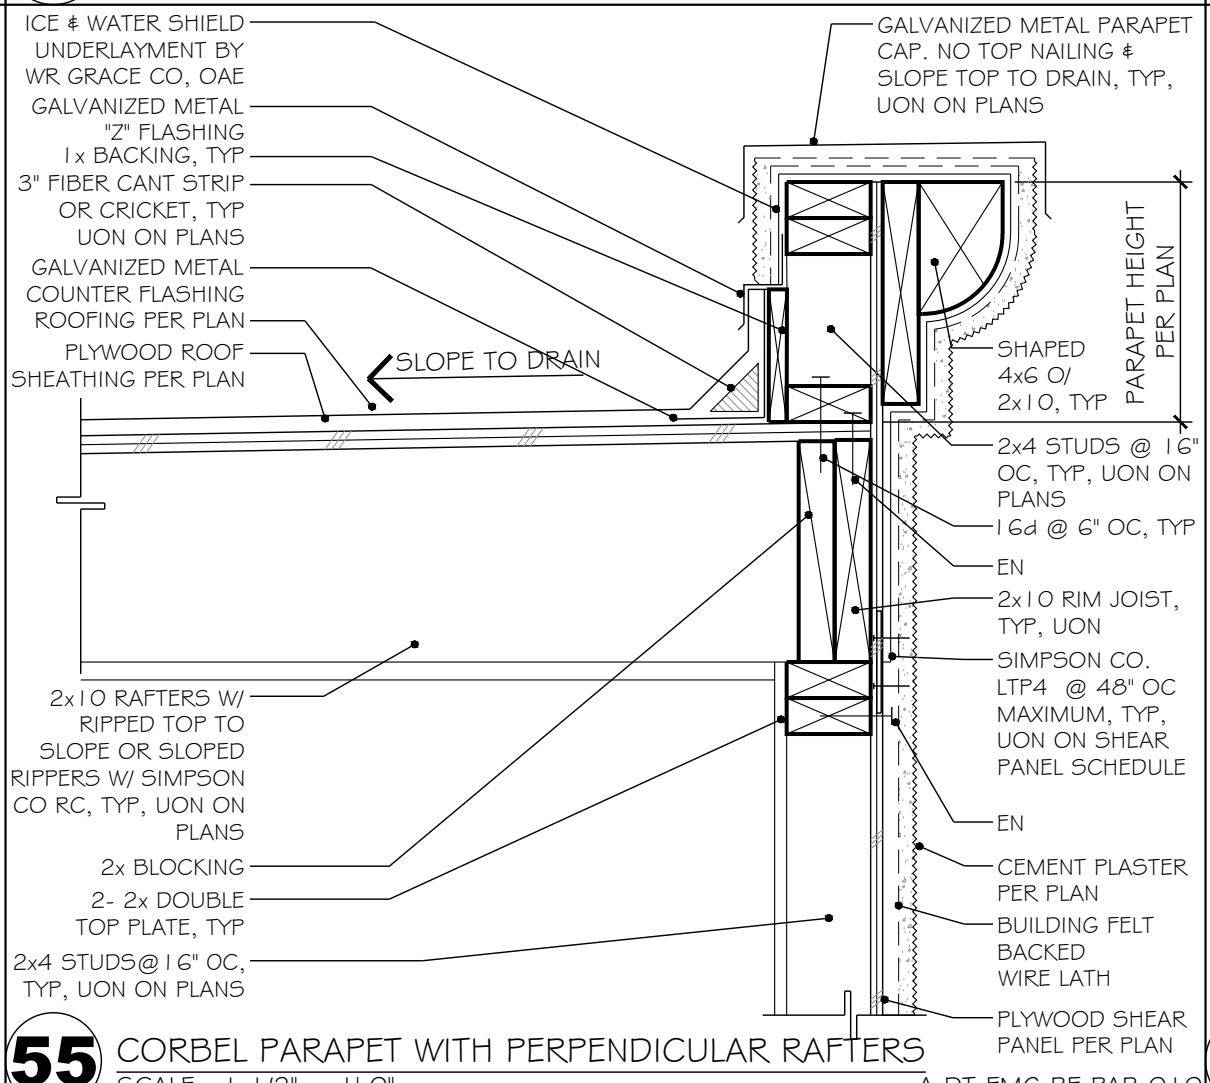


55 CORBEL PARAPET WITH PERPENDICULAR RAFTERS
SCALE: 1/2" = 1'-0"

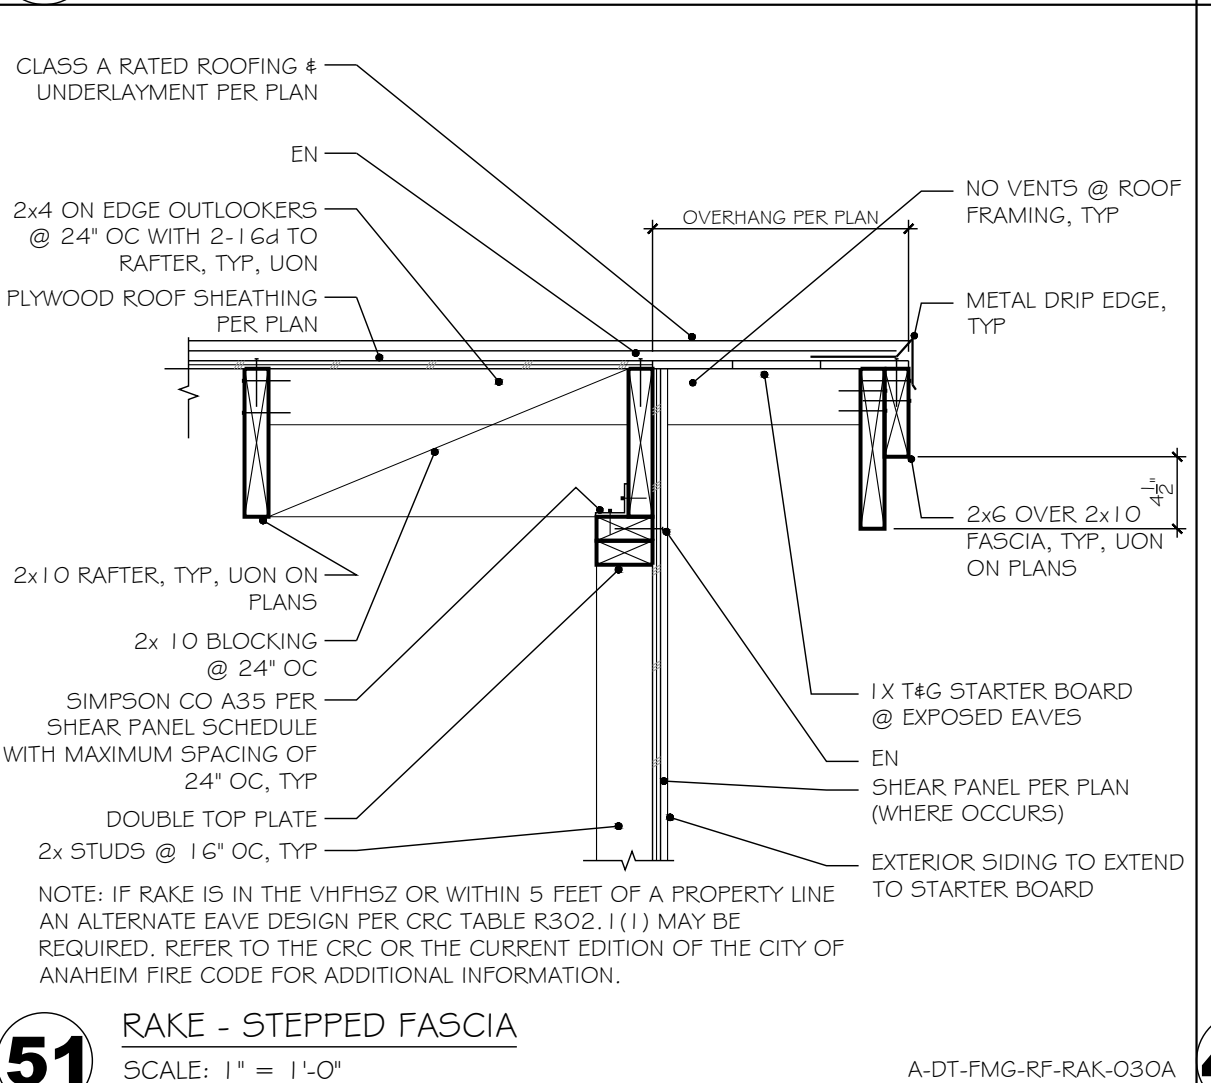


51 RAKE - STEPPED FASCIA
SCALE: 1" = 1'-0"

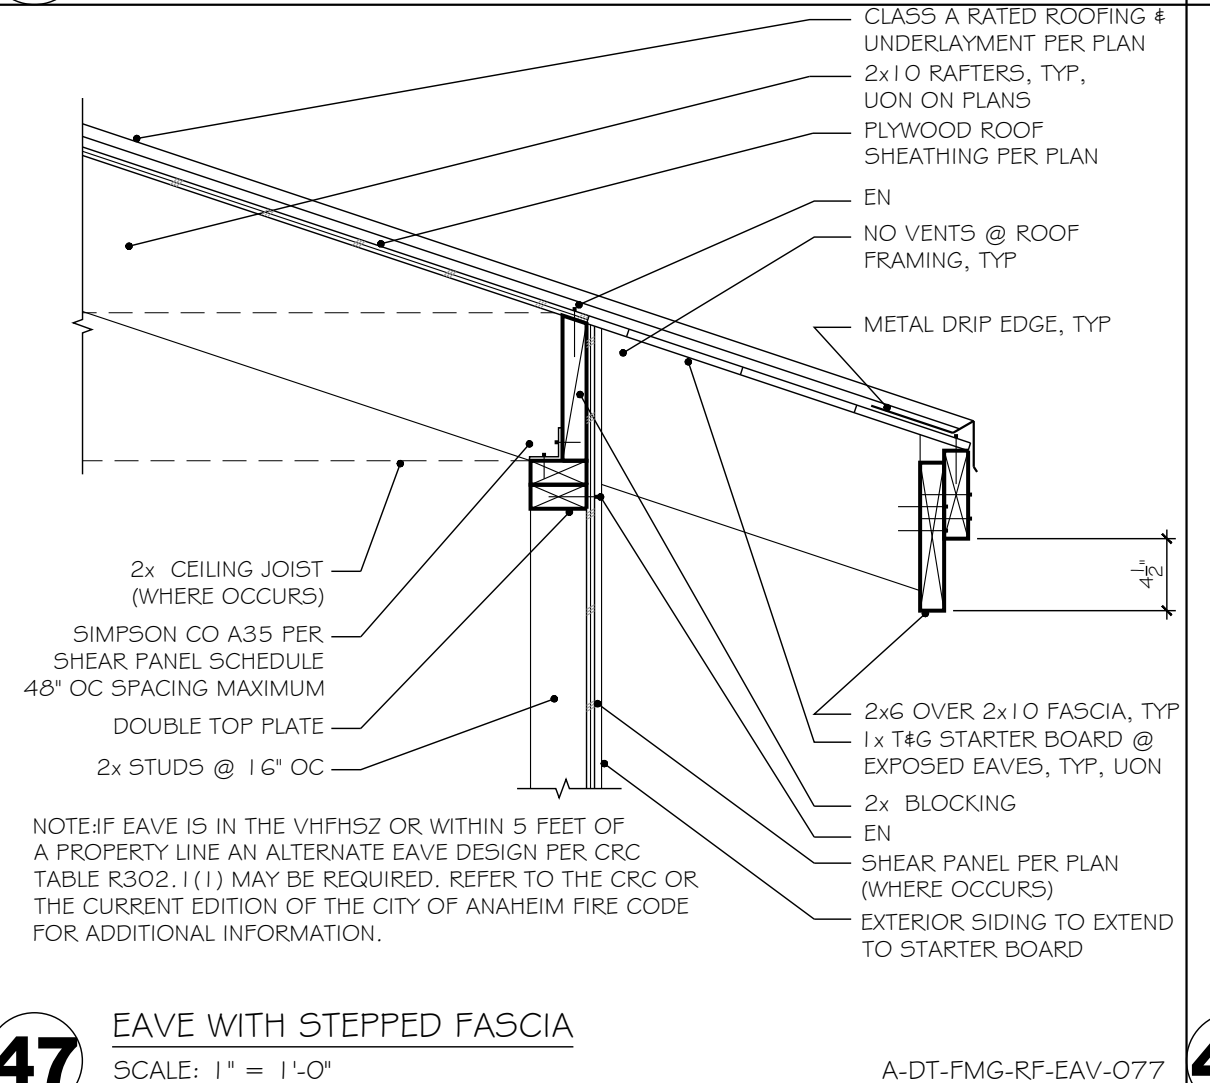


47 EAVE WITH STEPPED FASCIA
SCALE: 1" = 1'-0"

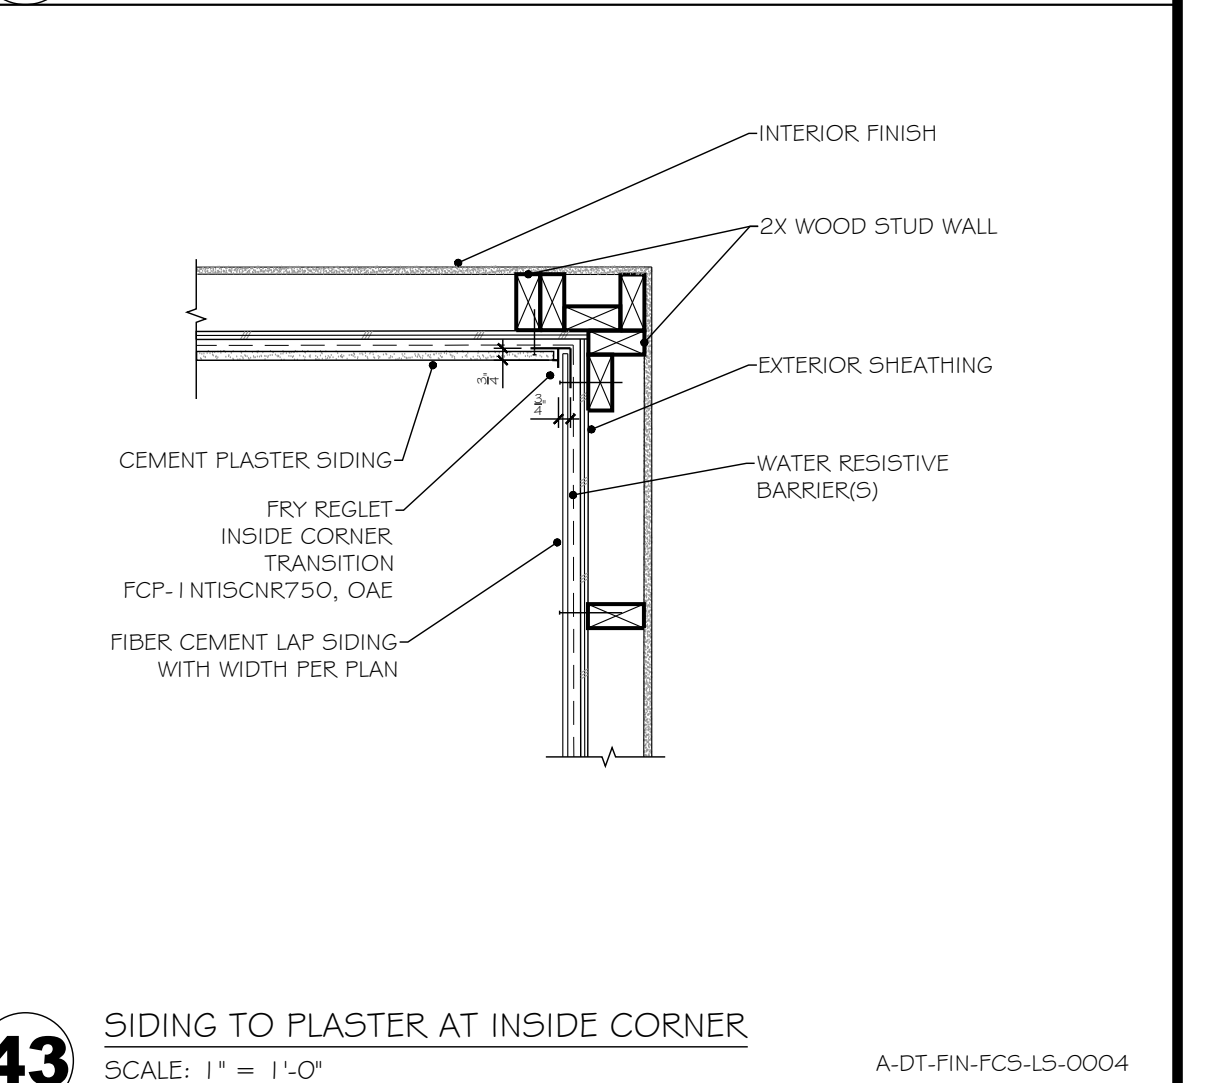


43 SIDING TO PLASTER AT INSIDE CORNER
SCALE: 1" = 1'-0"

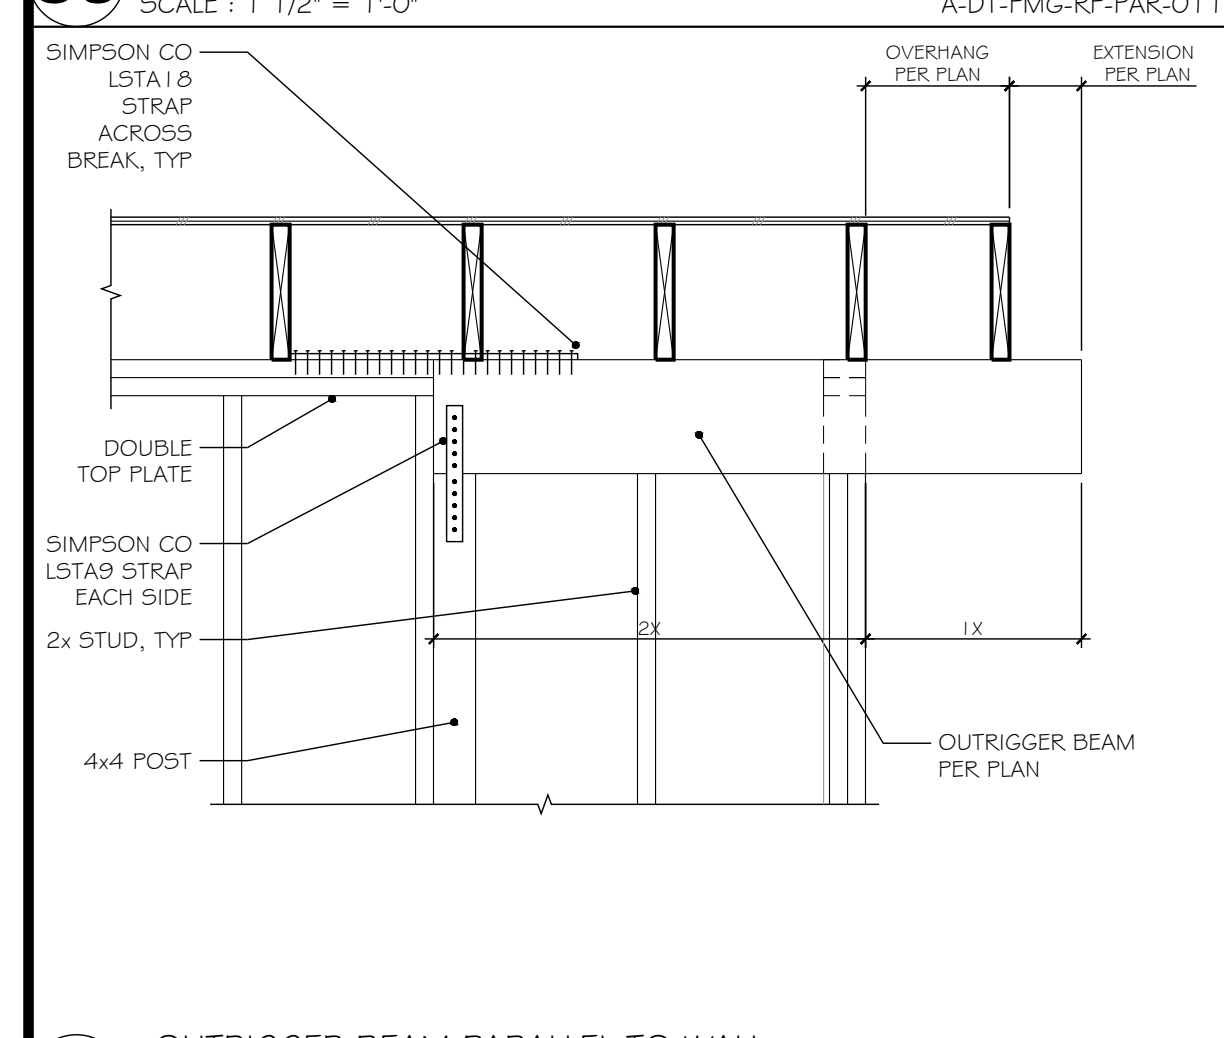


60 OUTRIGGER BEAM PARALLEL TO WALL
SCALE: 3/4" = 1'-0"

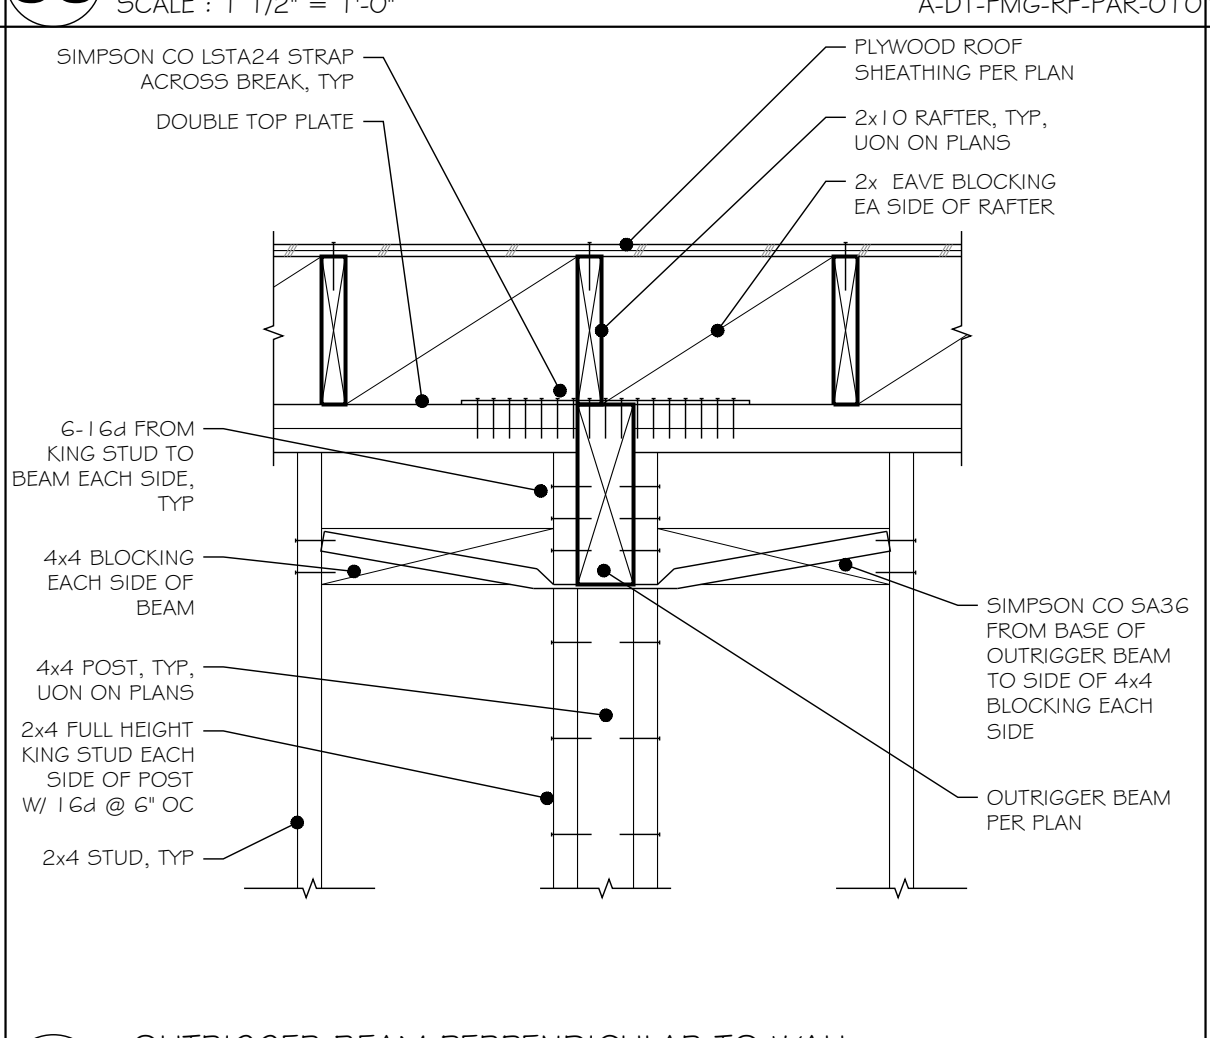


56 OUTRIGGER BEAM PERPENDICULAR TO WALL
SCALE: 1" = 1'-0"

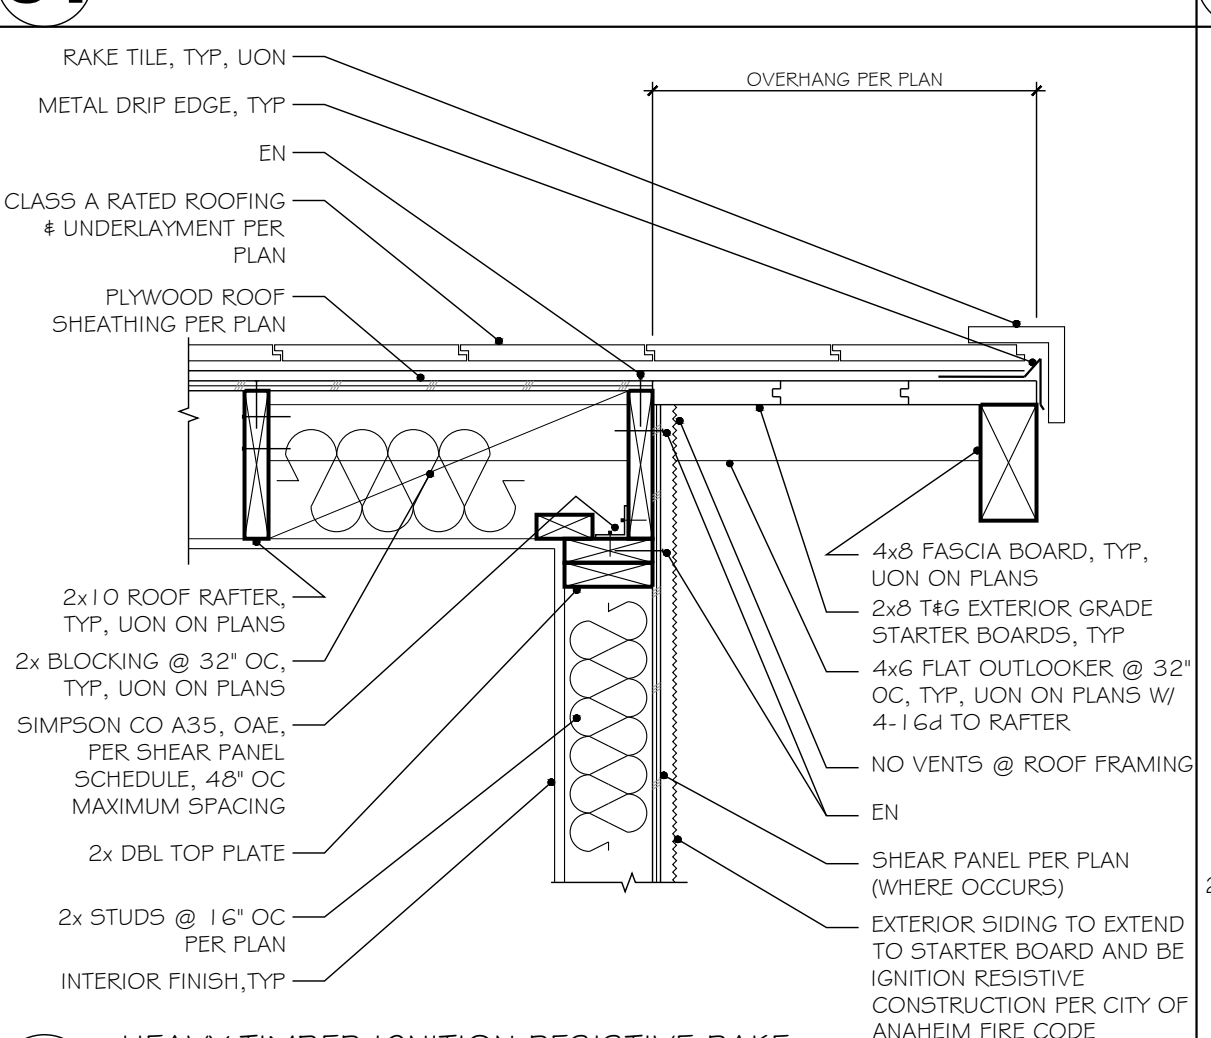

52 HEAVY TIMBER IGNITION RESISTIVE RAKE
SCALE: 1" = 1'-0" (SD CO PD5-198, SHEET 7, DETAIL #4)

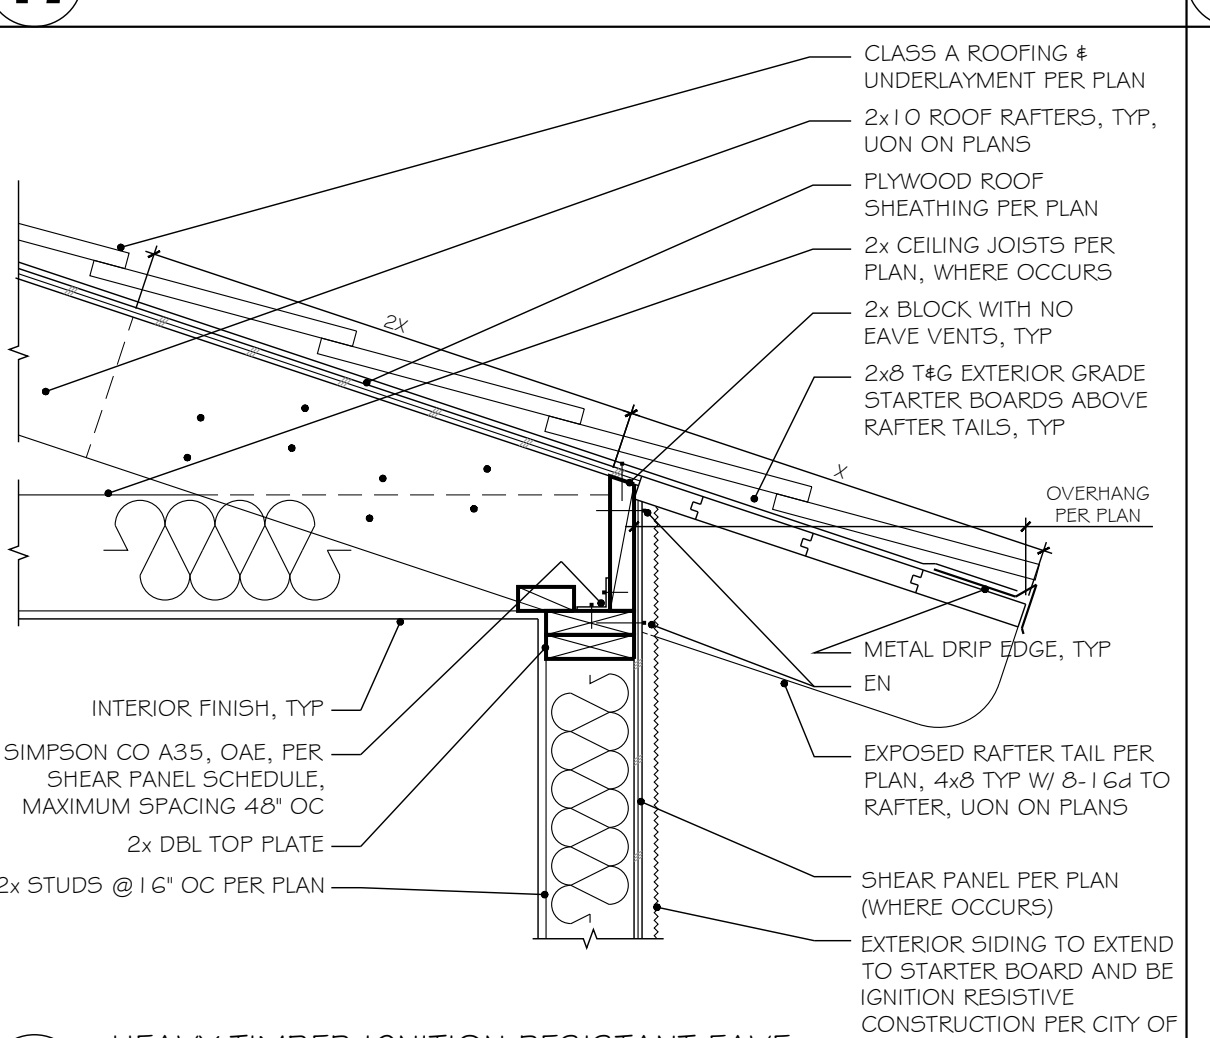

48 HEAVY TIMBER IGNITION RESISTANT EAVE
SCALE: 1" = 1'-0"

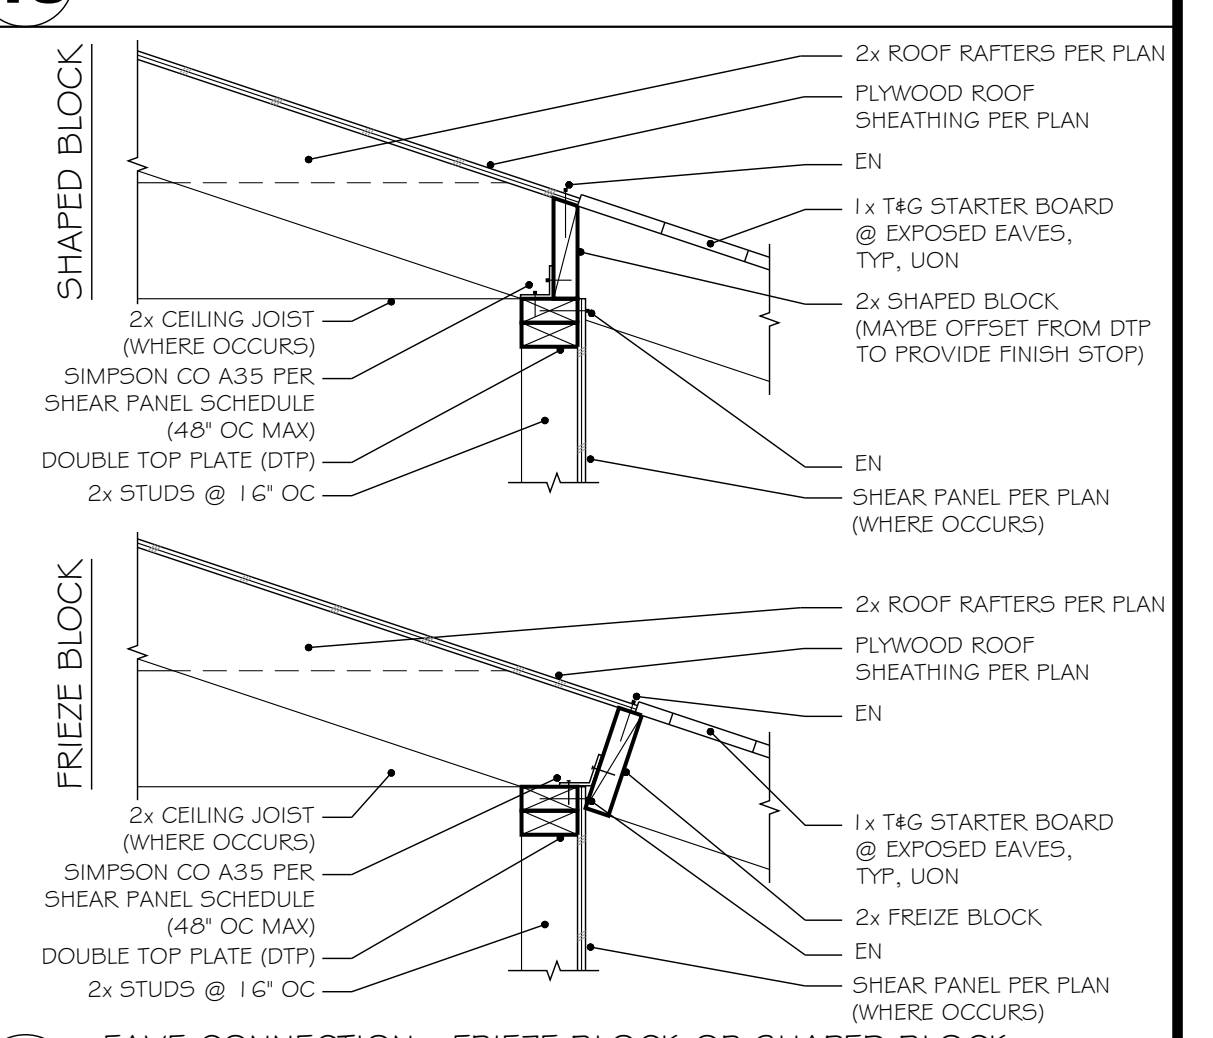

44 EAVE CONNECTION - FRIEZE BLOCK OR SHAPED BLOCK
SCALE: 1" = 1'-0"

PREPARER SIGNATURE
FOR CITY STAMPS

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM


ANAHEIM PRADU

CITY: ANAHEIM


JOB: 202409R

DETAILS


d0.2

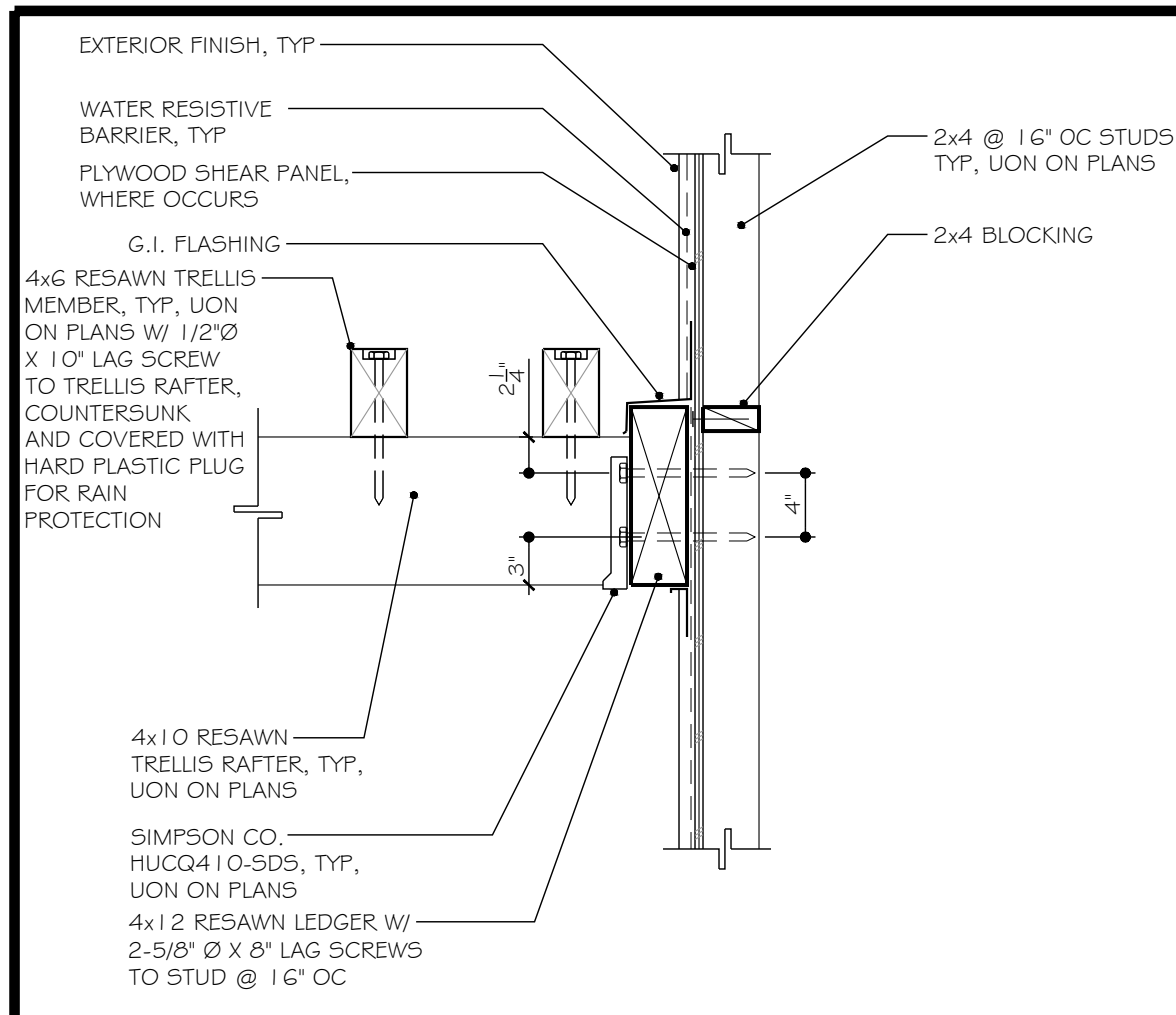


77 TRELLIS LEDGER AT WALL SCALE: 1" = 1'-0" A-DT-FMG-RF-TRL-055

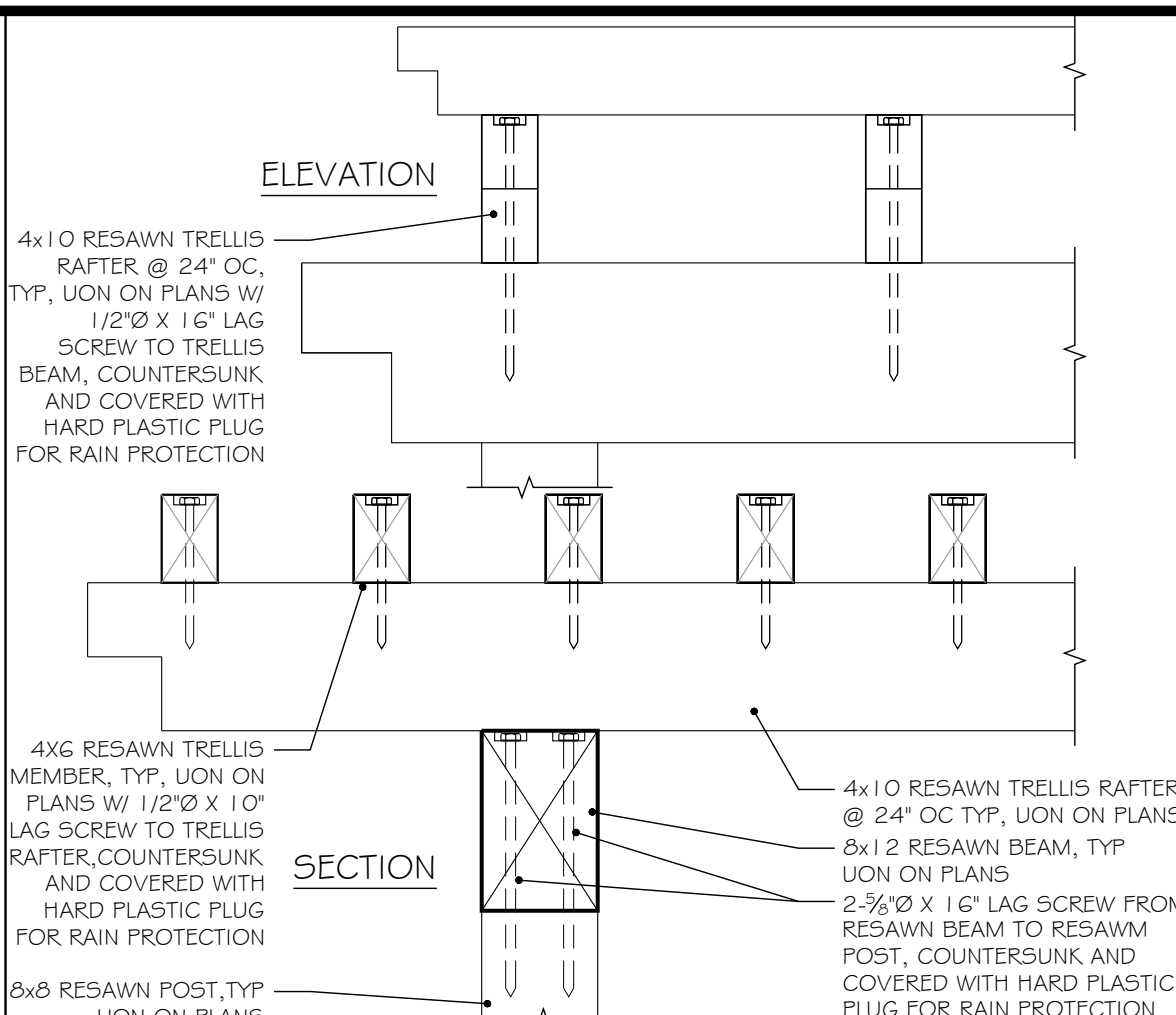


73 POST/BEAM/RAFTER/TRELLIS CONNECTIONS SCALE: 1" = 1'-0" A-DT-FMG-RF-TRL-054

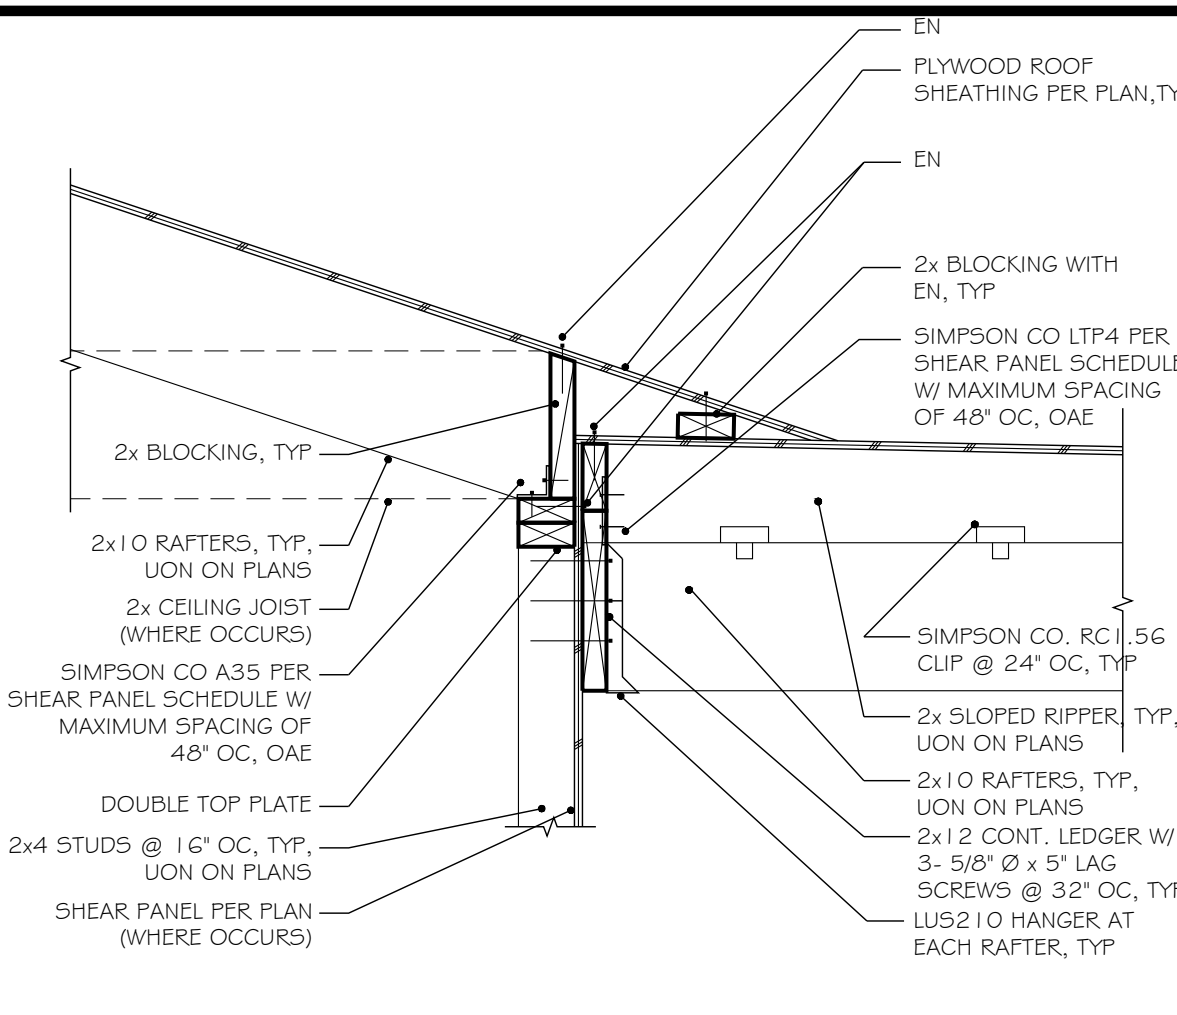


69 SLOPED TO LOW SLOPE ROOF TRANSITION SCALE: 1" = 1'-0" A-DT-FMG-RF-0332

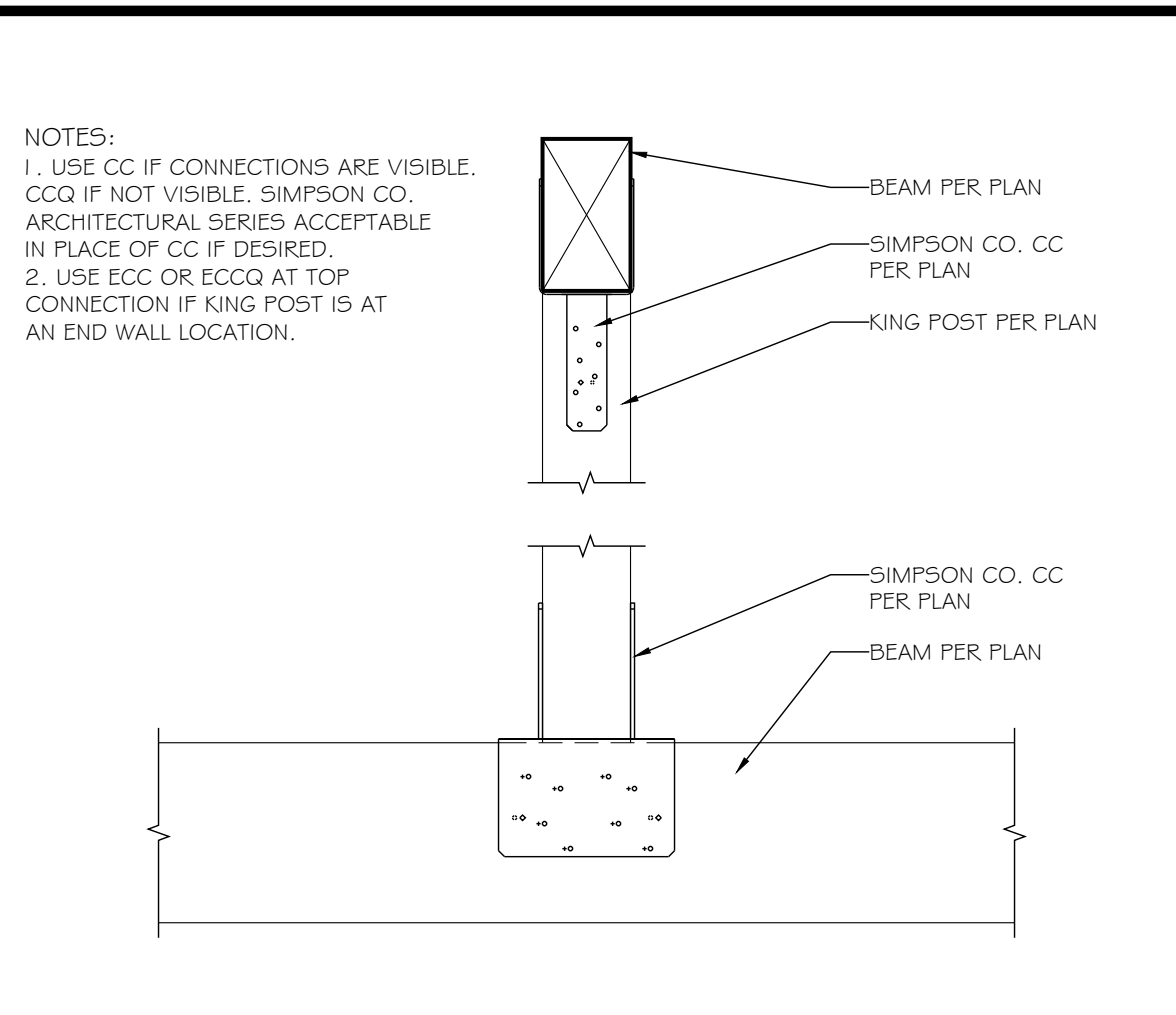


65 KING POST SCALE: 1" = 1'-0" A-DT-FMG-PB-0006

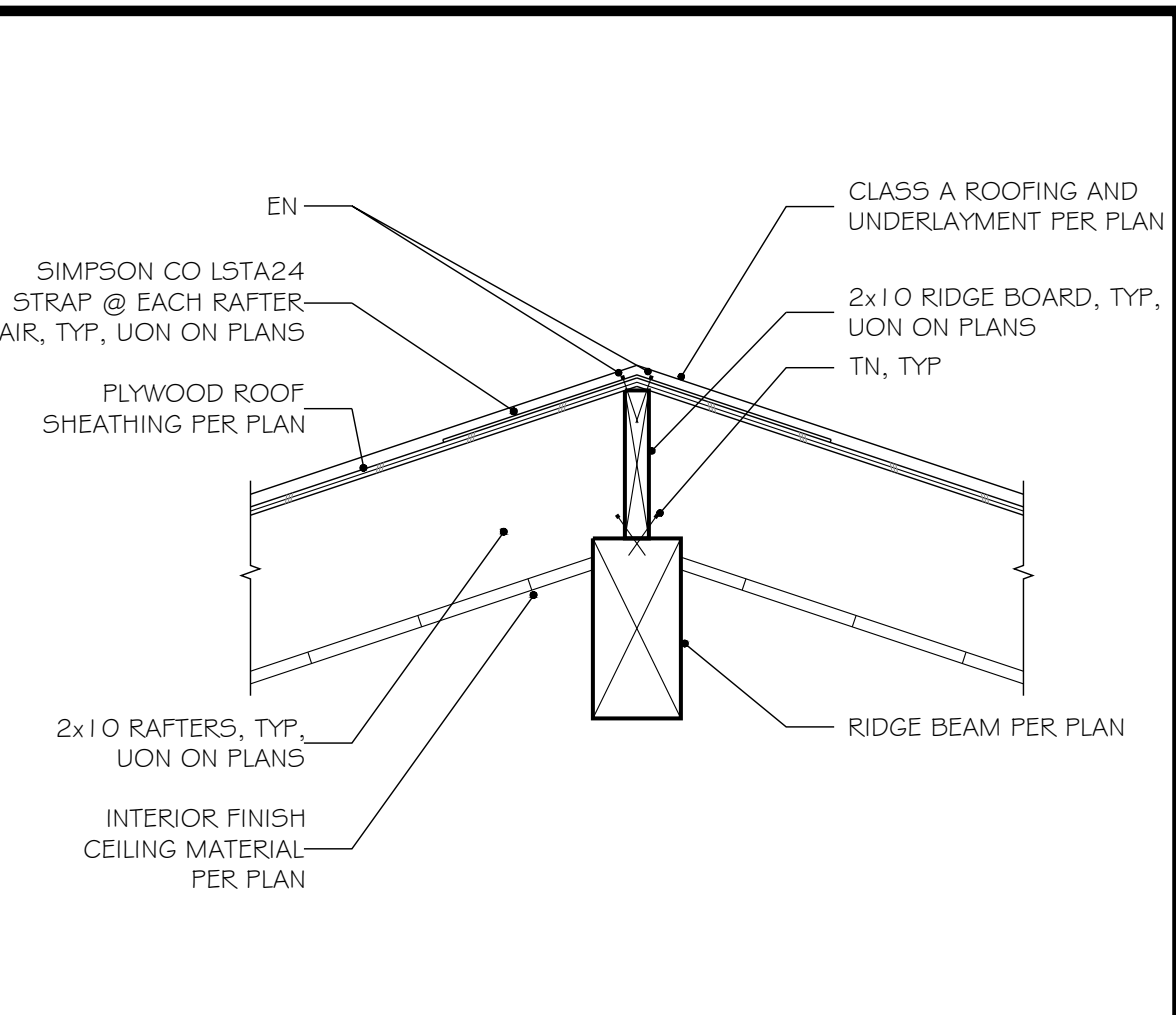


61 RAFTERS AT RIDGE BOARD OVER RIDGE BEAM SCALE: 1" = 1'-0" A-DT-FMG-RF-RDG-003

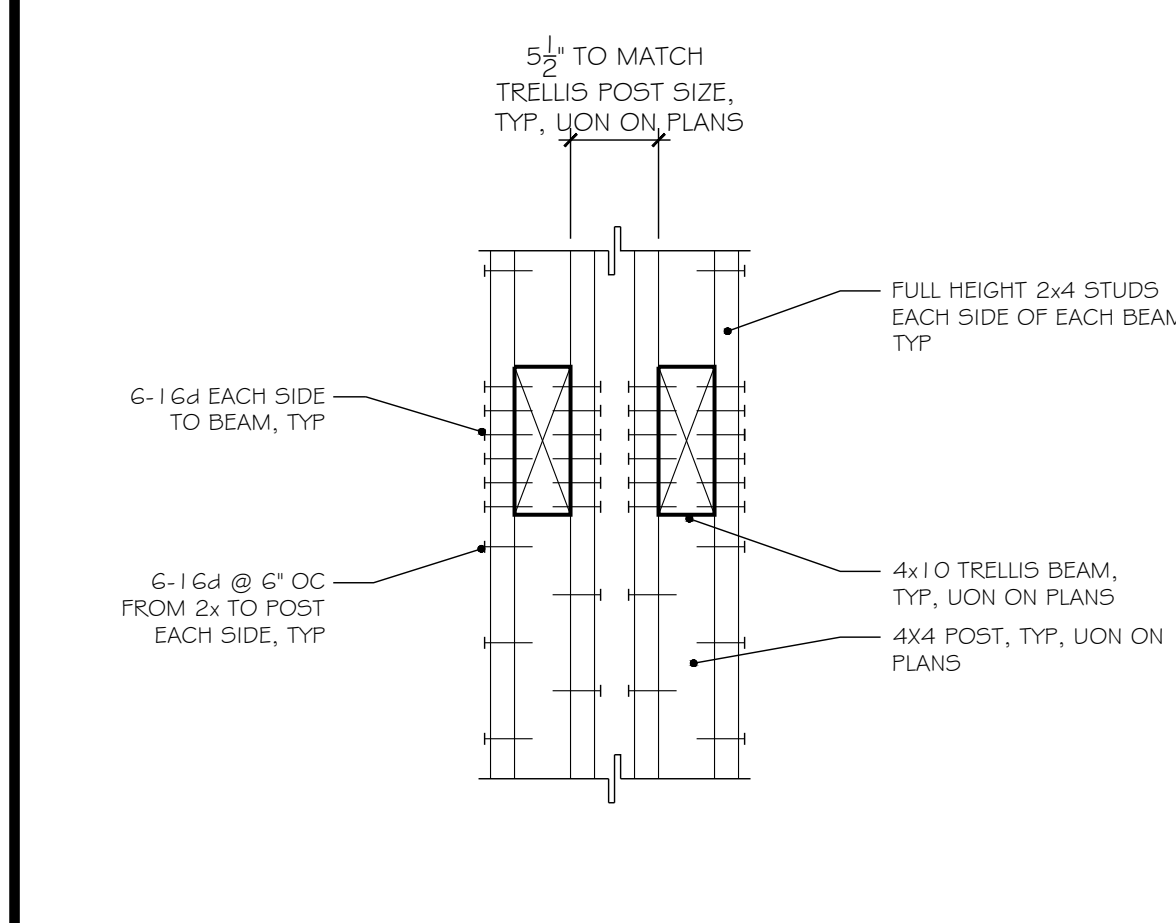


78 TRELLIS BEAMS TO STUD WALL SCALE: 1" = 1'-0" A-DT-FMG-PB-0034

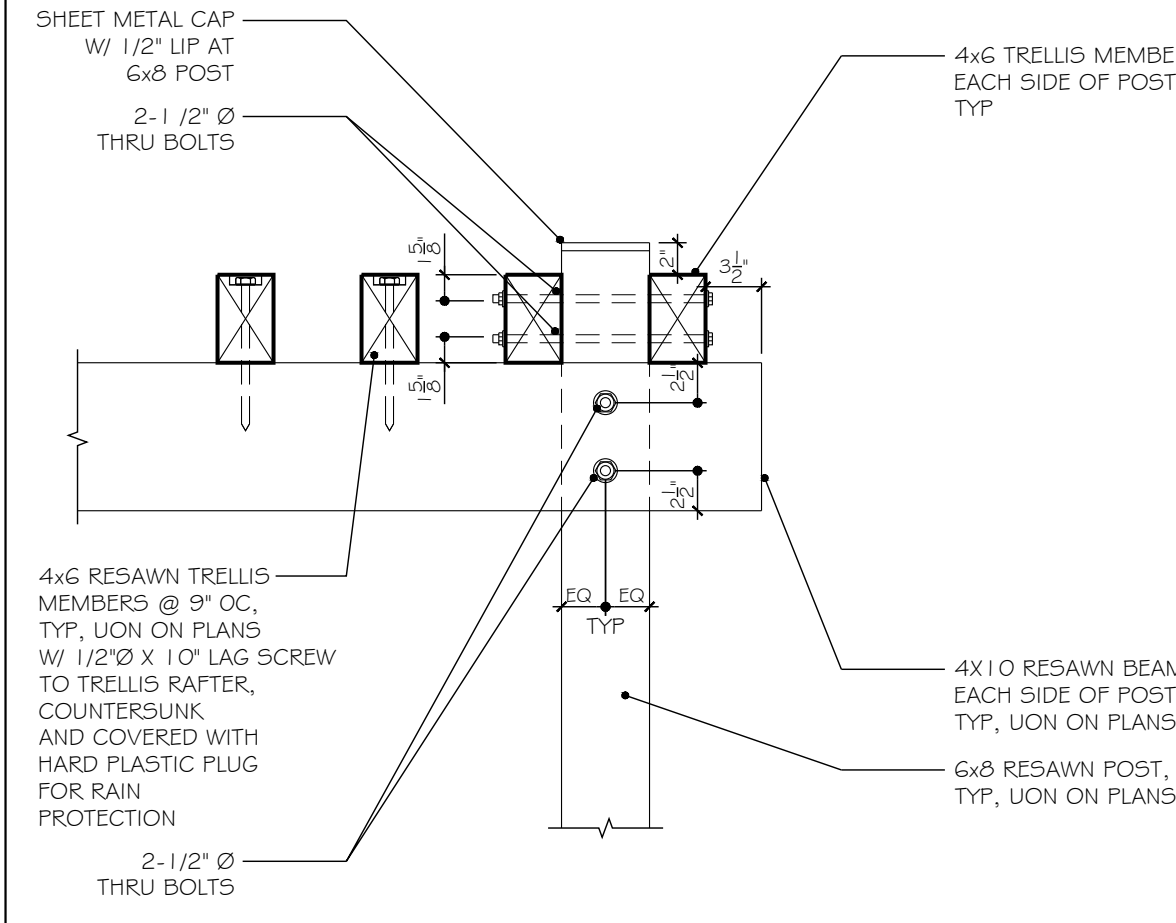


74 TRELLIS AT POST SCALE: 1" = 1'-0" A-DT-FMG-PB-0136

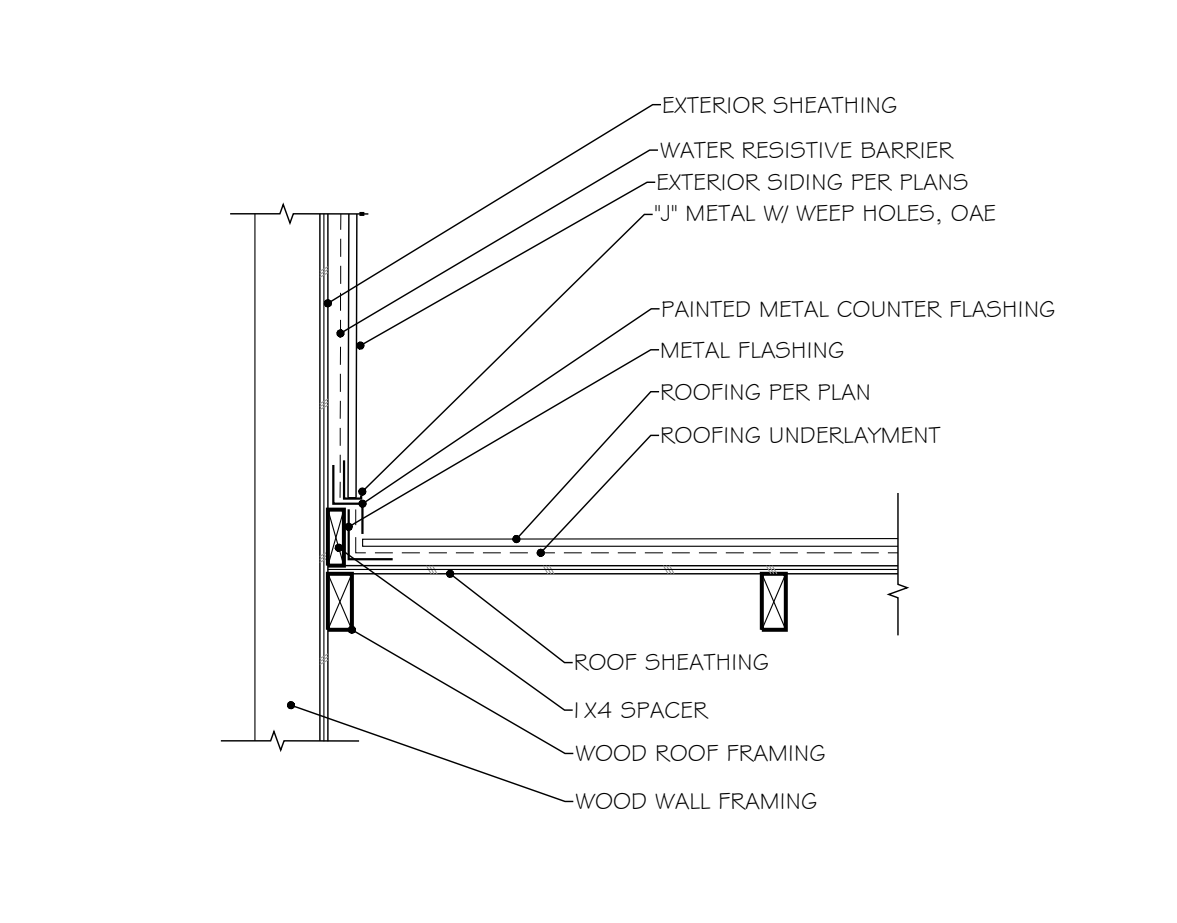


70 ROOF TO WALL - FIBER CEMENT LAP SIDING SCALE: 1" = 1'-0" A-DT-FIN-WP-0004

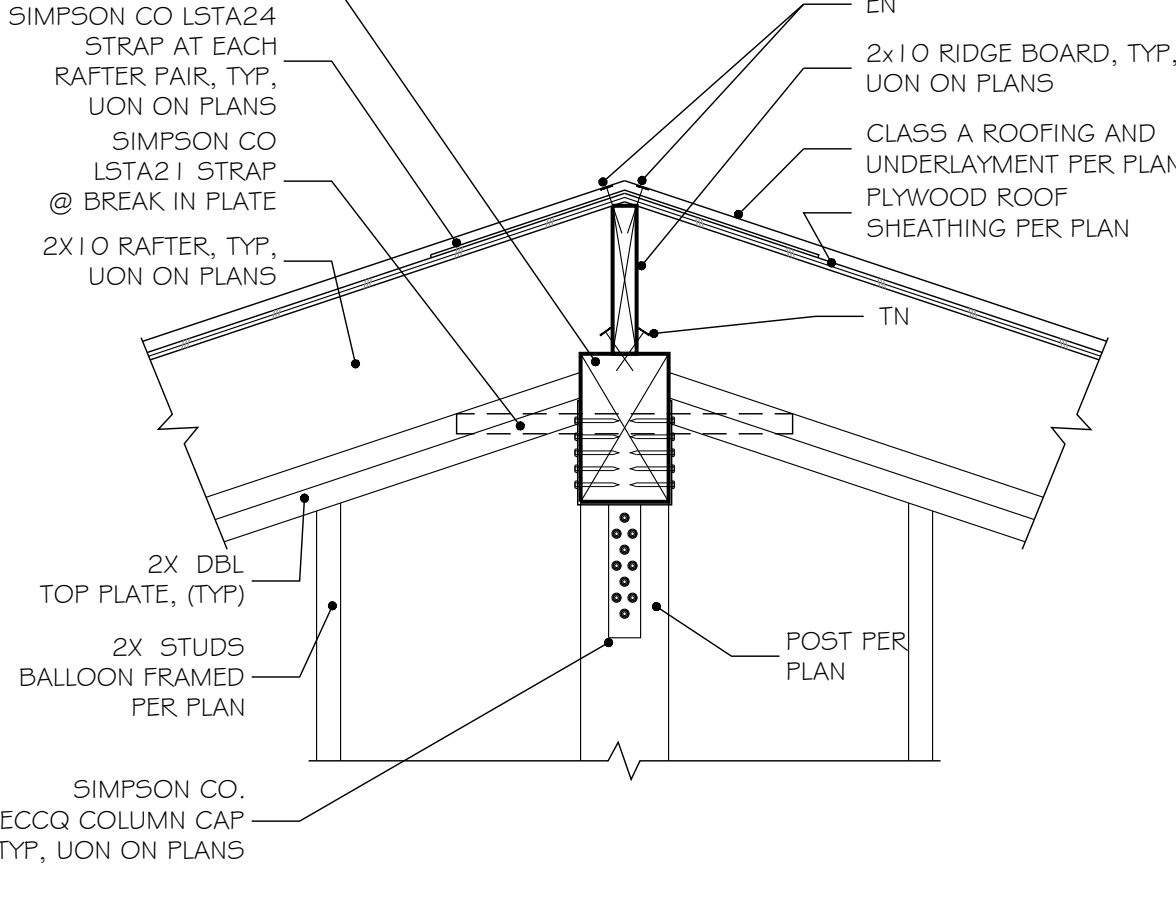


66 RIDGE BOARD & BEAM AT WALL POST W/ HARDWARE SCALE: 1" = 1'-0" A-DT-FMG-RF-RDG-023

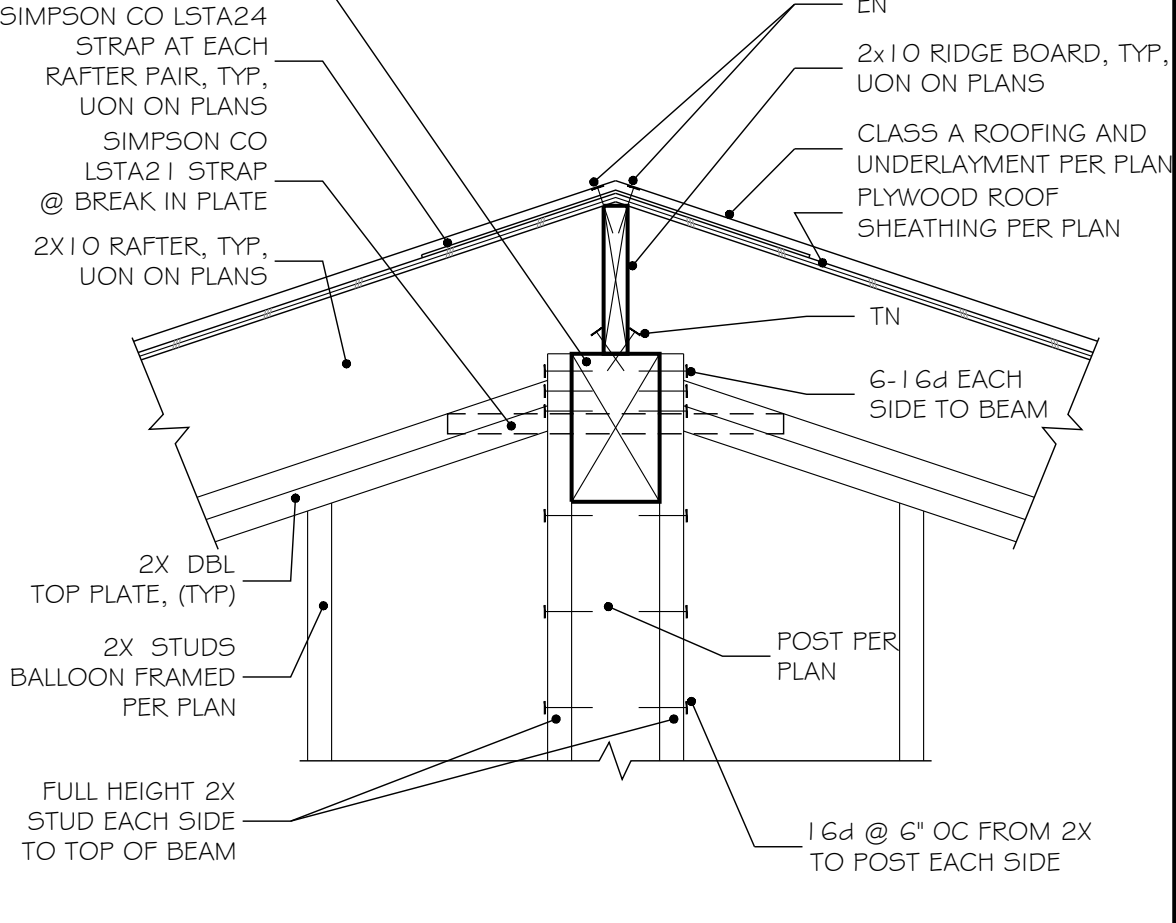


62 RIDGE BOARD & BEAM AT WALL POST W/O HARDWARE SCALE: 1" = 1'-0" A-DT-FMG-RF-RDG-005B

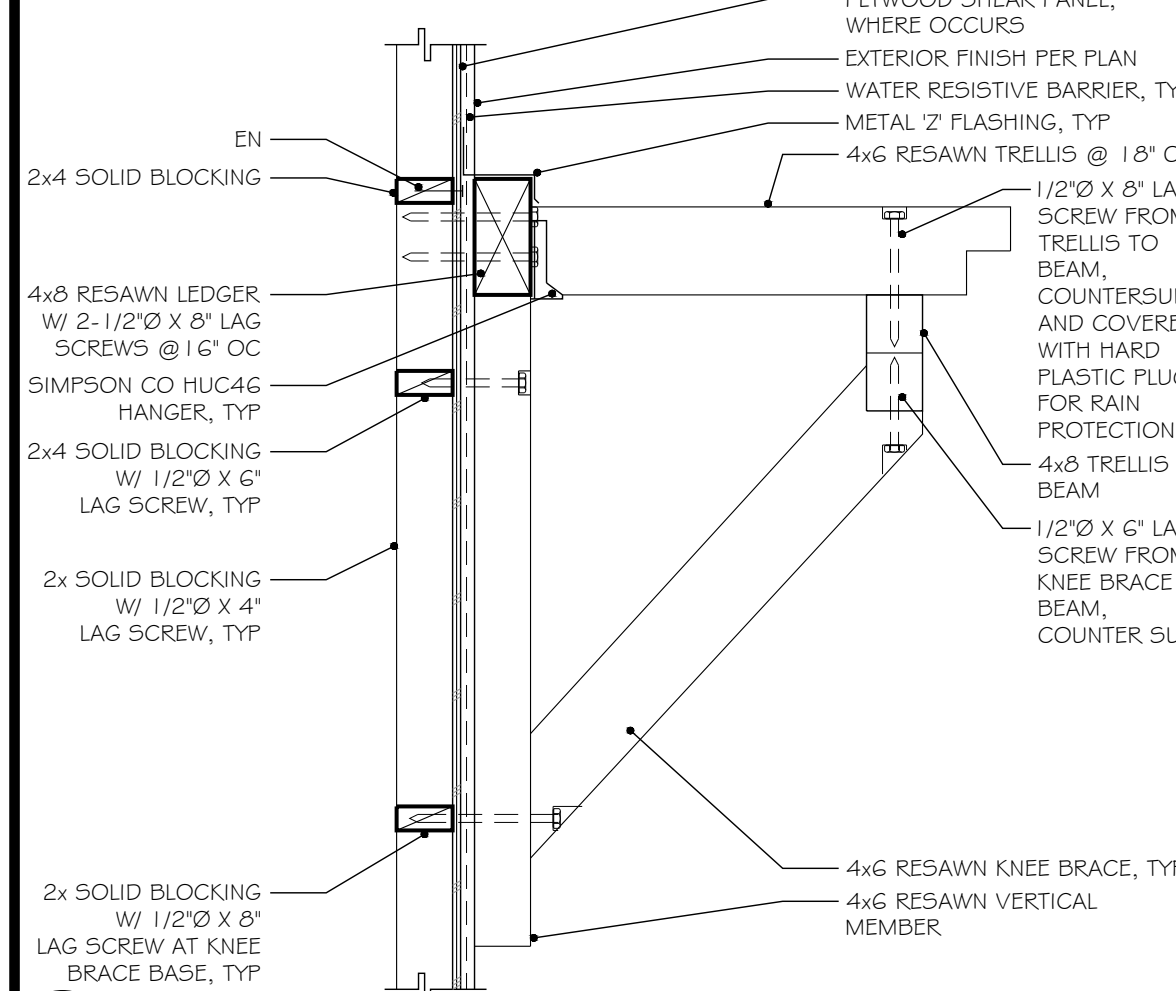


79 KNEE BRACE TRELLIS OPENING CAP SCALE: 1" = 1'-0" A-DT-FMG-RF-0321

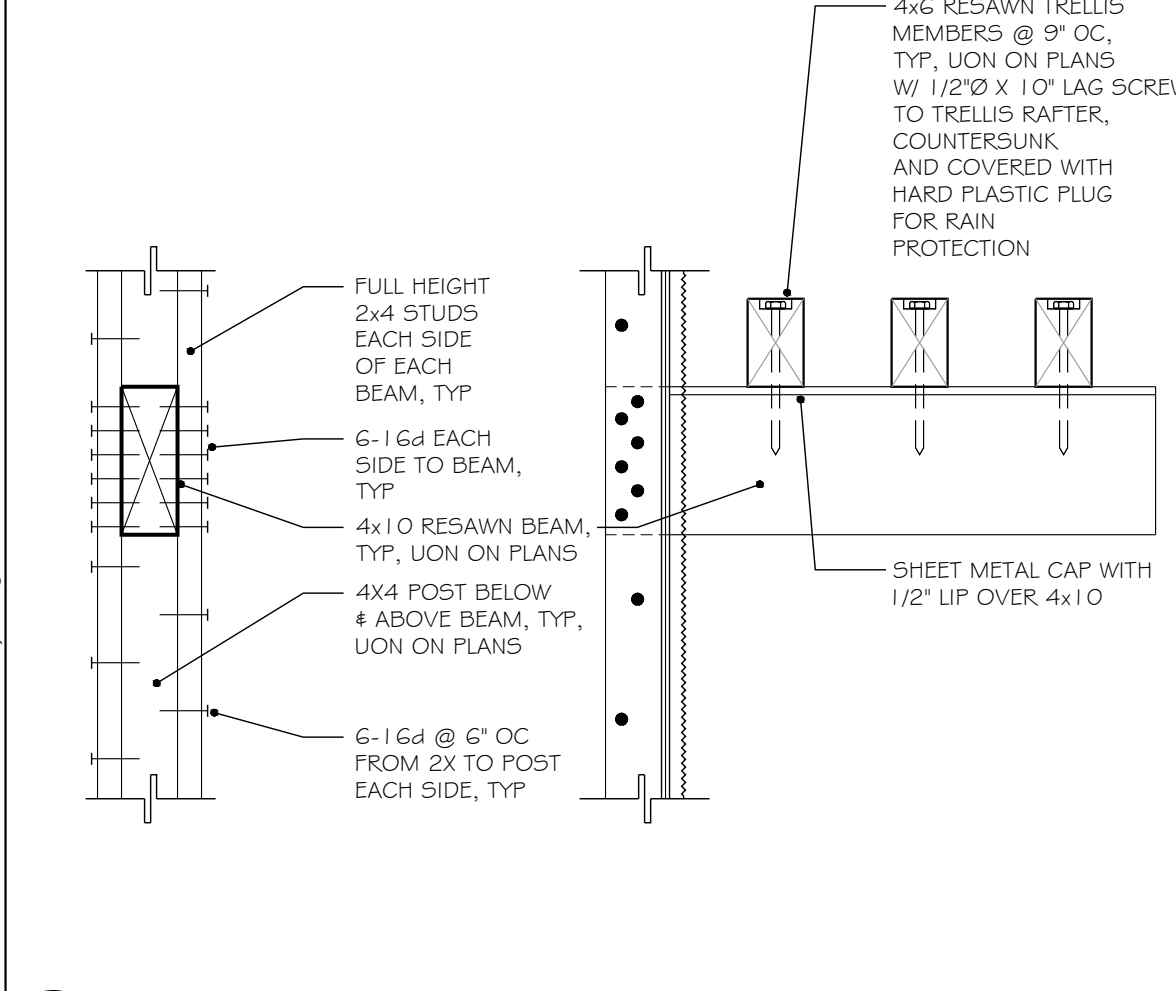


75 CANTILEVER TRELLIS OPENING CAP SCALE: 1" = 1'-0" A-DT-FMG-PB-0137

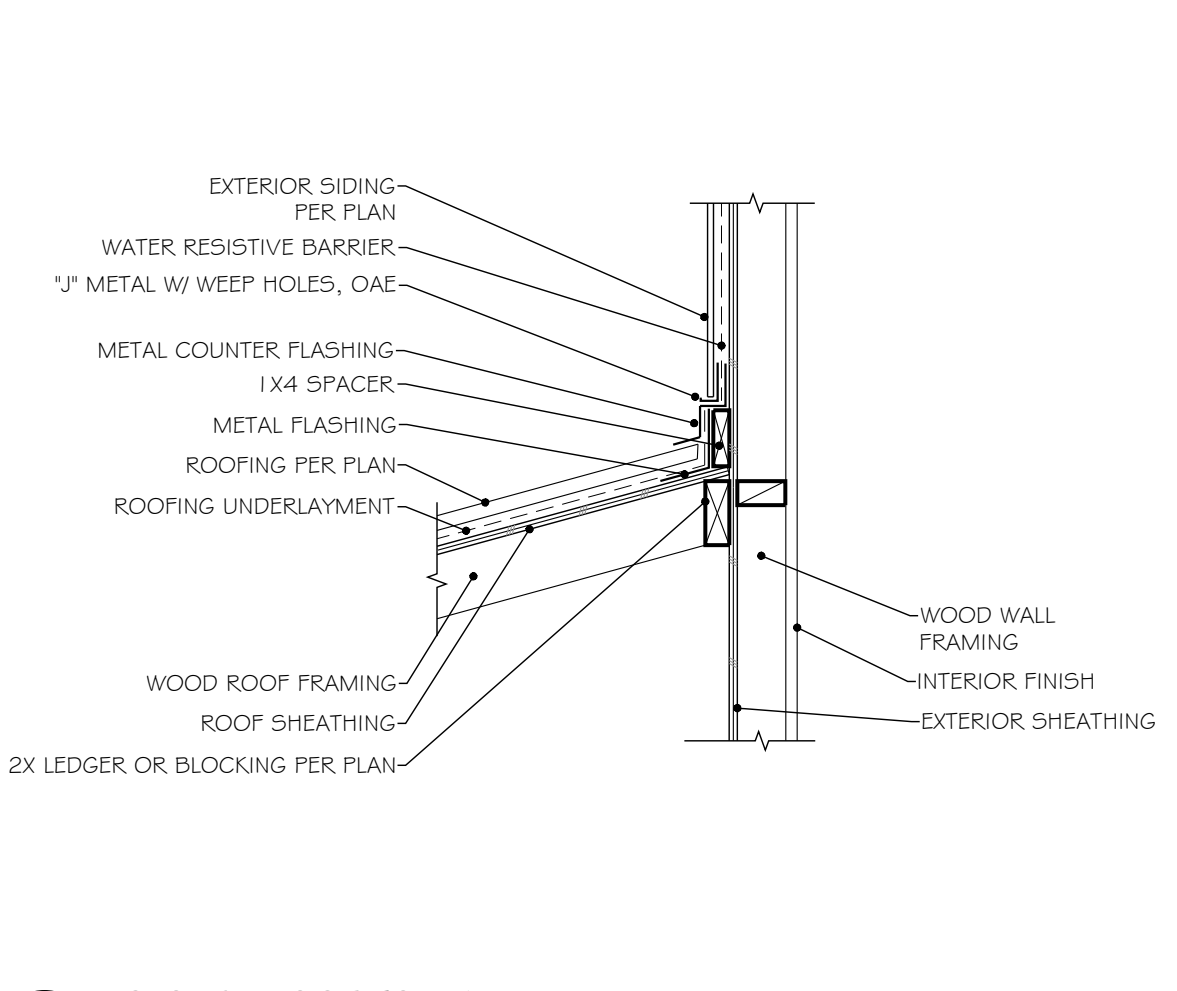


71 SLOPED ROOF TO WALL SCALE: 1" = 1'-0" A-DT-FIN-WP-0003

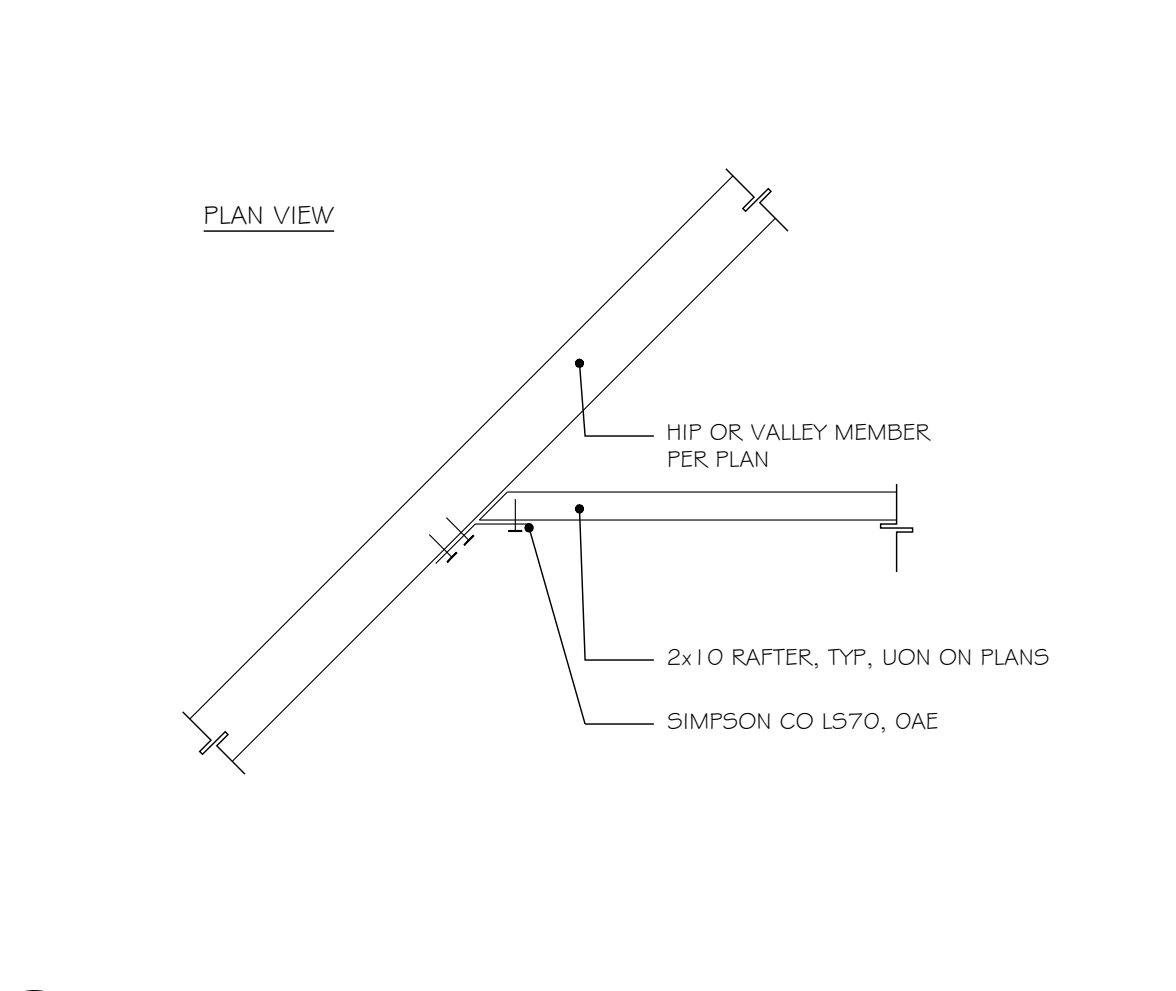


67 RAFTER TO HIP OR VALLEY SCALE: 1" = 1'-0" A-DT-FMG-RF-0328

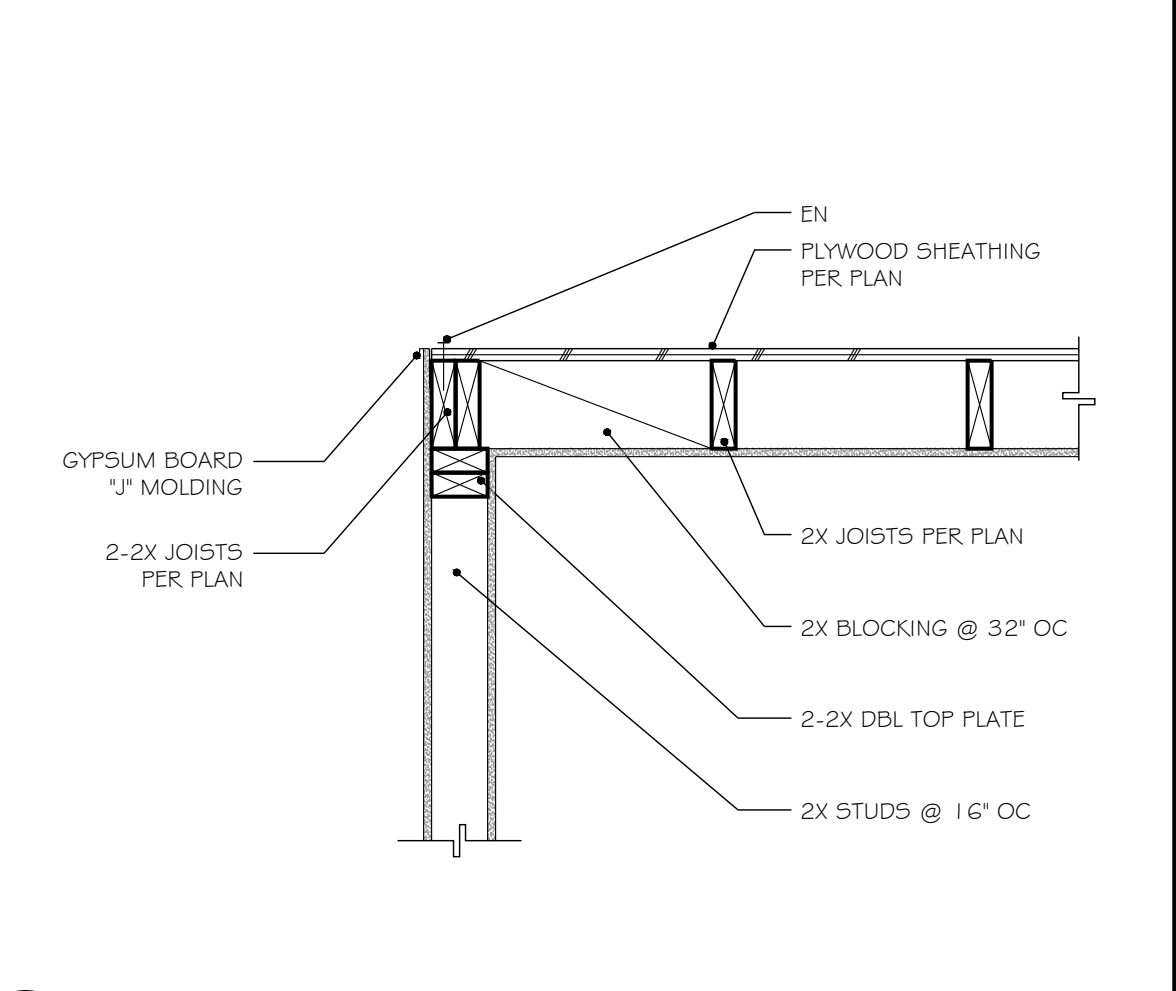


63 PARALLEL JOISTS AT EDGE WITH WALL SCALE: 1" = 1'-0" A-DT-FMG-RF-0132

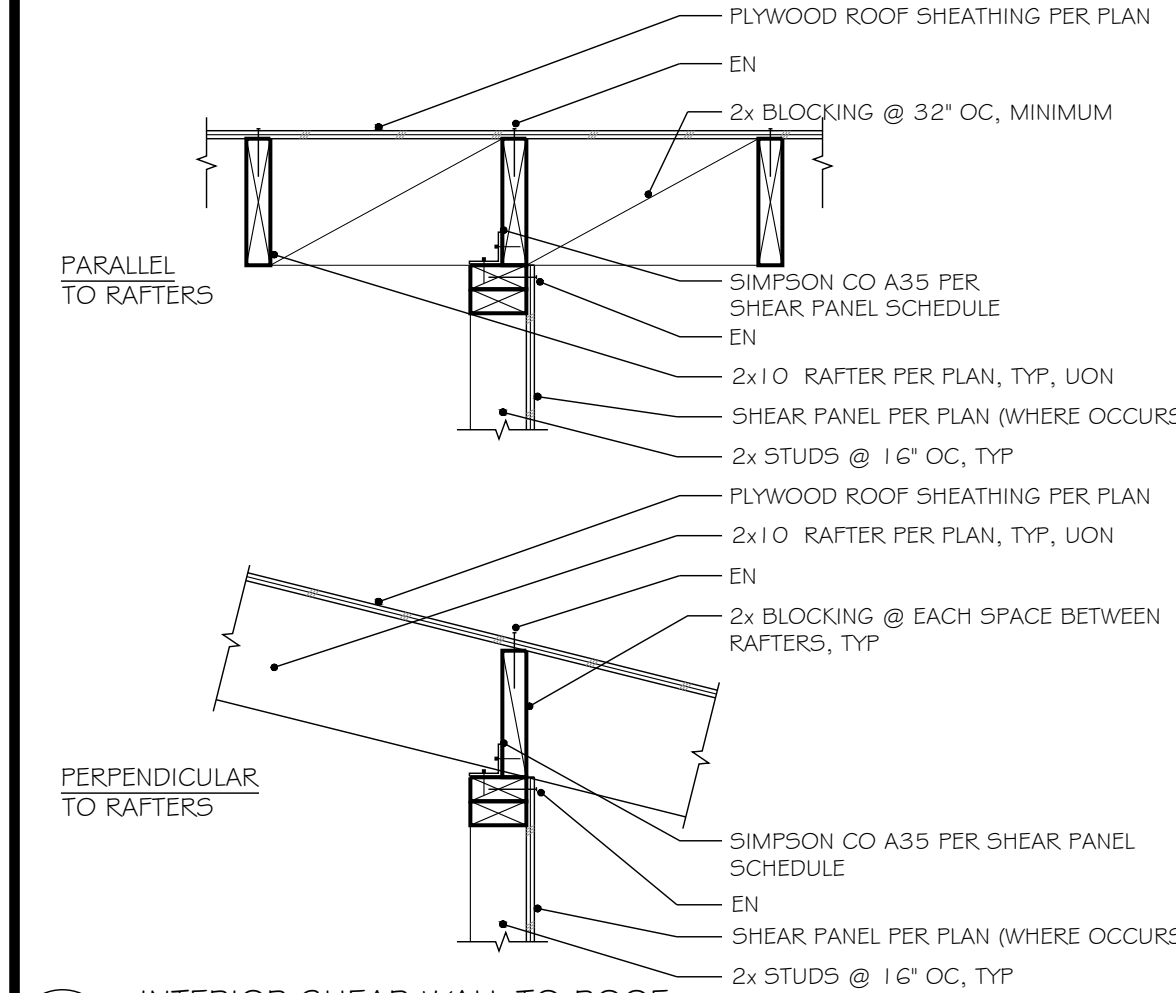


80 INTERIOR SHEAR WALL TO ROOF SCALE: 1" = 1'-0" A-DT-FMG-RF-WAL-039

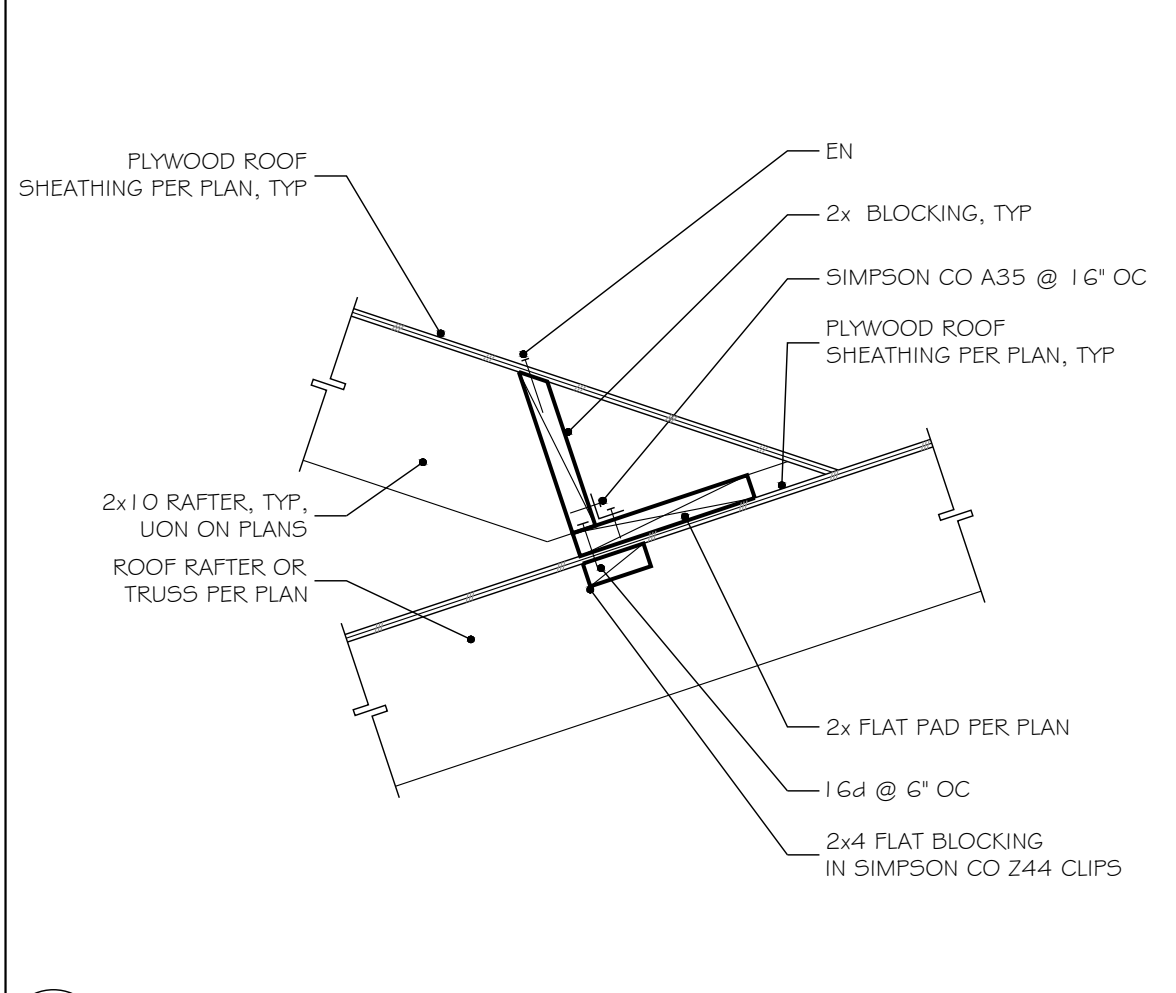


76 CALIFORNIA ROOF FILL CONNECTION SCALE: 1" = 1'-0" A-DT-FMG-RF-0163

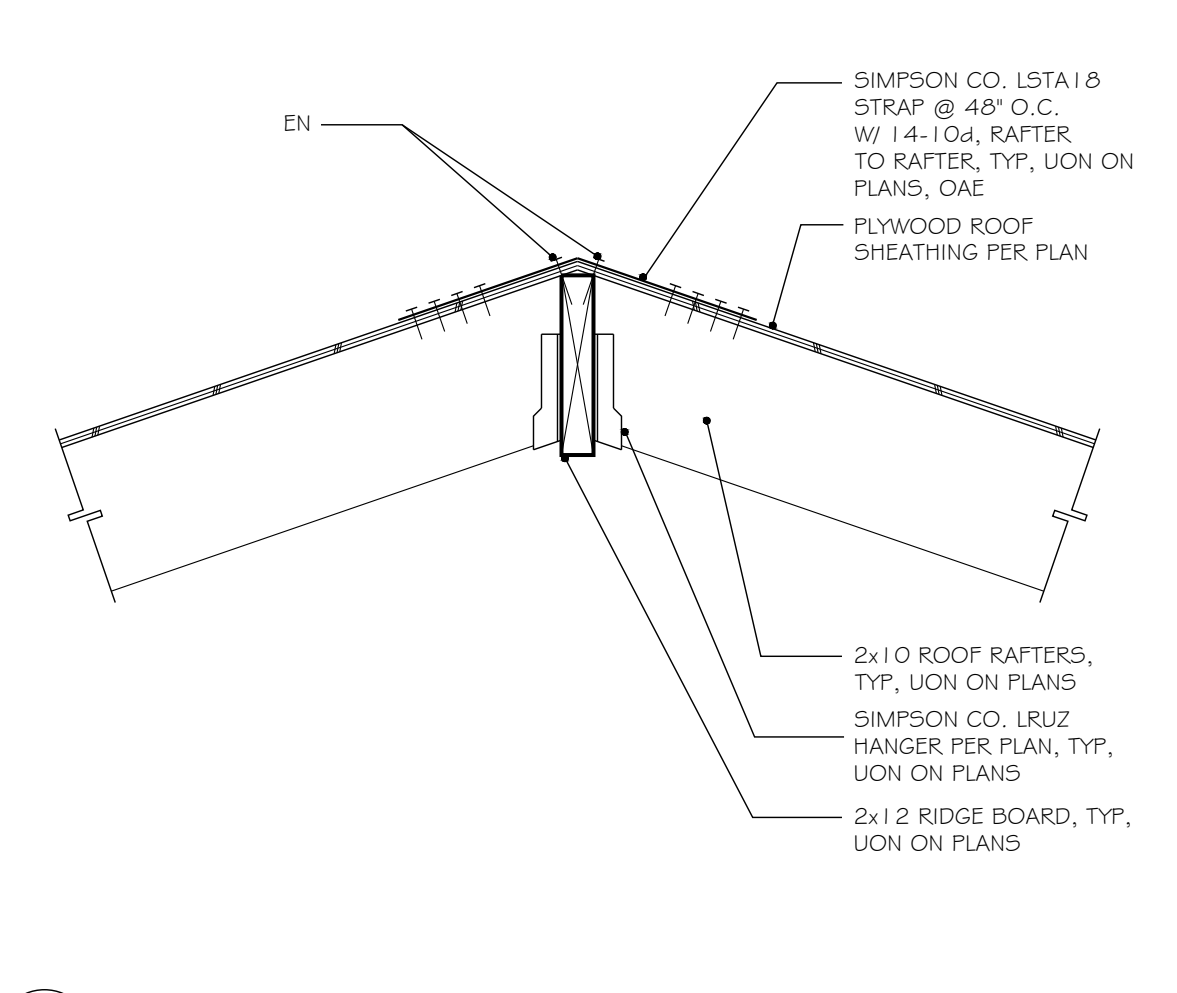

72 RIDGE BOARD DETAIL SCALE: 1" = 1'-0" A-DT-FMG-RF-0074

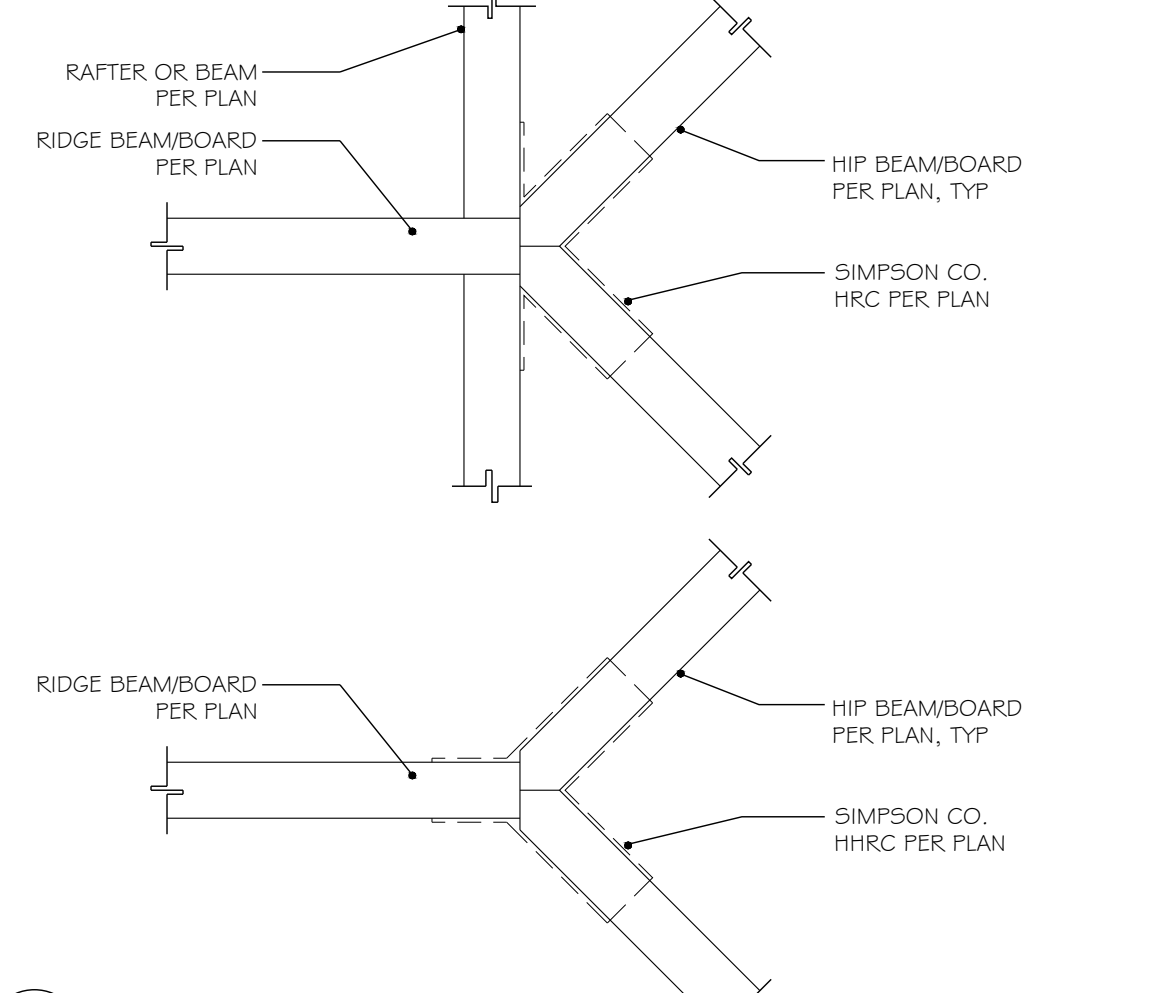

68 HIP/RIDGE DETAIL SCALE: 1" = 1'-0" A-DT-FMG-RF-0017

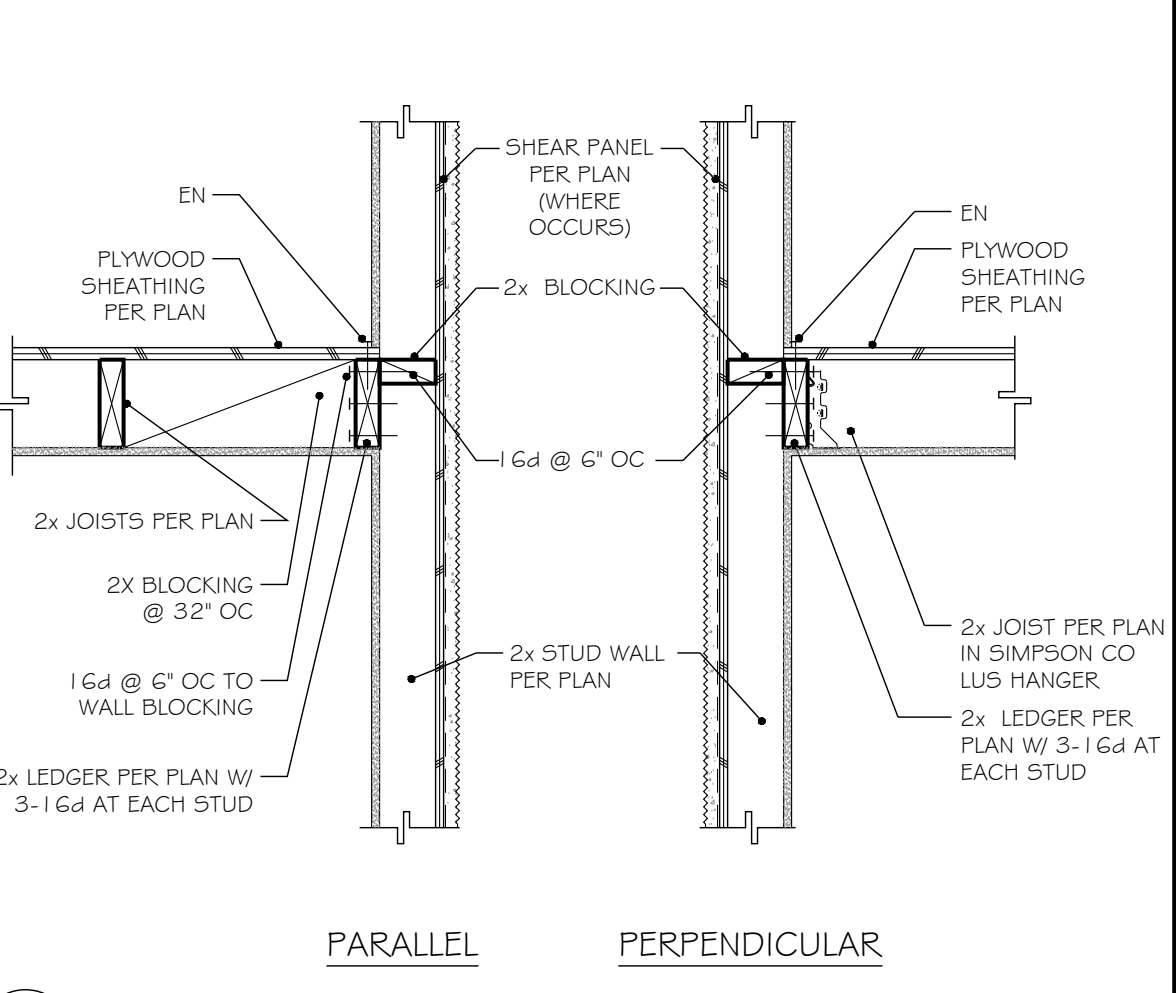

64 JOISTS TO LEDGER AT WALL SCALE: 1" = 1'-0" A-DT-FMG-RF-0153

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS 682 SECOND ST ENCINITAS, CA (760) 7532464 DZNPARTNERS.COM

ANAHEIM PRADU CITY: ANAHEIM

JOB: 202409R

DETAILS


d0.3

97

93


89

EXTERIOR ONE HOUR WALL - FIBER CEMENT SIDING EXTERIOR
SCALE: 2" = 1'-0" A-DT-FIN-FR-WAL-033

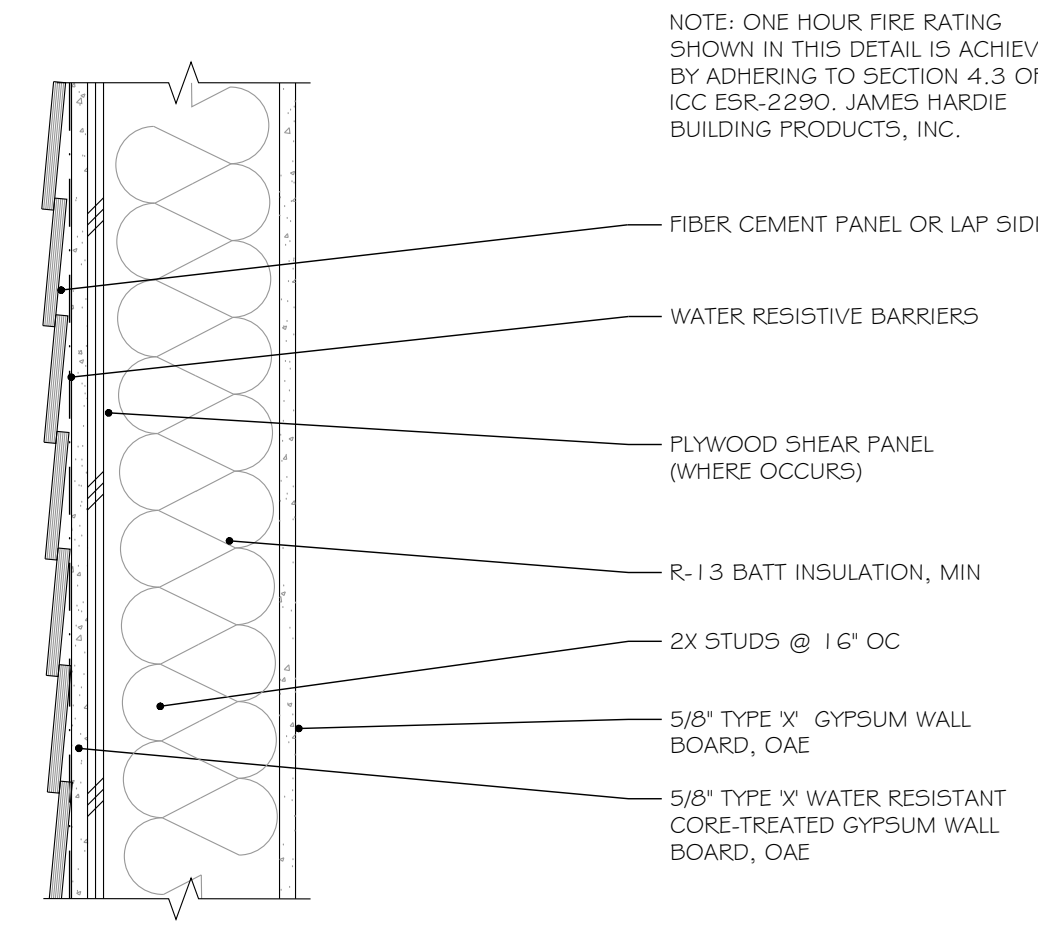


85

RIDGE BEAM INTERSECTION WITH VALLEY RAFTERS ABOVE
SCALE: 1" = 1'-0" A-DT-FMG-RF-RDG-026

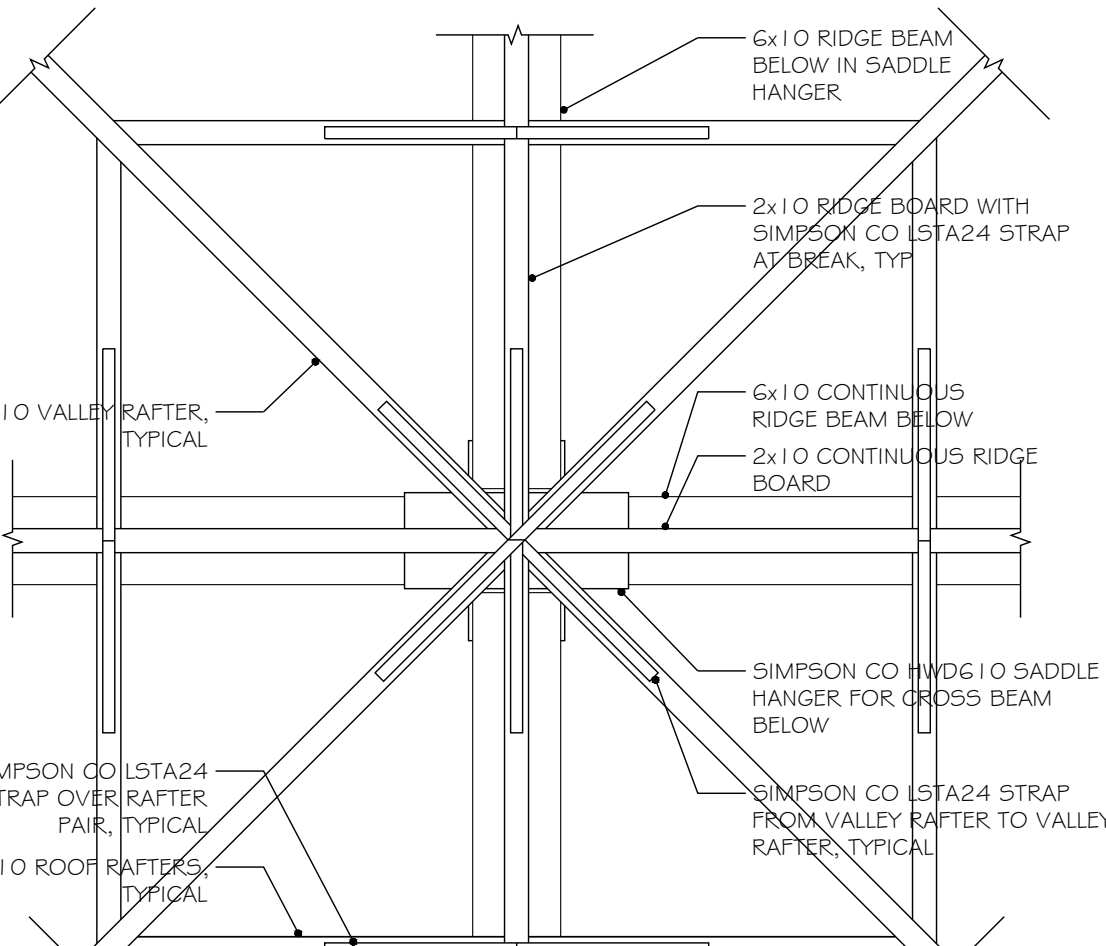

81

RAFTERS TO RIDGE BEAM
SCALE: 1" = 1'-0" A-DT-FMG-RF-RDG-024

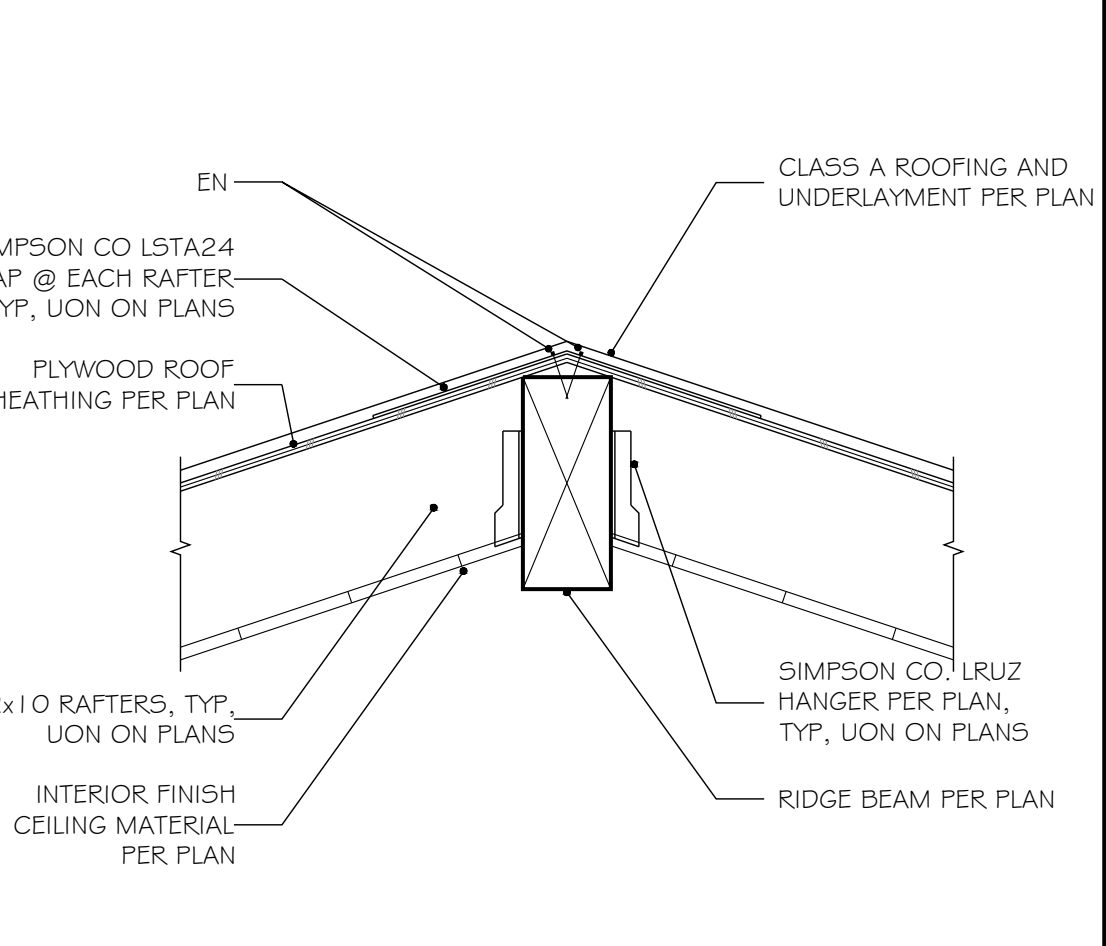


98

94


90

KING POST WITH SLOPED AND/OR SKEWED TOP BEAM
SCALE: 1" = 1'-0" A-DT-FMG-PB-0142

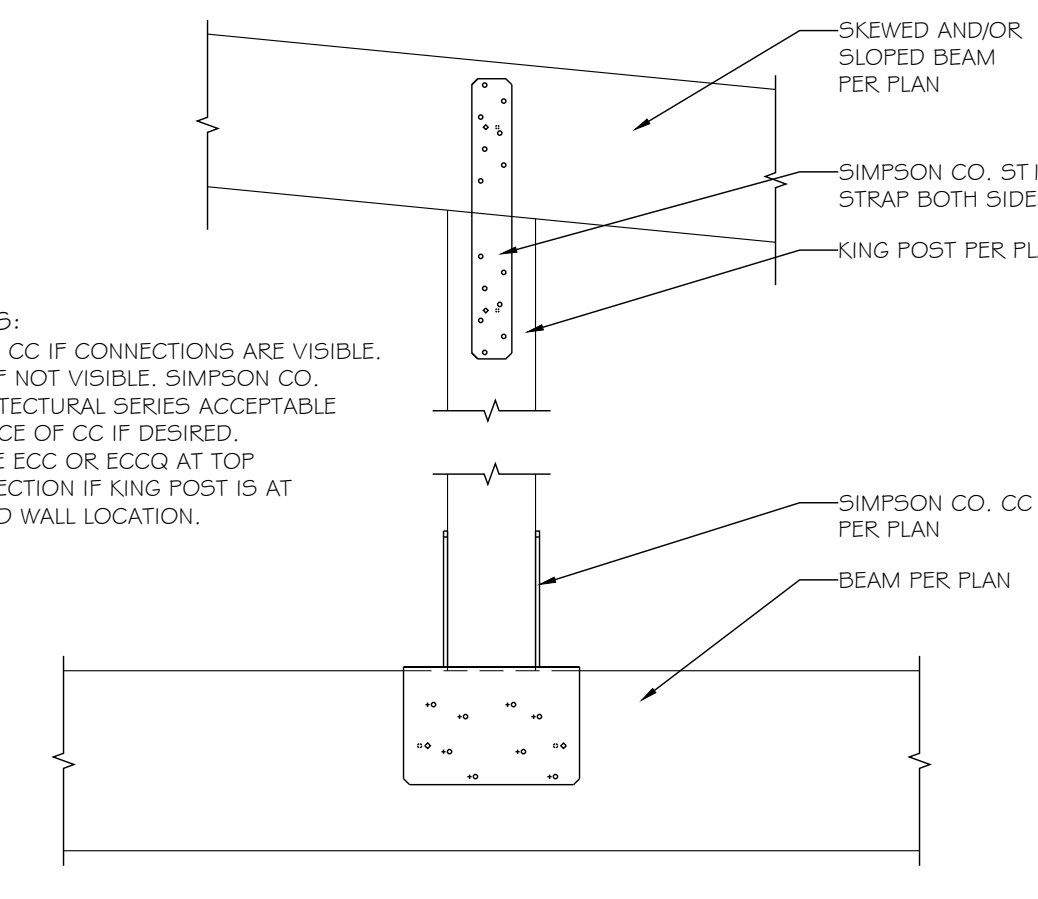


86

INSULATION AT UNVENTED ROOF ASSEMBLY - IMPERMEABLE ONLY
SCALE: 1" = 1'-0" CRC R806.5 A-DT-FMG-RF-0326

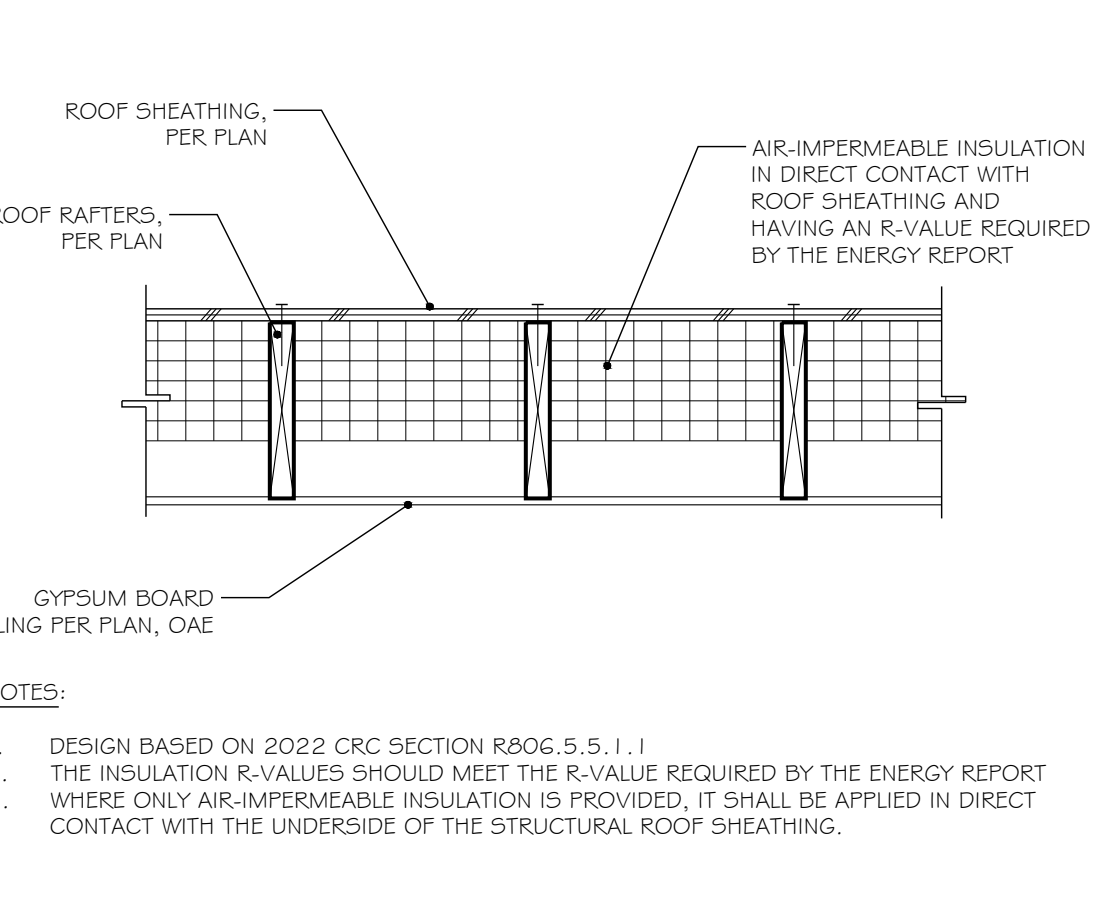

82

FIRE RESISTANCE - ONE HOUR WOOD FRAMED WALLS
SCALE: 1" = 1'-0" A-DT-FIN-FR-WAL-001

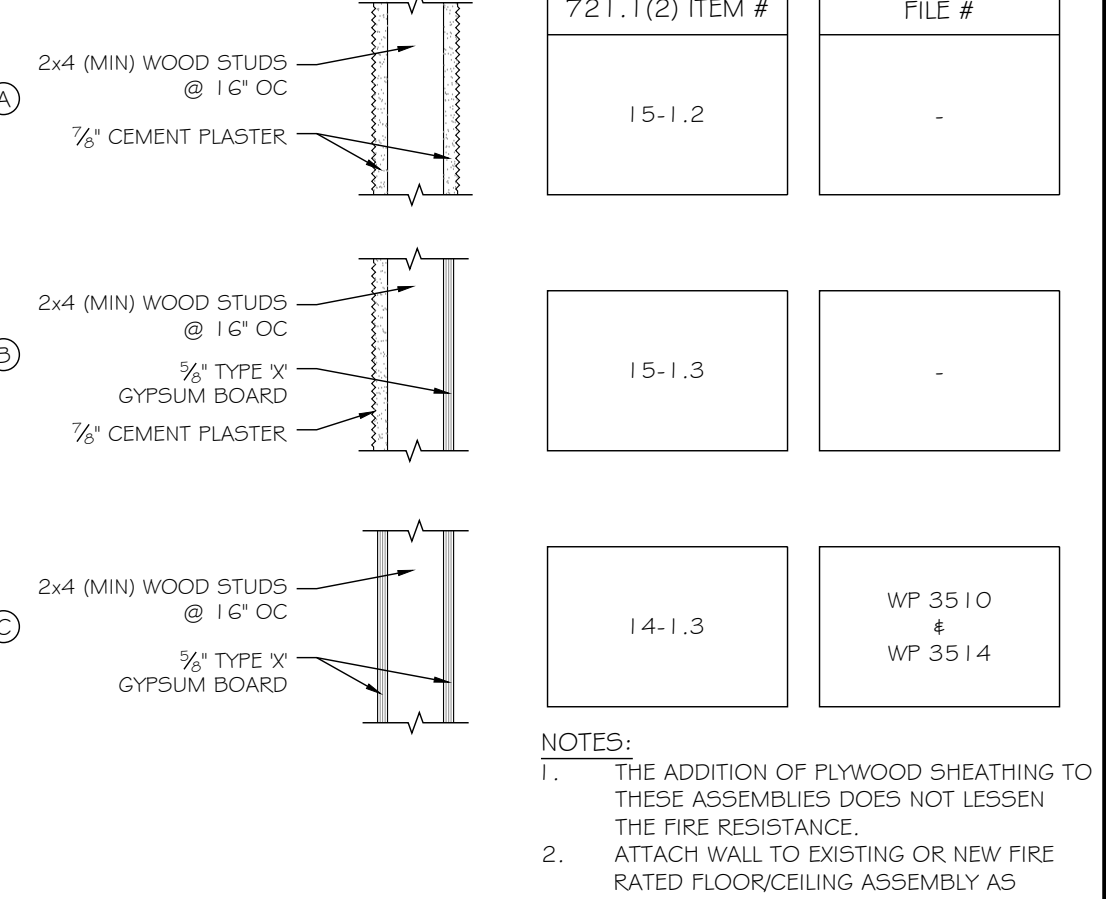


99

95


91

PERPENDICULAR JOISTS AT EDGE
SCALE: 1" = 1'-0" A-DT-FMG-FF-0154

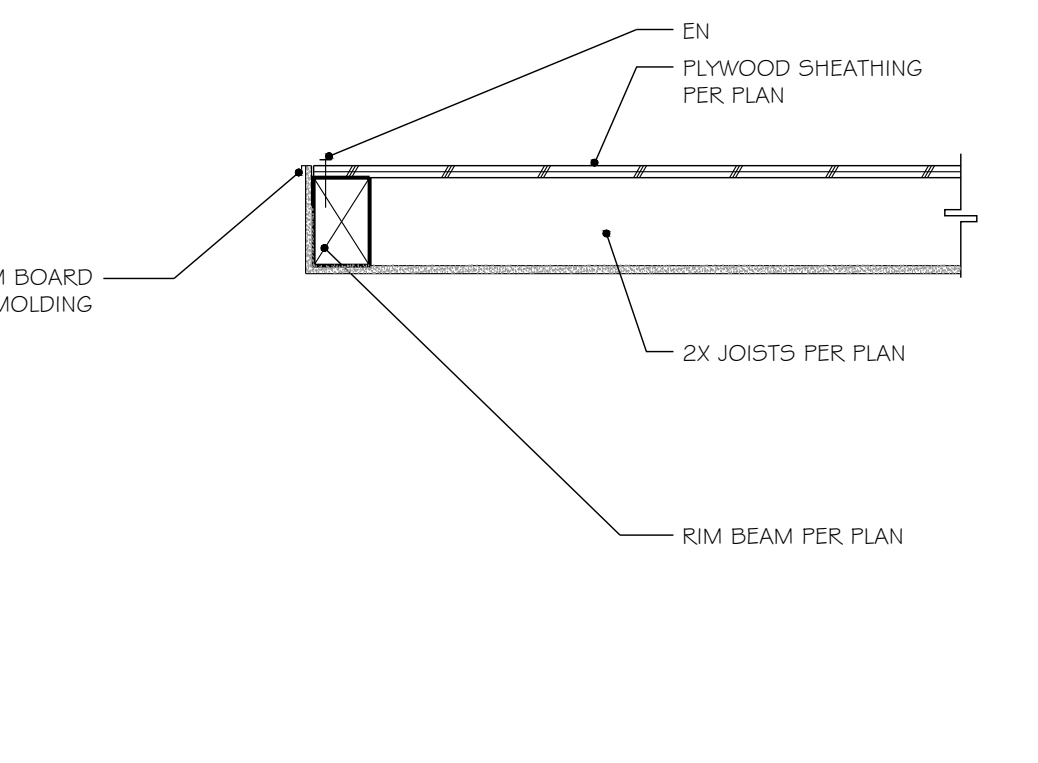


87

INSULATION AT UNVENTED ROOF ASSEMBLY - BOTH TYPES
SCALE: 1" = 1'-0" CRC R806.5 A-DT-FMG-RF-0325

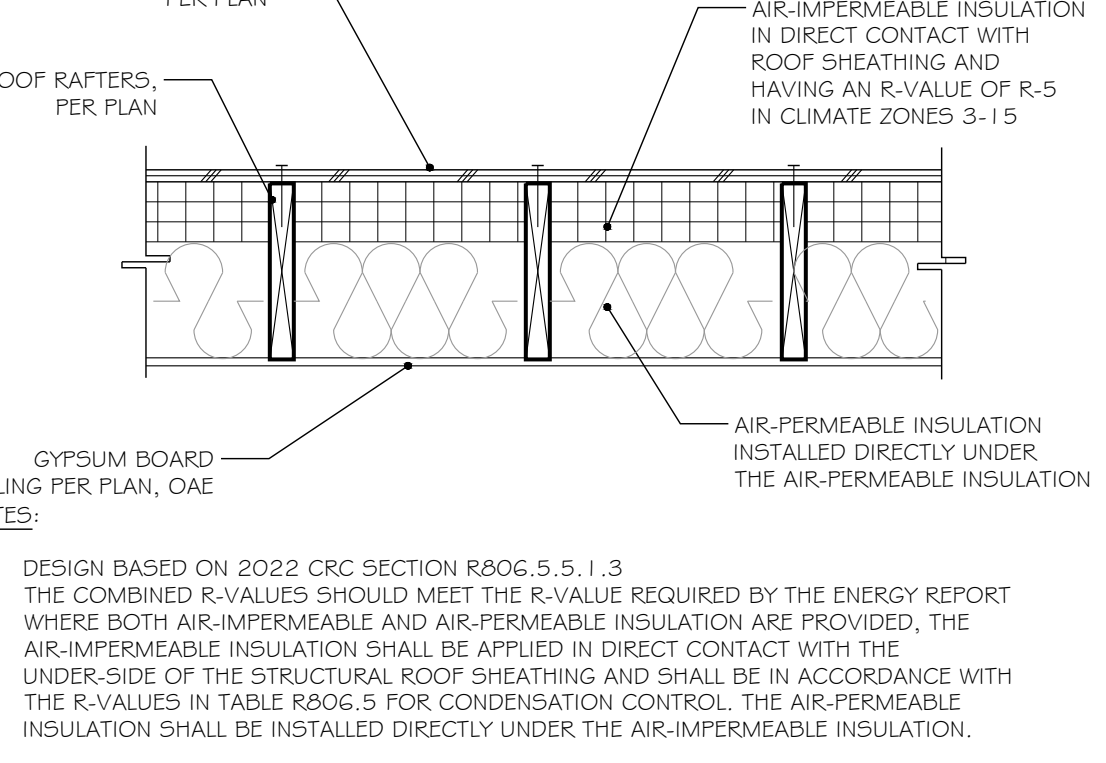

83

FIRE RESISTANCE: 1 HR EXTERIOR WALL, SOUND: STC 51
SCALE: 1" = 1'-0" A-DT-FIN-FR-WAL-025

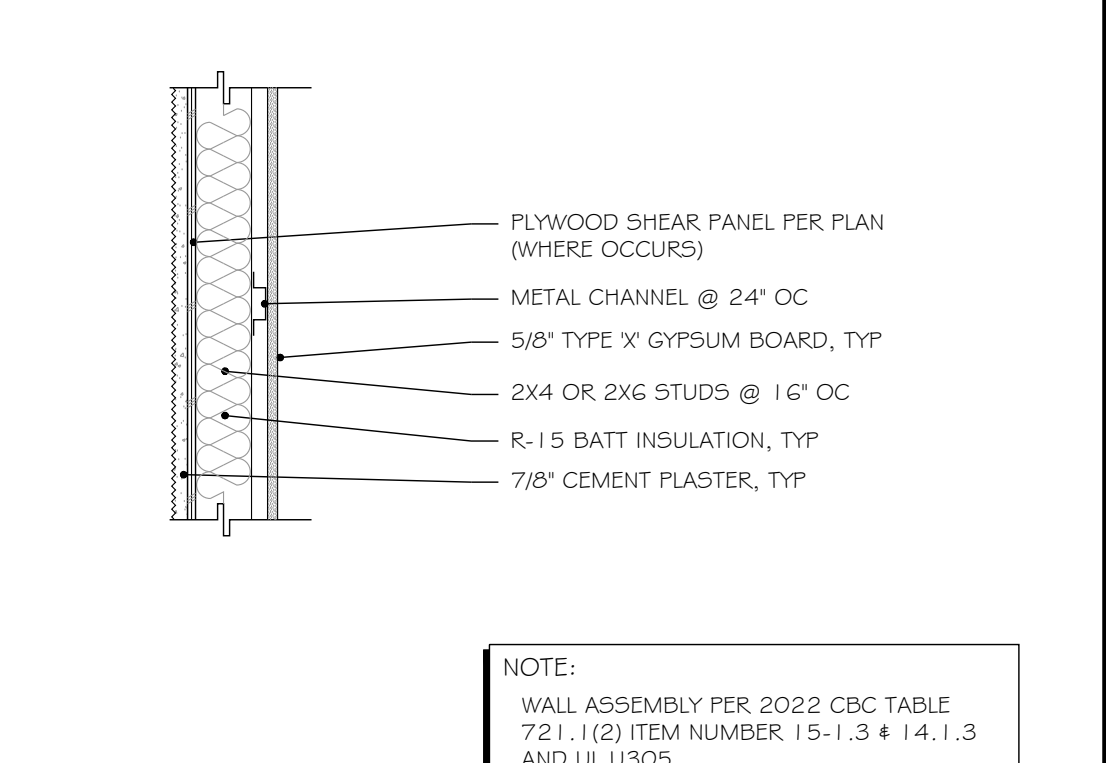


100

96


92

HOLD DOWN AT SHEAR WALL INTERSECTION
SCALE: 1" = 1'-0" A-DT-FDN-SG-ANC-018

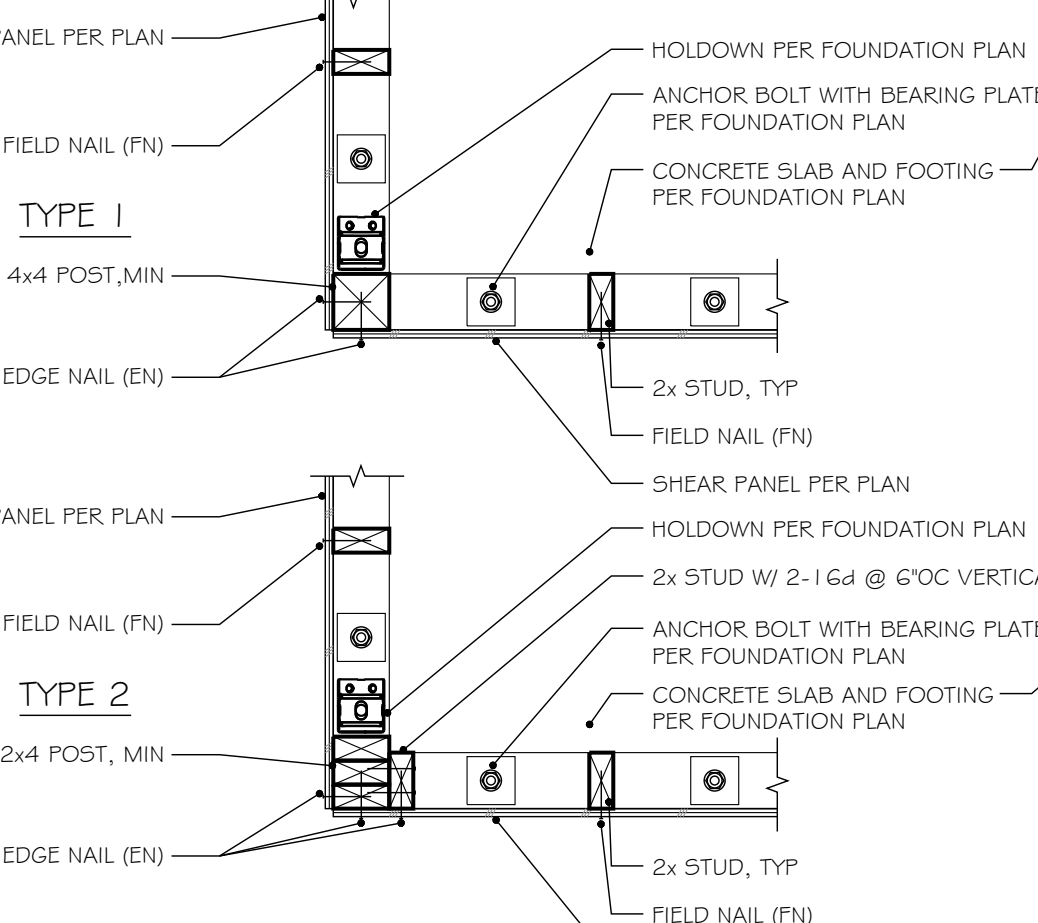


88

INSULATION AT UNVENTED ROOF ASSEMBLY - OVER/UNDER
SCALE: 1" = 1'-0" CRC R806.5 A-DT-FMG-RF-0327

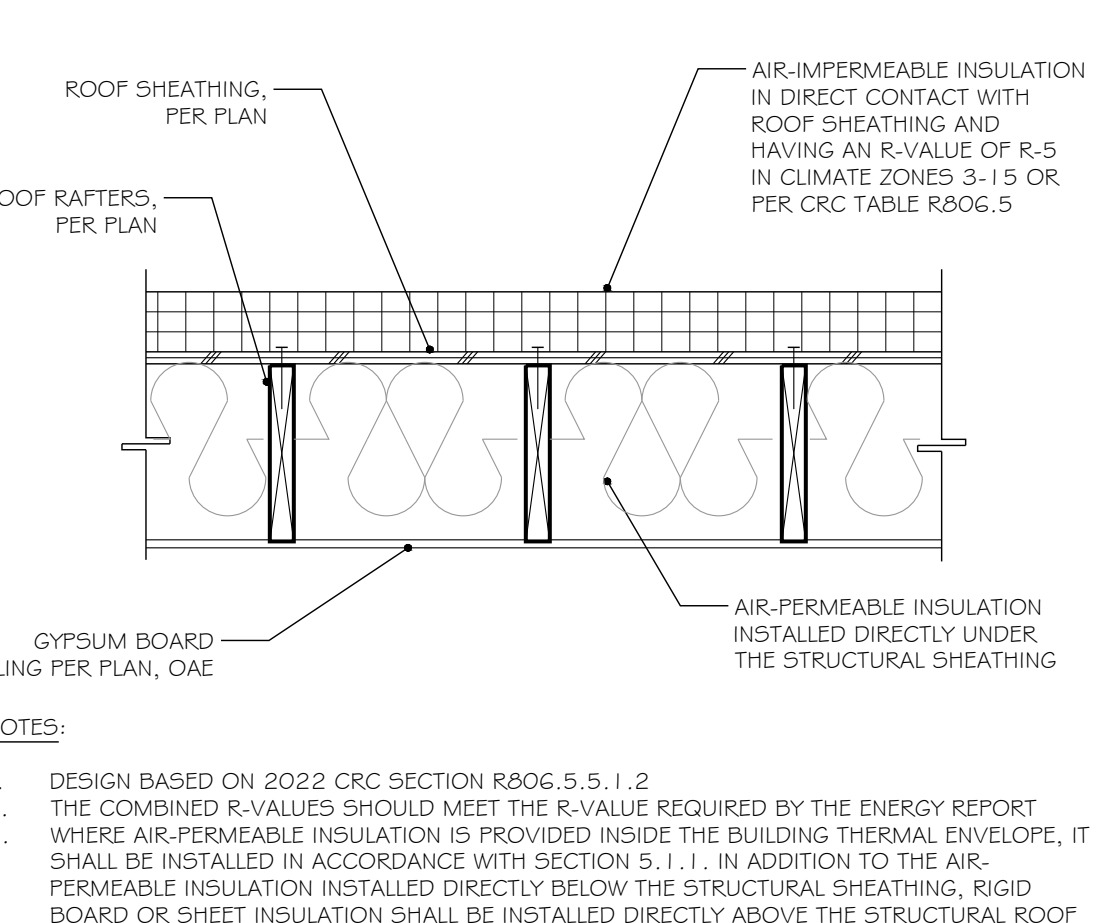

84

EXTERIOR STAIRS AT STEM WALL FOOTING
SCALE: 1" = 1'-0" A-DT-FDN-SW-0136

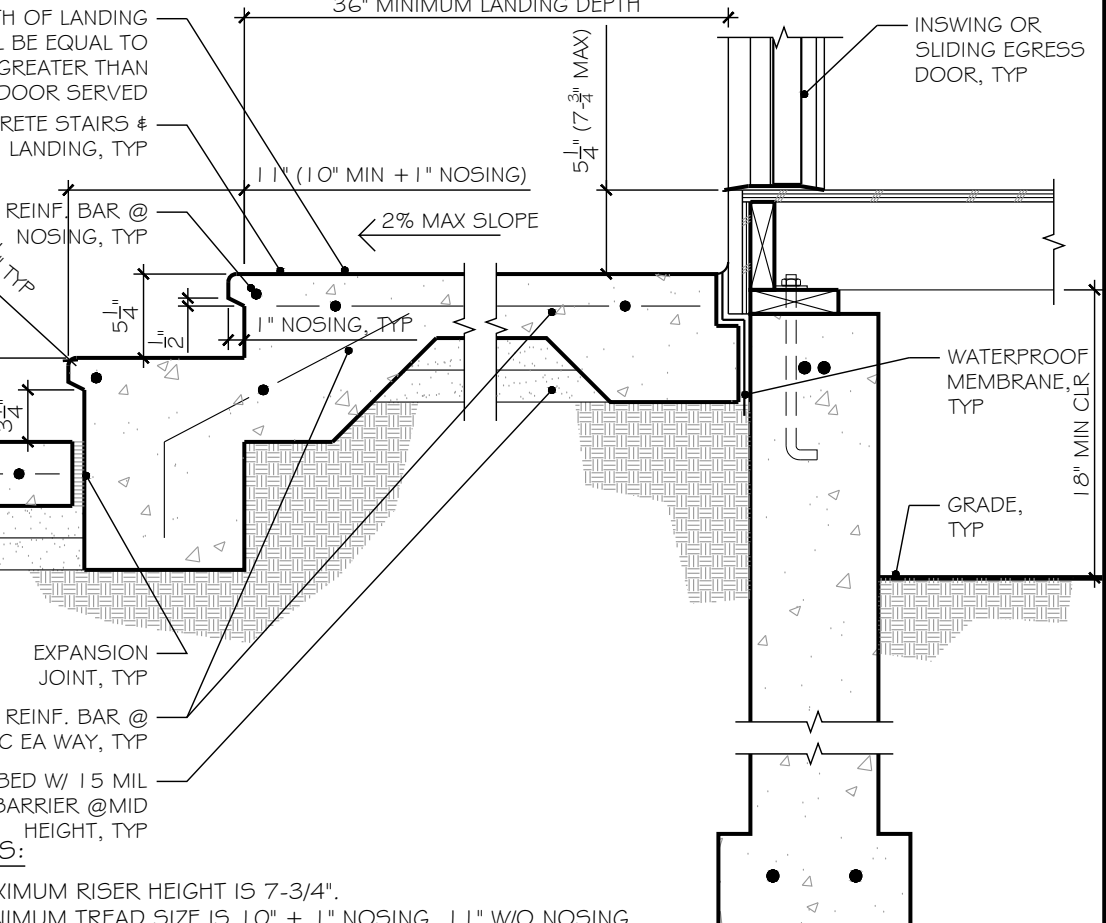

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.



ANAHEIM PRADU

CITY: ANAHEIM

JOB: 202409R

DETAILS

d0.4

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 1 of 13)

GENERAL INFORMATION						
01	Project Name	Anaheim PRADU - 1-Bedroom Plan A				
02	Run Title	Title 24 Analysis				
03	Project Location	Anaheim PRADU Street				
04	City	Anaheim	05	Standards Version	2022	
06	Zip code	92805	07	Software Version	EnergyPro 9.0	
08	Climate Zone	7	09	Front Orientation (deg/ Cardinal)	All orientations	
10	Building Type	Single family	11	Number of Dwelling Units	1	
12	Project Scope	Newly Constructed	13	Number of Bedrooms	1	
14	Addition Cond. Floor Area (ft ²)	0	15	Number of Stories	1	
16	Existing Cond. Floor Area (ft ²)	n/a	17	Fenestration Average U-factor	0.58	
18	Total Cond. Floor Area (ft ²)	499	19	Glazing Percentage (%)	47.40%	
20	ADU Bedroom Count	n/a				
COMPLIANCE RESULTS						
01	Building Complies with Computer Performance					
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.					
03	This building incorporates one or more Special Features shown below					

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 3 of 13)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kbtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.13	0.6	0.75	5.22	-0.62	-4.62
Space Cooling	0.87	18.49	0.65	17.26	0.22	1.23
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.89	2.2	27.07	0.96	9.82
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	4.62	60.92	4.06	54.49	0.56	6.43
Space Heating	0.13	0.6	0.91	6.37	-0.78	-5.77
Space Cooling	0.87	18.49	0.71	18.39	0.16	0.1
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.89	2.22	27.07	0.94	9.82
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	4.62	60.92	4.3	56.77	0.32	4.15

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 2 of 13)

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	31.4	45.1	31.9			
Proposed Design						
North Facing	30.1	40.3	29.7	1.3	4.8	2.2
East Facing	30.6	42	30.4	0.8	3.1	1.5
South Facing	30.1	39.8	29.4	1.3	5.3	2.5
West Facing	30.3	41.6	30.2	1.1	3.5	1.7
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
<ul style="list-style-type: none"> Standard Design PV Capacity: 1.56 kWdc Proposed PV Capacity Scaling: North (1.56 kWdc) East (1.56 kWdc) South (1.56 kWdc) West (1.56 kWdc) 						

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 4 of 13)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kbtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.13	0.6	0.81	5.67	-0.68	-5.07
Space Cooling	0.87	18.49	0.58	16.08	0.29	2.41
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.89	2.21	27.06	0.95	9.83
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	4.62	60.92	4.06	53.75	0.56	7.17
Space Heating	0.13	0.6	0.75	5.25	-0.62	-4.65
Space Cooling	0.87	18.49	0.71	19.04	0.16	-0.55
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.89	2.21	26.97	0.95	9.92
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	4.62	60.92	4.13	56.2	0.49	4.72

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU- 1 BEDROOM PLAN A
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BA.1-03	T-01
Date	01/17/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 5 of 13)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² - yr)	Proposed Design (kBtu/ft ² - yr)	Compliance Margin (kBtu/ft ² - yr)	Margin Percentage
North Facing				
Gross EUI ¹	23.74	23.61	0.13	0.55
Net EUI ²	6.96	6.83	0.13	1.87
East Facing				
Gross EUI ¹	23.74	23.86	-0.12	-0.51
Net EUI ²	6.96	7.09	-0.13	-1.87
South Facing				
Gross EUI ¹	23.74	23.51	0.23	0.97
Net EUI ²	6.96	6.73	0.23	3.3
West Facing				
Gross EUI ¹	23.74	23.86	-0.12	-0.51
Net EUI ²	6.96	7.08	-0.12	-1.72

Notes
1. Gross EUI is Energy Use Total (not including PV) / Total Building Area.
2. Net EUI is Energy Use Total (including PV) / Total Building Area.

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 7 of 13)

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Anaheim PRADU - 1-Bedroom Plan A	499	1	1	1	1	1

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Status
ADU 1-Bedroom A	Conditioned	Ductless Mini-Split1	499	8	DHW Sys 1	New

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window and Door Area (ft ²)	Tilt (deg)
Front Wall	ADU 1-Bedroom A	_WALL: 2x4 Exterior	0	Front	321	54.5	90
Left Wall	ADU 1-Bedroom A	_WALL: 2x4 Exterior	90	Left	126	48	90
Rear Wall	ADU 1-Bedroom A	_WALL: 2x4 Exterior	180	Back	321	70	90
Right Wall	ADU 1-Bedroom A	_WALL: 2x4 Exterior	270	Right	126	64	90
Roof 2	ADU 1-Bedroom A	_ROOF: CLG.	n/a	n/a	200	n/a	n/a

OPAQUE SURFACES - CATHEDRAL CEILINGS										
01	02	03	04	05	06	07	08	09	10	11
Name	Zone	Construction	Azimuth	Orientation	Area (ft ²)	Skylight Area (ft ²)	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Cool Roof
Roof	ADU 1-Bedroom A	_ROOF: SLPD. CLG.	0	Front	299	0	4	0.1	0.85	No

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 6 of 13)

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
1.56	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Whole house fan
- Exposed slab floor in conditioned zone
- Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)
- Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater, specific brand/model, or equivalent, must be installed

HERS FEATURE SUMMARY
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered EF2Rs and CF3Rs are required to be completed in the HERS Registry.

- Indoor air quality ventilation
- Kitchen range hood
- Whole house fan airflow and fan efficacy
- Verified EER/SEER2
- Verified SEER/SEER2
- Verified Refrigerant Charge
- Airflow in habitable rooms (SC3.1.4.1.7)
- Verified HSPF2
- Verified heat pump rated heating capacity
- Wall-mounted thermostat in zones greater than 150 ft² (SC3.4.5)
- Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 8 of 13)

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic ADU 1-Bedroom A	Attic RoofADU 1-Bedroom A	Ventilated	4	0.1	0.85	Yes	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
w1	Window	Front Wall	Front	0			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
d1	Window	Front Wall	Front	0			1	24	0.58	NFRC	0.65	NFRC	Bug Screen
w5	Window	Front Wall	Front	0			1	12.5	0.58	NFRC	0.65	NFRC	Bug Screen
d3	Window	Left Wall	Left	90			1	48	0.58	NFRC	0.65	NFRC	Bug Screen
w4	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w3	Window	Rear Wall	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
w2	Window	Rear Wall	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
w1.2	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w1.3	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
d2	Window	Right Wall	Right	270			1	64	0.58	NFRC	0.65	NFRC	Bug Screen

Registration Number: 223-P010006670A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 16:41:01

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU- 1 BEDROOM PLAN A
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BA.1-03	T-02
Date	01/17/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
 Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 9 of 13)

01	02	03	04	05	06	07	08
Name	Zone	Area (ft ²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab On Grade	ADU 1-Bedroom A	499	99	none	0	0%	No

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
_WALL: 2x4 Exterior	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O. C.	R-15	None / None	0.095	Inside Finish: Gypsum Board Cavity / Frame: R-15 / 2x4 Exterior Finish: All Other Siding
_ROOF: SLPD. CLG.	Cathedral Ceilings	Wood Framed Ceiling	2x10 @ 24 in. O. C.	R-30	None / None	0.035	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-30 / 2x10 Inside Finish: Gypsum Board
Attic Roof/ADU 1-Bedroom A	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / D	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
_ROOF: CLG.	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 16 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

01	02	03	04	05
Quality Insulation Installation (QI)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Not Required	Not Required	N/A	n/a	n/a

Registration Number: 223-P010006670A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-01-17 12:07:36
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
 Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 10 of 13)

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	AOSmith	AOSmithFPTU50	ADU 1-Bedroom A	ADU 1-Bedroom A	ADU 1-Bedroom A

01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
Ductless Mini-Split1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback

Registration Number: 223-P010006670A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-01-17 12:07:36
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
 Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 11 of 13)

01	02	03	04	05	06	07	08	09	10	11	12	13	
Name	System Type	Number of Units	Heating			Cooling			Zonally Controlled	Compressor Type	HERS Verification		
			Efficiency Type	HSPF / HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2				EER / CEER	
Heat Pump System 1	VCHP-ductless	1	HSPF2	13.1	28000	16800	EER2SEER2	18.9	13	Zonally Controlled	Multi-speed	Heat Pump System 1-hers-htpump	

01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER/EER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htpump	Not Required	0	Not Required	Not Required	Yes	No	Yes	Yes

01	02	03	04	05	06	07	08	09	10
Name	Certified Low-Static VCHP System	Airflow to Habitable Rooms	Ductless Units in Conditioned Space	Wall Mount Thermostat	Air Filter Sizing & Pressure Drop Rating	Low Leakage Ducts in Conditioned Space	Minimum Airflow per RA3.3 and SC3.3.3.4.1	Certified non-continuous Fan	Indoor Fan not Running Continuously
Heat Pump System 1	Not required	Required	Required	Required	Not required	Not required	Not required	Not required	Not required

01	02	03	04	05	06	07	08	09
Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE	Includes Fault Indicator Display?	HERS Verification	Status
Sfam IAQVentRpt	30	0.35	Exhaust	No	n/a	No	Yes	

Registration Number: 223-P010006670A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-01-17 12:07:36
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 16:41:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan A
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T16:40:10-08:00
 Input File Name: 23Q1019-1BA.1-03.rbd22x

(Page 12 of 13)

01	02	03	04	05	06	07	08	09
Name	Airflow Rate (CFM/ft2)	Cooling Vent CFM	Cooling Vent Watts/CFM	Total Watts	Number of Fans	CFVCS Type	Exhausts to	HERS Verification
WH Fan 1	0.04	20	0.05	1	1	Not a CFVCS	Outside	Required

PROJECT NOTES

 This report is based on the drawings received on 01/03/2023.

 SCOPE OF WORK: Construct a ADU - 1-Bedroom (A Elevation).
 1) DO NOT USE FOR ACTUAL HEATING/COOLING DESIGN. 2) The Title 24 calculations used for this project are used for the purpose of complying with the current Title 24 code provisions and are intended to be used in order to obtain compliance per Title 24 regulations. They are NOT intended to be used as a substitute for the heating and cooling loads required for the structure(s) that are normally done by a mechanical engineer(s) or HVAC contractor(s) and in NO CIRCUMSTANCES is this to be used in lieu of the normal calculation methods used by a mechanical engineer(s) or HVAC contractor(s). 3) The assembly components found in this document are for modeling purposes only and may not reflect the actual conditions of the walls, roof(s), floor(s), windows and doors of the structure.

Registration Number: 223-P010006670A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-01-17 12:07:36
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 16:41:01

General Notes



R19-04-30011
 NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU - 1 BEDROOM PLAN A
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BA.1-03	T-03
Date	01/17/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 1 of 13)

GENERAL INFORMATION						
01	Project Name	Anaheim PRADU - 1-Bedroom Plan B				
02	Run Title	Title 24 Analysis				
03	Project Location	Anaheim PRADU Street				
04	City	05	Standards Version	2022		
06	Zip code	07	Software Version	EnergyPro 9.0		
08	Climate Zone	09	Front Orientation (deg/ Cardinal)	All orientations		
10	Building Type	11	Number of Dwelling Units	1		
12	Project Scope	13	Number of Bedrooms	1		
14	Addition Cond. Floor Area (ft ²)	15	Number of Stories	1		
16	Existing Cond. Floor Area (ft ²)	17	Fenestration Average U-factor	0.58		
18	Total Cond. Floor Area (ft ²)	19	Glazing Percentage (%)	47.40%		
20	ADU Bedroom Count	n/a				
COMPLIANCE RESULTS						
01	Building Complies with Computer Performance					
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.					
03	This building incorporates one or more Special Features shown below					

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 3 of 13)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kbtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.13	0.62	0.67	4.71	-0.54	-4.09
Space Cooling	0.86	18.34	0.64	16.91	0.22	1.43
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.92	2.2	27.06	0.96	9.86
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	4.61	60.82	3.97	53.62	0.64	7.2
Space Heating	0.13	0.62	0.82	5.73	-0.69	-5.11
Space Cooling	0.86	18.34	0.69	17.73	0.17	0.61
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.92	2.22	27.05	0.94	9.87
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	4.61	60.82	4.19	55.45	0.42	5.37

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 2 of 13)

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	31.4	45	31.9			
Proposed Design						
North Facing	29.9	39.6	29.4	1.5	5.4	2.5
East Facing	30.4	41	30	1	4	1.9
South Facing	29.9	39.1	29.2	1.5	5.9	2.7
West Facing	30	40.6	29.8	1.4	4.4	2.1
RESULT: PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
<ul style="list-style-type: none"> Standard Design PV Capacity: 1.56 kWdc Proposed PV Capacity Scaling: North (1.56 kWdc) East (1.56 kWdc) South (1.56 kWdc) West (1.56 kWdc) 						

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 4 of 13)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kbtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kbtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.13	0.62	0.73	5.09	-0.6	-4.47
Space Cooling	0.86	18.34	0.57	15.86	0.29	2.48
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.92	2.21	27.04	0.95	9.88
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	4.61	60.82	3.97	52.93	0.64	7.89
Space Heating	0.13	0.62	0.67	4.66	-0.54	-4.04
Space Cooling	0.86	18.34	0.68	18.42	0.18	-0.08
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.16	36.92	2.2	26.95	0.96	9.97
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	4.61	60.82	4.01	54.97	0.6	5.85

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS inc.
Report Generated: 2023-01-14 17:01:27

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU- 1 BEDROOM PLAN B
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BB.1-04	T-01
Date	01/19/2023
Scale	

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² - yr)	Proposed Design (kBtu/ft ² - yr)	Compliance Margin (kBtu/ft ² - yr)	Margin Percentage
North Facing				
Gross EUI ¹	23.74	23.52	0.22	0.93
Net EUI ²	6.98	6.76	0.22	3.15
East Facing				
Gross EUI ¹	23.74	23.72	0.02	0.08
Net EUI ²	6.98	6.96	0.02	0.29
South Facing				
Gross EUI ¹	23.74	23.43	0.31	1.31
Net EUI ²	6.98	6.66	0.32	4.58
West Facing				
Gross EUI ¹	23.74	23.72	0.02	0.08
Net EUI ²	6.98	6.96	0.02	0.29

Notes
 1. Gross EUI is Energy Use Total (not including PV) / Total Building Area.
 2. Net EUI is Energy Use Total (including PV) / Total Building Area.

Registration Number: 223-P010006673A-000-000-00000000-0000 Registration Date/Time: 2023-01-17 12:07:36 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:01:27
 Schema Version: rev 20220901

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Anaheim PRADU - 1-Bedroom Plan B	499	1	1	1	1	1

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Status
ADU 1-Bedroom B	Conditioned	Ductless Mini-Split1	499	8	DHW Sys 1	New

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window and Door Area (ft ²)	Tilt (deg)
Front Wall	ADU 1-Bedroom B	_WALL: 2x4 Exterior	0	Front	192	42	90
Front Wall 2	ADU 1-Bedroom B	_WALL: 2x8 Exterior	0	Front	129	12.5	90
Left Wall	ADU 1-Bedroom B	_WALL: 2x4 Exterior	90	Left	138	48	90
Rear Wall	ADU 1-Bedroom B	_WALL: 2x4 Exterior	180	Back	192	54	90
Rear Wall 2	ADU 1-Bedroom B	_WALL: 2x8 Exterior	180	Back	129	16	90
Right Wall	ADU 1-Bedroom B	_WALL: 2x4 Exterior	270	Right	138	64	90
Roof 2	ADU 1-Bedroom B	_ROOF: CLG.	n/a	n/a	220	n/a	n/a

OPAQUE SURFACES - CATHEDRAL CEILINGS										
01	02	03	04	05	06	07	08	09	10	11
Name	Zone	Construction	Azimuth	Orientation	Area (ft ²)	Skylight Area (ft ²)	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Cool Roof
Roof	ADU 1-Bedroom B	_ROOF: SLPD. CLG.	0	Front	279	0	5	0.1	0.85	No

Registration Number: 223-P010006673A-000-000-00000000-0000 Registration Date/Time: 2023-01-17 12:07:36 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:01:27
 Schema Version: rev 20220901

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
1.56	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES
 The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.
 • Whole house fan
 • Exposed slab floor in conditioned zone
 • Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)
 • Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed

HERS FEATURE SUMMARY
 The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry.
 • Indoor air quality ventilation
 • Kitchen range hood
 • Whole house fan airflow and fan efficacy
 • Verified EER/EER2
 • Verified SEER/SEER2
 • Verified Refrigerant Charge
 • Airflow in habitable rooms (SC3.1.4.1.7)
 • Verified HSPF2
 • Verified heat pump rated heating capacity
 • Wall-mounted thermostat in zones greater than 150 ft2 (SC3.4.5)
 • Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)

Registration Number: 223-P010006673A-000-000-00000000-0000 Registration Date/Time: 2023-01-17 12:07:36 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:01:27
 Schema Version: rev 20220901

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic ADU 1-Bedroom B	Attic RoofADU 1-Bedroom B	Ventilated	5	0.1	0.85	Yes	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
w1	Window	Front Wall	Front	0			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
d1	Window	Front Wall	Front	0			1	24	0.58	NFRC	0.65	NFRC	Bug Screen
w5	Window	Front Wall 2	Front	0			1	12.5	0.58	NFRC	0.65	NFRC	Bug Screen
d3	Window	Left Wall	Left	90			1	48	0.58	NFRC	0.65	NFRC	Bug Screen
w4	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w1 2	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w1 3	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w3	Window	Rear Wall 2	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
w2	Window	Rear Wall 2	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
d2	Window	Right Wall	Right	270			1	64	0.58	NFRC	0.65	NFRC	Bug Screen

Registration Number: 223-P010006673A-000-000-00000000-0000 Registration Date/Time: 2023-01-17 12:07:36 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:01:27
 Schema Version: rev 20220901

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU - 1 BEDROOM PLAN B
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BB.1-04	T-02
Date	01/19/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 9 of 13)

01	02	03	04	05	06	07	08
Name	Zone	Area (ft ²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab On Grade	ADU 1-Bedroom B	499	99	none	0	0%	No

OPAQUE SURFACE CONSTRUCTIONS

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
_WALL: 2x4 Exterior	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O. C.	R-15	None / None	0.095	Inside Finish: Gypsum Board Cavity / Frame: R-15 / 2x4 Exterior Finish: All Other Siding
_WALL: 2x8 Exterior	Exterior Walls	Wood Framed Wall	2x8 @ 16 in. O. C.	R-25	None / None	0.056	Inside Finish: Gypsum Board Cavity / Frame: R-25 / 2x8 Exterior Finish: All Other Siding
_ROOF: SLPD. CLG.	Cathedral Ceilings	Wood Framed Ceiling	2x10 @ 24 in. O. C.	R-30	None / None	0.035	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-30 / 2x10 Inside Finish: Gypsum Board
Attic Roof/ADU 1-Bedroom B	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
_ROOF: CLG.	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 16 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 10 of 13)

01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Not Required	Not Required	N/A	n/a	n/a

WATER HEATING SYSTEMS

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

WATER HEATERS - NEEA HEAT PUMP

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	AOSmith	AOSmithPPTU50	ADU 1-Bedroom B	ADU 1-Bedroom B	ADU 1-Bedroom B

WATER HEATING - HERS VERIFICATION

01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 11 of 13)

01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
Ductless Mini-Split1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback

HVAC - HEAT PUMPS

01	02	03	04	05	06	07	08	09	10	11	12	13
Name	System Type	Number of Units	Heating			Cooling			Zonally Controlled	Compressor Type	HERS Verification	
			Efficiency Type	HSPF / HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2				EER / EER / CEER
Heat Pump System 1	VCHP-ductless	1	HSPF2	13.1	28000	16800	EER2SEER2	18.9	13	Zonally Controlled	Multi-speed	Heat Pump System 1-hers-htpump

HVAC HEAT PUMPS - HERS VERIFICATION

01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER/SEER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htpump	Not Required	0	Not Required	Not Required	Yes	No	Yes	Yes

VARIABLE CAPACITY HEAT PUMP COMPLIANCE OPTION - HERS VERIFICATION

01	02	03	04	05	06	07	08	09	10
Name	Certified Low-Static VCHP System	Airflow to Habitable Rooms	Ductless Units in Conditioned Space	Wall Mount Thermostat	Air Filter Sizing & Pressure Drop Rating	Low Leakage Ducts in Conditioned Space	Minimum Airflow per RA3.3 and SC3.3.3.4.1	Certified non-continuous Fan	Indoor Fan not Running Continuously
Heat Pump System 1	Not required	Required	Required	Required	Not required	Not required	Not required	Not required	Not required

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 17:01:27

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan B
Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:00:35-08:00
Input File Name: 23Q1019-1BB.1-04.rbd22x

(Page 12 of 13)

01	02	03	04	05	06	07	08	09
Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE	Includes Fault Indicator Display?	HERS Verification	Status
Sfam IAQVentRpt	30	0.35	Exhaust	No	n/a	No	Yes	

COOLING VENTILATION

01	02	03	04	05	06	07	08	09
Name	Airflow Rate (CFM/ft2)	Cooling Vent CFM	Cooling Vent Watts/CFM	Total Watts	Number of Fans	CFVCS Type	Exhausts to	HERS Verification
WH Fan 1	0.04	20	0.05	1	1	Not a CFVCS	Outside	Required

PROJECT NOTES

This report is based on the drawings received on 01/03/2023.

SCOPE OF WORK: Construct a ADU - 1-Bedroom (B Elevation).

1) DO NOT USE FOR ACTUAL HEATING/COOLING DESIGN. 2) The Title 24 calculations used for this project are used for the purpose of complying with the current Title 24 code provisions and are intended to be used in order to obtain compliance per Title 24 regulations. They are NOT intended to be used as a substitute for the heating and cooling loads required for the structure(s) that are normally done by a mechanical engineer(s) or HVAC contractor(s) and in NO CIRCUMSTANCES is this to be used in lieu of the normal calculation methods used by a mechanical engineer(s) or HVAC contractor(s). 3) The assembly components found in this document are for modeling purposes only and may not reflect the actual conditions of the walls, roof(s), floor(s), windows and doors of the structure.

Registration Number: 223-P010006673A-000-000-0000000-0000
CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:07:36
Report Version: 2022.0.000
Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
Report Generated: 2023-01-14 17:01:27

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU - 1 BEDROOM PLAN B
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BB.1-04	T-03
Date	01/19/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 1 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

GENERAL INFORMATION						
01	Project Name	Anaheim PRADU - 1-Bedroom Plan C				
02	Run Title	Title 24 Analysis				
03	Project Location	Anaheim PRADU Street				
04	City	05	Standards Version	2022		
06	Zip code	07	Software Version	EnergyPro 9.0		
08	Climate Zone	09	Front Orientation (deg/ Cardinal)	All orientations		
10	Building Type	11	Number of Dwelling Units	1		
12	Project Scope	13	Number of Bedrooms	1		
14	Addition Cond. Floor Area (ft ²)	15	Number of Stories	1		
16	Existing Cond. Floor Area (ft ²)	17	Fenestration Average U-factor	0.58		
18	Total Cond. Floor Area (ft ²)	19	Glazing Percentage (%)	49.00%		
20	ADU Bedroom Count	n/a				
COMPLIANCE RESULTS						
01	Building Complies with Computer Performance					
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.					
03	This building incorporates one or more Special Features shown below					

Registration Number: 223-P010006674A-000-000-0000000-0000 HERS Provider: CalCERTS inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 3 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.1	0.46	0.71	4.96	-0.61	-4.5
Space Cooling	0.87	18.4	0.68	18.05	0.19	0.35
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.15	36.89	2.2	26.98	0.95	9.91
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	4.58	60.69	4.05	54.93	0.53	5.76
Space Heating	0.1	0.46	0.85	5.93	-0.75	-5.47
Space Cooling	0.87	18.4	0.71	18.54	0.16	-0.14
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.15	36.89	2.22	27.06	0.93	9.83
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	4.58	60.69	4.24	56.47	0.34	4.22

Registration Number: 223-P010006674A-000-000-0000000-0000 HERS Provider: CalCERTS inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 2 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

ENERGY DESIGN RATINGS						
	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	31.5	45.2	31.9			
Proposed Design						
North Facing	30.2	40.9	29.9	1.3	4.3	2
East Facing	30.6	42.1	30.4	0.9	3.1	1.5
South Facing	30.2	40.3	29.6	1.3	4.9	2.3
West Facing	30.3	41.7	30.2	1.2	3.5	1.7
RESULT³: PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
<ul style="list-style-type: none"> Standard Design PV Capacity: 1.56 kWdc Proposed PV Capacity Scaling: North (1.56 kWdc) East (1.56 kWdc) South (1.56 kWdc) West (1.56 kWdc) 						

Registration Number: 223-P010006674A-000-000-0000000-0000 HERS Provider: CalCERTS inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 4 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.1	0.46	0.77	5.39	-0.67	-4.93
Space Cooling	0.87	18.4	0.61	16.77	0.26	1.63
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.15	36.89	2.21	27.04	0.94	9.85
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	4.58	60.69	4.05	54.14	0.53	6.55
Space Heating	0.1	0.46	0.7	4.9	-0.6	-4.44
Space Cooling	0.87	18.4	0.71	19.21	0.16	-0.81
IAQ Ventilation	0.46	4.94	0.46	4.94	0	0
Water Heating	3.15	36.89	2.2	26.94	0.95	9.95
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	4.58	60.69	4.07	55.99	0.51	4.7

Registration Number: 223-P010006674A-000-000-0000000-0000 HERS Provider: CalCERTS inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU- 1 BEDROOM PLAN C
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project	Sheet
23Q1019-1BC.1-03	T-01
Date	01/19/2023
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:20:13-08:00
 Input File Name: 23Q1019-1BC.1-03.rbd22x

(Page 5 of 13)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² - yr)	Proposed Design (kBtu/ft ² - yr)	Compliance Margin (kBtu/ft ² - yr)	Margin Percentage
North Facing				
Gross EUI ¹	23.71	23.69	0.02	0.08
Net EUI ²	6.94	6.92	0.02	0.29
East Facing				
Gross EUI ¹	23.71	23.86	-0.15	-0.63
Net EUI ²	6.94	7.09	-0.15	-2.16
South Facing				
Gross EUI ¹	23.71	23.58	0.13	0.55
Net EUI ²	6.94	6.8	0.14	2.02
West Facing				
Gross EUI ¹	23.71	23.85	-0.14	-0.59
Net EUI ²	6.94	7.08	-0.14	-2.02

Notes
 1. Gross EUI is Energy Use Total (not including PV) / Total Building Area.
 2. Net EUI is Energy Use Total (including PV) / Total Building Area.

Registration Number: 223-P01000674A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000
 Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 17:21:06

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:20:13-08:00
 Input File Name: 23Q1019-1BC.1-03.rbd22x

(Page 6 of 13)

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
1.56	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES
 The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Whole house fan
- Exposed slab floor in conditioned zone
- Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)
- Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed

HERS FEATURE SUMMARY
 The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2s and CF3s are required to be completed in the HERS Registry.

- Indoor air quality ventilation
- Kitchen range hood
- Whole house fan airflow and fan efficacy
- Verified EER/EER2
- Verified SEER/SEER2
- Verified Refrigerant Charge
- Airflow in habitable rooms (SC3.1.4.1.7)
- Verified HSPF2
- Verified heat pump rated heating capacity
- Wall-mounted thermostat in zones greater than 150 ft² (SC3.4.5)
- Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)

Registration Number: 223-P01000674A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000
 Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 17:21:06

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:20:13-08:00
 Input File Name: 23Q1019-1BC.1-03.rbd22x

(Page 7 of 13)

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Anaheim PRADU - 1-Bedroom Plan C	499	1	1	1	1	1

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft ²)	Avg. Ceiling Height	Water Heating System 1	Status
ADU 1-Bedroom C	Conditioned	Ductless Mini-Split1	499	8	DHW Sys 1	New

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft ²)	Window and Door Area (ft ²)	Tilt (deg)
Front Wall	ADU 1-Bedroom C	_WALL: 2x4 Exterior	0	Front	294	54.5	90
Left Wall	ADU 1-Bedroom C	_WALL: 2x4 Exterior	90	Left	126	52	90
Rear Wall	ADU 1-Bedroom C	_WALL: 2x4 Exterior	180	Back	321	70	90
Right Wall	ADU 1-Bedroom C	_WALL: 2x4 Exterior	270	Right	126	68	90
Roof 2	ADU 1-Bedroom C	_ROOF: CLG.	n/a	n/a	200	n/a	n/a

OPAQUE SURFACES - CATHEDRAL CEILINGS										
01	02	03	04	05	06	07	08	09	10	11
Name	Zone	Construction	Azimuth	Orientation	Area (ft ²)	Skylight Area (ft ²)	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Cool Roof
Roof	ADU 1-Bedroom C	_ROOF: SLPD. CLG.	0	Front	299	0	5	0.1	0.85	No

Registration Number: 223-P01000674A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000
 Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 17:21:06

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C
 Calculation Description: Title 24 Analysis

Calculation Date/Time: 2023-01-14T17:20:13-08:00
 Input File Name: 23Q1019-1BC.1-03.rbd22x

(Page 8 of 13)

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic ADU 1-Bedroom C	Attic RoofADU 1-Bedroom C	Ventilated	5	0.1	0.85	Yes	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft ²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
w1	Window	Front Wall	Front	0			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
d1	Window	Front Wall	Front	0			1	24	0.58	NFRC	0.65	NFRC	Bug Screen
w5	Window	Front Wall	Front	0			1	12.5	0.58	NFRC	0.65	NFRC	Bug Screen
d3	Window	Left Wall	Left	90			1	48	0.58	NFRC	0.65	NFRC	Bug Screen
w6	Window	Left Wall	Left	90			1	4	0.58	NFRC	0.65	NFRC	Bug Screen
w4	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w3	Window	Rear Wall	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
w2	Window	Rear Wall	Back	180			1	8	0.58	NFRC	0.65	NFRC	Bug Screen
w1 2	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
w1 3	Window	Rear Wall	Back	180			1	18	0.58	NFRC	0.65	NFRC	Bug Screen
d2	Window	Right Wall	Right	270			1	64	0.58	NFRC	0.65	NFRC	Bug Screen
w6 2	Window	Right Wall	Right	270			1	4	0.58	NFRC	0.65	NFRC	Bug Screen

Registration Number: 223-P01000674A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance

Registration Date/Time: 2023-01-17 12:08:33
 Report Version: 2022.0.000
 Schema Version: rev 20220901

HERS Provider: CalCERTS Inc.
 Report Generated: 2023-01-14 17:21:06

General Notes



R19-04-30011
 NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date
-----	----------------	------

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU - 1 BEDROOM PLAN C
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project 23Q1019-1BC.1-03	Sheet T-02
Date 01/19/2023	
Scale	

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 9 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

01	02	03	04	05	06	07	08
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab On Grade	ADU 1-Bedroom C	499	96	none	0	0%	No

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
_WALL: 2x4 Exterior	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O. C.	R-15	None / None	0.095	Inside Finish: Gypsum Board Cavity / Frame: R-15 / 2x4 Exterior Finish: All Other Siding
_ROOF: SLPD. CLG.	Cathedral Ceilings	Wood Framed Ceiling	2x10 @ 24 in. O. C.	R-30	None / None	0.035	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: R-30 / 2x10 Inside Finish: Gypsum Board
Attic Roof/ADU 1-Bedroom C	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no Insul. / 2x4
_ROOF: CLG.	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 16 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Not Required	Not Required	N/A	n/a	n/a

Registration Number: 223-P01000674A-000-000-0000000-0000 Registration Date/Time: 2023-01-17 12:08:33 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 10 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	50	AOSmith	AOSmithFPTU50	ADU 1-Bedroom C	ADU 1-Bedroom C	ADU 1-Bedroom C

01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
Ductless Mini-Split1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback

Registration Number: 223-P01000674A-000-000-0000000-0000 Registration Date/Time: 2023-01-17 12:08:33 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 11 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

01	02	03	04	05	06	07	08	09	10	11	12	13
Name	System Type	Number of Units	Heating			Cooling			Zonally Controlled	Compressor Type	HERS Verification	
			Efficiency Type	HSPF / HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2				EER / EER / CEER
Heat Pump System 1	VCHP-ductless	1	HSPF2	13.1	28000	16800	EER2SEER2	18.9	13	Zonally Controlled	Multi-speed	Heat Pump System 1-hers-htpump

01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER/EER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htpump	Not Required	0	Not Required	Not Required	Yes	No	Yes	Yes

01	02	03	04	05	06	07	08	09	10
Name	Certified Low-Static VCHP System	Airflow to Habitable Rooms	Ductless Units in Conditioned Space	Wall Mount Thermostat	Air Filter Sizing & Pressure Drop Rating	Low Leakage Ducts in Conditioned Space	Minimum Airflow per RA3.3 and SC3.3.3.4.1	Certified non-continuous Fan	Indoor Fan not Running Continuously
Heat Pump System 1	Not required	Required	Required	Required	Not required	Not required	Not required	Not required	Not required

01	02	03	04	05	06	07	08	09
Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE	Includes Fault Indicator Display?	HERS Verification	Status
Sfam IAQVentRpt	30	0.35	Exhaust	No	n/a	No	Yes	

Registration Number: 223-P01000674A-000-000-0000000-0000 Registration Date/Time: 2023-01-17 12:08:33 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 12 of 13)
 Calculation Description: Title 24 Analysis Input File Name: 23Q1019-1BC.1-03.rbd22x

01	02	03	04	05	06	07	08	09
Name	Airflow Rate (CFM/ft2)	Cooling Vent CFM	Cooling Vent Watts/CFM	Total Watts	Number of Fans	CFVCS Type	Exhausts to	HERS Verification
WH Fan 1	0.04	20	0.05	1	1	Not a CFVCS	Outside	Required

PROJECT NOTES

 This report is based on the drawings received on 01/03/2023.

 SCOPE OF WORK: Construct a ADU - 1-Bedroom (C Elevation).
 1) DO NOT USE FOR ACTUAL HEATING/COOLING DESIGN. 2) The Title 24 calculations used for this project are used for the purpose of complying with the current Title 24 code provisions and are intended to be used in order to obtain compliance per Title 24 regulations. They are NOT intended to be used as a substitute for the heating and cooling loads required for the structure(s) that are normally done by a mechanical engineer(s) or HVAC contractor(s) and in NO CIRCUMSTANCES is to be used in lieu of the normal calculation methods used by a mechanical engineer(s) or HVAC contractor(s). 3) The assembly components found in this document are for modeling purposes only and may not reflect the actual conditions of the walls, roof(s), floor(s), windows and doors of the structure.

Registration Number: 223-P01000674A-000-000-0000000-0000 Registration Date/Time: 2023-01-17 12:08:33 HERS Provider: CalCERTS Inc.
 CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Report Generated: 2023-01-14 17:21:06
 Schema Version: rev 20220901

General Notes



R19-04-30011
 NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

No.	Revision/Issue	Date

Firm Name and Address

 BEAR TECHNOLOGIES CONSULTING, INC.
 3431 DON ARTURO DRIVE,
 CARLSBAD, CALIFORNIA 92010
 (760) 635-2327
 wayne@beartechconsulting.com
 http://www.beartechconsulting.com

Project Name and Address
 ANAHEIM PRADU - 1 BEDROOM PLAN C
 1 BEDROOM A STREET
 ANAHEIM, CALIFORNIA 92805

Project 23Q1019-1BC.1-03	Sheet T-03
Date 01/19/2023	
Scale	

2022 Single-Family Residential Mandatory Requirements Summary

Note: Single-family residential buildings subject to the Energy Codes must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information.

Table with 2 columns: Code Section and Description. Includes sections for Building Envelope, Space Conditioning, Water Heating, and Plumbing.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

Table with 2 columns: Code Section and Description. Includes sections for Ventilation and Indoor Air Quality, Pool and Spa Systems and Equipment, and Lighting.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

Table with 2 columns: Code Section and Description. Includes sections for Ducts and Fans, Energy Storage System (ESS) Ready, and various energy efficiency requirements.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

Table with 2 columns: Code Section and Description. Includes sections for Energy Storage System (ESS) Ready, and various energy efficiency requirements.

5/6/22

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Anaheim PRADU - 1-Bedroom Plan C Calculation Date/Time: 2023-01-14T17:20:13-08:00 (Page 13 of 13)
Calculation Description: Title 24 Analysis Input File Name: 23QJ019-1BC-1-03.rbd22x

Table with 2 columns: Field and Value. Includes fields for Documentation Author Name (Wayne Seward), Signature Date (2023-01-17 12:07:59), and City/State/Zip (Carlsbad, CA 92010).

Table with 2 columns: Field and Value. Includes fields for Responsible Person Name (Bar M Smith), Signature Date (2023-01-17 12:08:33), and City/State/Zip (Encinitas, CA 92024).

Digitally signed by CaCERTS. This digital signature is provided in order to secure the content of this registered document, and in no way implies Registration Provider responsibility for the accuracy of the information.

Registration Number: 223-P01000674A-000-000-0000000-0000 Registration Date/Time: 2023-01-17 12:08:33
CA Building Energy Efficiency Standards - 2022 Residential Compliance Report Version: 2022.0.000 Schema Version: rev 20220901



2022 Single-Family Residential Mandatory Requirements Summary

Table with 2 columns: Code Section and Description. Includes sections for Energy Storage System (ESS) Ready, and various energy efficiency requirements.

5/6/22

General Notes



R19-04-30011
NR19-04-30020

TITLE 24, PART 6 ENERGY COMPLIANCE DOCUMENTATION

Table with 3 columns: No., Revision/Issue, Date.

Firm Name and Address: BEAR TECHNOLOGIES CONSULTING, INC. 3431 DON ARTURO DRIVE, CARLSBAD, CALIFORNIA 92010

Project Name and Address: ANAHEIM PRADU - 1 BEDROOM PLAN C 1 BEDROOM A STREET ANAHEIM, CALIFORNIA 92805

Table with 2 columns: Project and Sheet. Project: 23QJ019-1BC-1-03, Sheet: T-04

HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY									
Project Name PRADU - 1-Bedroom Plan C								Date 1/17/2023	
System Name Ductless Mini-Split								Floor Area 499	
ENGINEERING CHECKS					SYSTEM LOAD				
Number of Systems		1			COIL COOLING PEAK		COIL HTG. PEAK		
Heating System		Total Room Loads			CFM	Sensible	Latent	CFM	Sensible
Output per System		28,000			586	14,952	1,746	664	10,884
Total Output (Btuh)		28,000			Return Vented Lighting				
Output (Btuh/sqft)		56.1			Return Air Ducts				
Cooling System		Return Fan			Ventilation				
Output per System		24,000			250	2,421	3,543	250	9,414
Total Output (Btuh)		24,000			Supply Fan				
Total Output (Tons)		2.0			Supply Air Ducts				
Total Output (Btuh/sqft)		48.1			TOTAL SYSTEM LOAD				
Total Output (sqft/Ton)		249.5			17,968	5,290	19,702		
Air System					HVAC EQUIPMENT SELECTION				
CFM per System		800			Ductless Mini-Split		23,445	0	21,922
Airflow (cfm)		800			Total Adjusted System Output				
Airflow (cfm/sqft)		1.60			(Adjusted for Peak Design conditions)				
Airflow (cfm/Ton)		400.0			23,445				
Outside Air (%)		31.2%			0				
Outside Air (cfm/sqft)		0.50			21,922				
Note: values above given at ARI conditions									
HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)					TIME OF SYSTEM PEAK				
Aug 3 PM					Jan 1 AM				

c

HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY									
Project Name PRADU - 1-Bedroom Plan B								Date 1/17/2023	
System Name Ductless Mini-Split								Floor Area 499	
ENGINEERING CHECKS					SYSTEM LOAD				
Number of Systems		1			COIL COOLING PEAK		COIL HTG. PEAK		
Heating System		Total Room Loads			CFM	Sensible	Latent	CFM	Sensible
Output per System		28,000			565	14,428	1,746	652	10,676
Total Output (Btuh)		28,000			Return Vented Lighting				
Output (Btuh/sqft)		56.1			Return Air Ducts				
Cooling System		Return Fan			Ventilation				
Output per System		24,000			250	2,421	3,543	250	9,414
Total Output (Btuh)		24,000			Supply Fan				
Total Output (Tons)		2.0			Supply Air Ducts				
Total Output (Btuh/sqft)		48.1			TOTAL SYSTEM LOAD				
Total Output (sqft/Ton)		249.5			17,444	5,290	19,494		
Air System					HVAC EQUIPMENT SELECTION				
CFM per System		800			Ductless Mini-Split		23,445	0	21,922
Airflow (cfm)		800			Total Adjusted System Output				
Airflow (cfm/sqft)		1.60			(Adjusted for Peak Design conditions)				
Airflow (cfm/Ton)		400.0			23,445				
Outside Air (%)		31.2%			0				
Outside Air (cfm/sqft)		0.50			21,922				
Note: values above given at ARI conditions									
HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)					TIME OF SYSTEM PEAK				
Aug 3 PM					Jan 1 AM				

b

HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY									
Project Name PRADU - 1-Bedroom Plan A								Date 1/17/2023	
System Name Ductless Mini-Split								Floor Area 499	
ENGINEERING CHECKS					SYSTEM LOAD				
Number of Systems		1			COIL COOLING PEAK		COIL HTG. PEAK		
Heating System		Total Room Loads			CFM	Sensible	Latent	CFM	Sensible
Output per System		28,000			565	14,425	1,746	659	10,799
Total Output (Btuh)		28,000			Return Vented Lighting				
Output (Btuh/sqft)		56.1			Return Air Ducts				
Cooling System		Return Fan			Ventilation				
Output per System		24,000			250	2,421	3,543	250	9,414
Total Output (Btuh)		24,000			Supply Fan				
Total Output (Tons)		2.0			Supply Air Ducts				
Total Output (Btuh/sqft)		48.1			TOTAL SYSTEM LOAD				
Total Output (sqft/Ton)		249.5			17,442	5,290	19,617		
Air System					HVAC EQUIPMENT SELECTION				
CFM per System		800			Ductless Mini-Split		23,445	0	21,922
Airflow (cfm)		800			Total Adjusted System Output				
Airflow (cfm/sqft)		1.60			(Adjusted for Peak Design conditions)				
Airflow (cfm/Ton)		400.0			23,445				
Outside Air (%)		31.2%			0				
Outside Air (cfm/sqft)		0.50			21,922				
Note: values above given at ARI conditions									
HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)					TIME OF SYSTEM PEAK				
Aug 3 PM					Jan 1 AM				

a

BY USING THESE PERMIT READY CONSTRUCTION DOCUMENTS, THE USER AGREES TO RELEASE THE CITY OF ANAHEIM AND THE ARCHITECT WHO PREPARED THESE CONSTRUCTION DOCUMENTS FROM ANY AND ALL CLAIMS, LIABILITIES, SUITS AND DEMANDS ON ACCOUNT OF ANY INJURY, DAMAGE OR LOSS TO PERSONS OR PROPERTY, INCLUDING INJURY OR DEATH, OR ECONOMIC LOSSES, ARISING OUT OF THE USE OF THESE CONSTRUCTION DOCUMENTS.

DZN PARTNERS
682 SECOND ST
ENCINITAS, CA
(760) 753 2464
DZNPARTNERS.COM

1 BEDROOM PRADU

CITY: ANAHEIM

JOB: 202409R

HVAC SYSTEM ENERGY SUMMARIES


T-05

PCSD Engineering Corp

3529 Coastview Court

Carlsbad, CA 92010

Ph: 760-207-1885

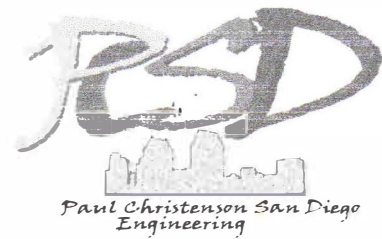

Structural Design Calculations

Accessory Dwelling Unit - 1 Bedroom

Client

DZN Partners

682 Second Street
Encinitas, CA 92024

Project

PRADU-1 Bedrm

Anaheim, CA



Paul S. Christenson
RCE C57182, exp. 12/31/23

February 3, 2023


PCSD File #: 19-018-1

Paul Christenson San Diego Engineering

3529 Coastview Ct - Carlsbad, CA 92010

Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

1.0 Design Criteria:	PRADU-1 Bedrm 20-404-1
Code:	2022 California Building Code - ASCE 7-16
Timber:	Douglas Fir-Larch (DF-L), WWPA or WCLIB 2x Wall Framing: DF-L #2 (unless noted otherwise) 2x Rafters & Joists: DF-L #2 " " Posts & Beams: DF-L #1 " "
Glue-Lam Beams:	Simple Span: Grade 24F-V4 (DF/DF) Cantilevers: Grade 24F-V8 (DF/DF)
Sheathing:	Min. APA-Rated Sheathing, Exposure 1, Plywood or OSB (U.N.O.)
Engineered Framing	Wood I-Joists: TJI 110,210,230,360,560 ICC ESR-1153 LVL, PSL 1.9E Microllam, 2.0E Parallam ICBO ER-4979
Concrete:	Compressive Strength @ 28 days per ASTM C39-96: Footings: f'c = 2500 psi Grade Beams: f'c = 3000 psi
Concrete Block:	Grade N-l per ASTM C90-95, f'm = 1500 psi per ASTM E447-92
Mortar:	Type S Mortar Cement per ASTM C270-95, Min. f'm = 1800 psi @ 28 days.
Grout:	Coarse Grout w/ 3/8" Max. Aggregate per ASTM C476-91, Min. f'm = 2000 psi @ 28 days.
Reinforcing Steel:	#4 & Larger: ASTM A615-60 (Fy = 60 ksi) #3 & Smaller: ASTM A615-40 (Fy = 40 ksi)
Structural Steel:	'W' Shapes: ASTM A992, Fy= 50-65 ksi Plates, Angles, Channels ASTM A36, Fy = 36 ksi Tube Shapes: ASTM A500, Grade B, Fy= 46 ksi Pipe Shapes: ASTM A53, Grade B, Fy=35 ksi
Welding Electrodes:	Structural Steel: E70-T6 A615-60 Rebar: E90 Series
Bolts:	Sill Plate Anchor Bolts & Threaded Rods: A307 Quality Minimum Steel Moment & Braced Frames: A325 (Bearing, U.N.O.)
Soils:	1500 psf Bearing Pressure
References:	



Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

JOB _____ 22-404-S
SHEET NO 2 OF _____
CALCULATED BY PSC DATE 8/8/22
CHECK BY _____ DATE _____
SCALE _____

2.0 LOAD LIST

2.1 Roof (Vaulted)

Roofing	6.0 psf
15/32" Sheathing	1.5 psf
Roof Framing	2.8 psf
5/8" Gyp. Bd.	2.8 psf
Insulation and PV Sys	4.9 psf
$\Sigma_{DL} =$	18.0 psf
$\Sigma_{LL} =$	20.0 psf
Total Load =	41.0 psf

2.2 Roof (w/ ceiling)

Roofing	6.0 psf
15/32" Sheathing	1.5 psf
Roof Framing	2.8 psf
Insulation and Misc.	1.7 psf
$\Sigma_{DL} =$	12.0 psf
$\Sigma_{LL} =$	20.0 psf
Total Load =	35.0 psf

2.3 Ceiling

Ceiling Joists	1.3 psf
5/8" Gyp. Bd.	2.8 psf
Insulation and Misc.	1.9 psf
$\Sigma_{DL} =$	6.0 psf
$\Sigma_{LL} =$	10.0 psf
Total Load =	16.0 psf


2.4 Walls

Exterior Wall

7/8" Stucco	9.0 psf
15/32" Sheathing	1.5 psf
2x4 Studs @ 16" o.c.	1.1 psf
5/8" Gypsum Bd.	2.8 psf
Misc.	0.6 psf
$\Sigma_{DL} =$	15.0 psf

Interior Wall

1/2" Gyp. Bd. (2 Sides)	4.6 psf
2x4 Studs @ 16" o.c.	1.1 psf
Misc.	2.3 psf
$\Sigma_{DL} =$	8.0 psf



Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

JOB 22-404-S
SHEET NO 3 OF
CALCULATED BY PSC DATE 8/8/22
CHECK BY DATE
SCALE

2.0 LOAD LIST (CONTIN)

2.5 Floor

Floor Cover	5.5 psf
Sheathing	2.3 psf
2x F.J.	3.1 psf
5/8" Gyp. Bd.	2.8 psf
Insulation and Misc.	1.3 psf
Σ_{DL}	<u>15.0 psf</u>
Σ_{LL}	<u>40.0 psf</u>
Total Load	55.0 psf

WIND PARAMETERS

Basic Wind Speed = 110 mph Exposure Cat = B

2.6 Wind

$P_s = \lambda K_{zt} I P_{s30}$ (ASCE 7 - Equation 6-1)
 $P = 26.6 \text{ psf}$
 $P = 16.0 \text{ psf}$ (*0.6 ASD)

$\lambda = 1.00$ (fig. 6-3) $P_{s30} = 26.6 \text{ psf}$ (fig. 6-3)
 $K_{zt} = 1.00$ (fig. 6-4) $I = 1.0$ (table 11.5-1)

2.7 Seismic

$S_{MS} = F_a S_s$
 $S_{MS} = 1.79$
 $S_{DS} = (2/3) S_{MS}$ (11.4-3)
 $S_{DS} = 1.194$
 $C_s = \frac{S_{DS}}{(R/I)}$
 $C_s = 0.184$

USGS APPLICATION

$S_s = 1.492$ $S_1 = 0.503$
 $F_a = 1.20$ $F_v = 0.00$
 $R = 6.5$ $I = 1.00$
 $h_n = 15.00$
Occupancy Category: 2
Site Class: D

SEISMIC DESIGN CATEGORY

$S_1 < 0.75$ (11.6 ASCE 7-05)
 $S_1 > 0.04$ (11.4.1 ASCE 7-05)
 $S_s > 0.15$

USE:

$V = C_s W_{DL}$

$T_a = C_t * (h_n)^{0.75} = 0.152$ Eqn. 12.8-1 Not Ol
 $T_s = S_{D1}/S_{DS} = 0$
 $k = 1.0$ $T_a < 0.5$

$V = 0.184 W_{DL}$

Seismic Design Category: D

ASD BASE SHEAR

$V_{ASD} = \frac{C_s W_{DL}}{1.4}$

$V_{ASD} = 0.131 W_{DL}$




OSHPD

3A/

Berwin

San Diego, CA, USA

Latitude, Longitude: 32.715738, -117.1610838

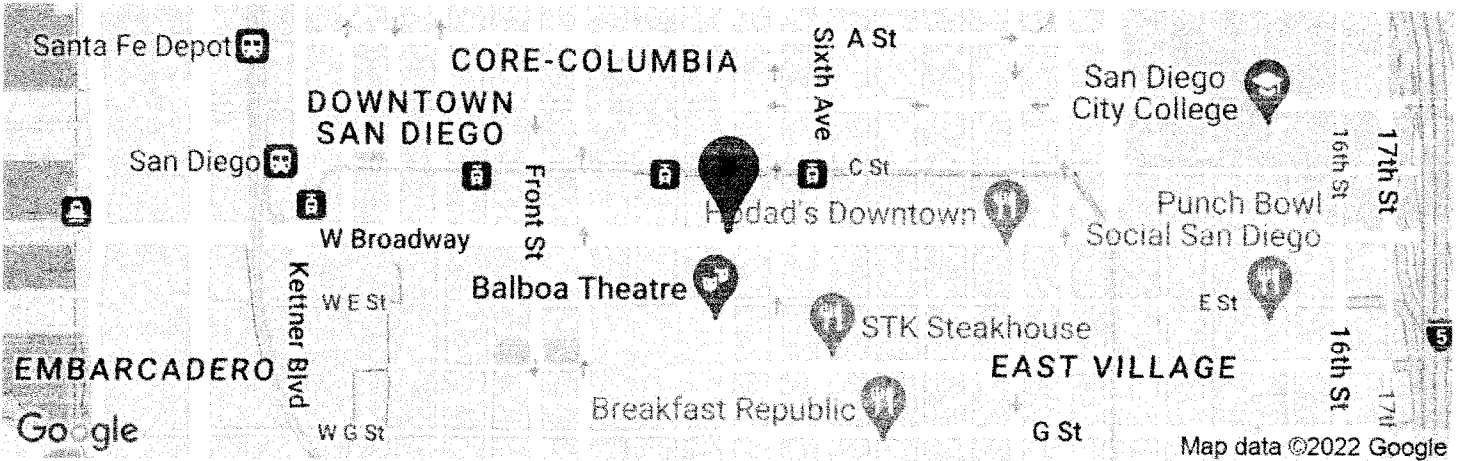


Date	8/9/2022, 3:45:54 PM
Design Code Reference Document	ASCE7-16
Risk Category	II
Site Class	D - Default (See Section 11.4.3)

Type	Value	Description
S _S	1.492	MCE _R ground motion. (for 0.2 second period)
S ₁	0.503	MCE _R ground motion. (for 1.0s period)
S _{MS}	1.79	Site-modified spectral acceleration value
S _{M1}	null -See Section 11.4.8	Site-modified spectral acceleration value
S _{DS}	1.193	Numeric seismic design value at 0.2 second SA
S _{D1}	null -See Section 11.4.8	Numeric seismic design value at 1.0 second SA

Type	Value	Description
SDC	null -See Section 11.4.8	Seismic design category
F _a	1.2	Site amplification factor at 0.2 second
F _v	null -See Section 11.4.8	Site amplification factor at 1.0 second
PGA	0.678	MCE _G peak ground acceleration
F _{PGA}	1.2	Site amplification factor at PGA
PGA _M	0.814	Site modified peak ground acceleration
T _L	8	Long-period transition period in seconds
SsRT	1.492	Probabilistic risk-targeted ground motion. (0.2 second)
SsUH	1.728	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration
SsD	2.269	Factored deterministic acceleration value. (0.2 second)
S1RT	0.503	Probabilistic risk-targeted ground motion. (1.0 second)
S1UH	0.574	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration.
S1D	0.799	Factored deterministic acceleration value. (1.0 second)
PGA _d	0.941	Factored deterministic acceleration value. (Peak Ground Acceleration)
PGA _{UH}	0.678	Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration

4/

Overall Sloped Length: 16' 8 3/16"

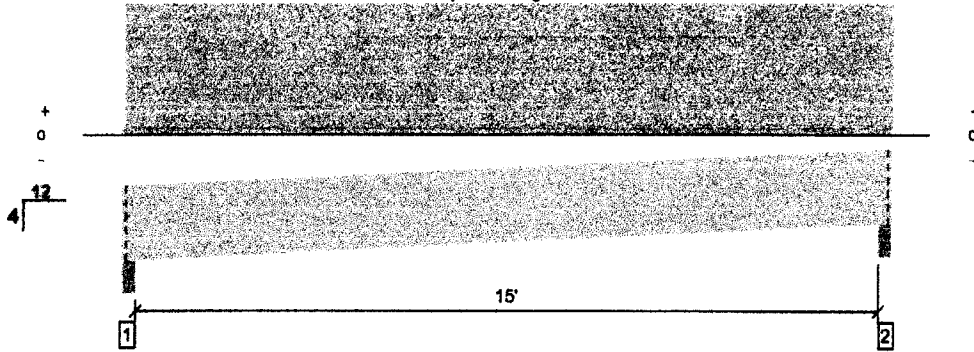

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load Combination (Pattern)
Member Reaction (lbs)	558 @ 2 1/2"	2231 (3.50")	Passed (25%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	485 @ 1' 1/4"	2081	Passed (23%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Ft-lbs)	2059 @ 7' 9 1/2"	2537	Passed (81%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.334 @ 7' 9 1/2"	0.533	Passed (L/574)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.599 @ 7' 9 1/2"	0.799	Passed (L/321)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pftch: 4/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 5' 4" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 16' 5" o/c unless detailed otherwise.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Roof Live	Total	
1 - Beveled Plate - SPF	3.50"	3.50"	1.50"	246	312	558	Blocking
2 - Beveled Plate - SPF	3.50"	3.50"	1.50"	246	312	558	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Spacing	Dead (k/ft)	Roof Live (k/ft) (per code: L/16)	Comments
1 - Uniform (PSF)	0 to 15' 7"	24"	15.0	20.0	Roof

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

Overall Length: 11' 7"

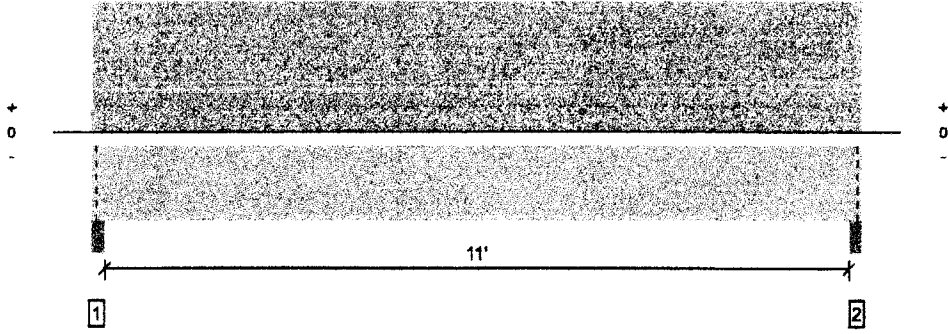

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	IDF	Load Combination (Pattern)
Member Reaction (lbs)	1496 @ 2"	12031 (3.50")	Passed (12%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	1216 @ 1' 1"	7402	Passed (16%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Pt-lbs)	4085 @ 5' 9 1/2"	11634	Passed (35%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (In)	0.089 @ 5' 9 1/2"	0.375	Passed (L/999+)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (In)	0.164 @ 5' 9 1/2"	0.563	Passed (L/821)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch : 0/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 11' 7" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 11' 7" o/c unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lb)			Accessories
	Total	Available	Required	Dead	Roof Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	685	811	1496	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	685	811	1496	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Start)	Tributary Width	Dead (S.DC)	Roof Live (per-spec 1.25)	Comments
0 - Self Weight (PLF)	0 to 11' 7"	N/A	13.2		
1 - Uniform (PSF)	0 to 11' 7" (Front)	7'	15.0	20.0	Roof

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator




Rev. 1-5-23

Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

6/

Overall Length: 14' 7"

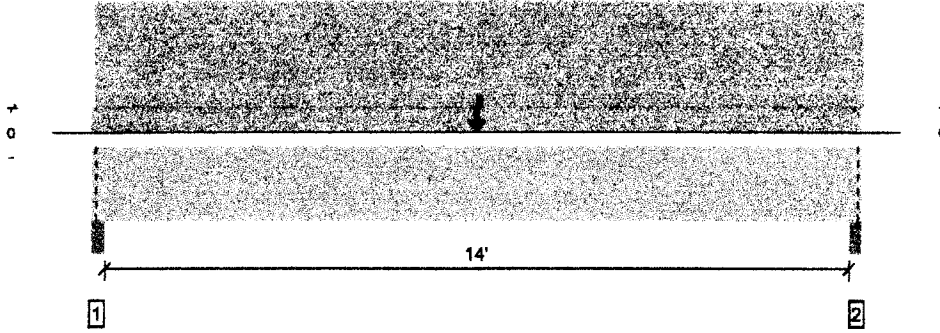

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDY	Load Combination (Pattern)
Member Reaction (lbs)	1606 @ 14' 5"	12031 (3.50")	Passed (13%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	1516 @ 1' 1"	7402	Passed (20%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Ft-lbs)	9234 @ 7' 3 1/2"	11634	Passed (79%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.258 @ 7' 3 1/2"	0.475	Passed (L/662)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.504 @ 7' 3 1/2"	0.712	Passed (L/339)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pttch: 0/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 14' 7" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lb): Bottom compression edge must be braced at 14' 7" o/c unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lb)			Accessories
	Total	Available	Required	Dead	Roof Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	792	815	1607	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	792	815	1607	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary Width	Dead (D, psf)	Roof Live (Roof Snow L, psf)	Comments
0 - Self Weight (PLF)	0 to 14' 7"	N/A	13.2		
1 - Uniform (PSF)	0 to 14' 7" (Front)	2'	15.0	20.0	Roof
2 - Point (lb)	7' 3 1/2" (Front)	N/A	953	1046	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ESR under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

7/

Overall Length: 8' 7"

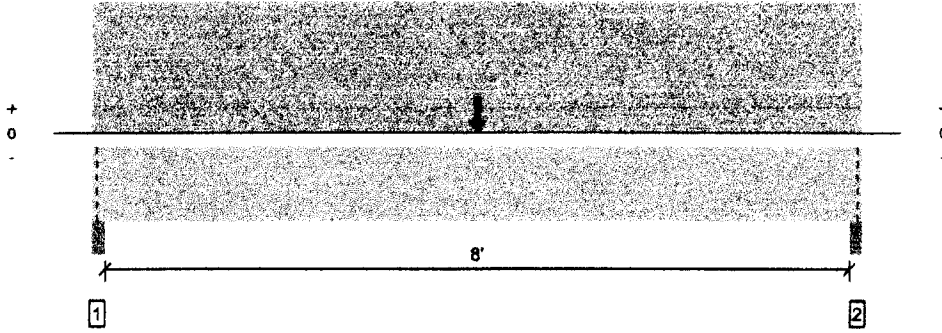

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Results	LDL	Load Combination (Pattern)
Member Reaction (lbs)	1076 @ 2"	7656 (3.50")	Passed (14%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	1008 @ 10 3/4"	3806	Passed (26%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (FT-lbs)	3736 @ 4' 3 1/2"	3737	Passed (100%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.116 @ 4' 3 1/2"	0.275	Passed (L/856)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.215 @ 4' 3 1/2"	0.412	Passed (L/461)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch: 0/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 6" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 8' 7" o/c unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lb)			Accessories
	Total	Available	Required	Dead	Roof Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	499	577	1076	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	499	577	1076	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary Width	Dead (D, psf)	Roof Live (not snow) (Lr, psf)	Comments
0 - Self Weight (PLF)	0 to 8' 7"	N/A	6.4		
1 - Uniform (PSF)	0 to 8' 7" (Front)	2'	15.0	20.0	Roof
2 - Point (lb)	4' 3 1/2" (Front)	N/A	685	811	

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ESR under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and Installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, Input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

Overall Length: 8' 7"

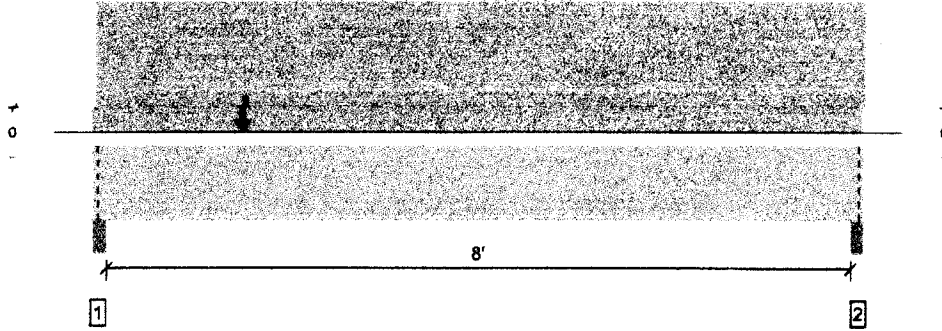

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load Combination (Pattern)
Member Reaction (lbs)	2874 @ 2"	7656 (3.50")	Passed (38%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	2791 @ 1' 3/4"	4856	Passed (57%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Ft-lbs)	4204 @ 1' 8"	5615	Passed (75%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.058 @ 3' 10 3/4"	0.275	Passed (L/999+)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.112 @ 3' 10 13/16"	0.412	Passed (L/883)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch: 0/12

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 8' 7" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lw): Bottom compression edge must be braced at 8' 7" o/c unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Roof Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	1372	1502	2874	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	432	467	899	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary width	Dead (D, psf)	Roof Live (non-snow, Lr, psf)	Comments
0 - Self Weight (PLF)	0 to 8' 7"	N/A	8.2		
1 - Uniform (PSF)	0 to 8' 7" (Front)	2'	15.0	20.0	Roof
2 - Point (lb)	1' 8" (Front)	N/A	1477	1626	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ESR under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

Roof Framing, (RB-6) Hdr Bm
1 piece(s) 4 x 4 DF No.2

8A/

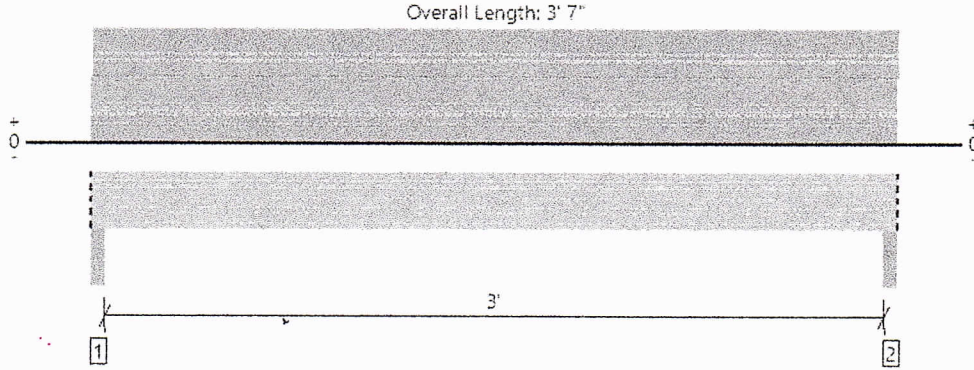

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	431 @ 2"	7656 (3.50")	Passed (6%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	291 @ 7"	1838	Passed (16%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Ft-lbs)	318 @ 1' 9 1/2"	1005	Passed (32%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.016 @ 1' 9 1/2"	0.162	Passed (L/999+)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.030 @ 1' 9 1/2"	0.217	Passed (L/999+)	--	1.0 D + 1.0 Lr (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD
 Member Pitch : 0/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.
- This product has a square cross section. The analysis engine has checked both edge and plank orientations to allow for either installation.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Roof Live	Factored	
1 - Column - DF	3.50"	3.50"	1.50"	207	224	431	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	207	224	431	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 7" o/c	
Bottom Edge (Lu)	3' 7" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Roof Live (non-snow: 1.25)	Comments
0 - Self Weight (PLF)	0 to 3' 7"	N/A	3.1	--	
1 - Uniform (PSF)	0 to 3' 7" (Front)	6' 3"	18.0	20.0	Default Load


Weyerhaeuser Notes
 Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	



9/

Overall Length: 8' 7"

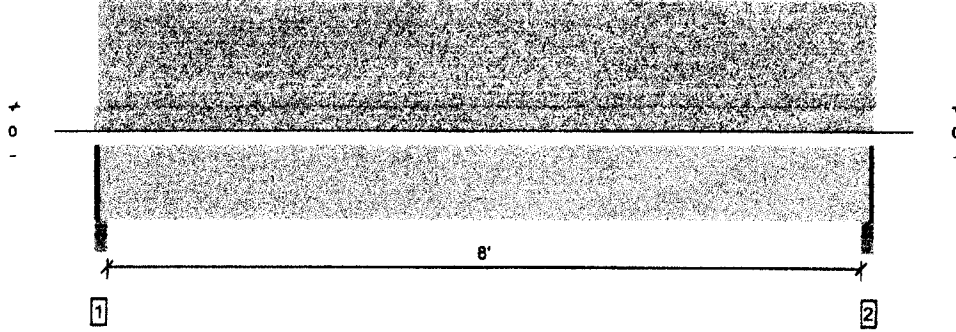

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LOF	Load Combination (Pattern)
Member Reaction (lbs)	307 @ 2 1/2"	2109 (2.25")	Passed (15%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	260 @ 9"	990	Passed (26%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	611 @ 4' 3 1/2"	848	Passed (72%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.160 @ 4' 3 1/2"	0.204	Passed (L/611)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.221 @ 4' 3 1/2"	0.408	Passed (L/444)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	N/A	N/A	--	--	--

System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 8' 5" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lb): Bottom compression edge must be braced at 8' 5" o/c unless detailed otherwise.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)			Annotations
	Total	Available	Required	Dead	Flr/Liv	Total	
1 - Stud wall - DF	3.50"	2.25"	1.50"	86	229	315	1 1/4" Rim Board
2 - Stud wall - DF	3.50"	2.25"	1.50"	86	229	315	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.


Loads	Location (ft)	Spacing	Dead (D, psf)	Flr/Liv (L, psf)	Comments
1 - Uniform (PSF)	0 to 8' 7"	16"	15.0	40.0	Residential - Living Areas

Weyerhaeuser Notes
 Weyerhaeuser warrants that the slating of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

Overall Length: 7' 3"

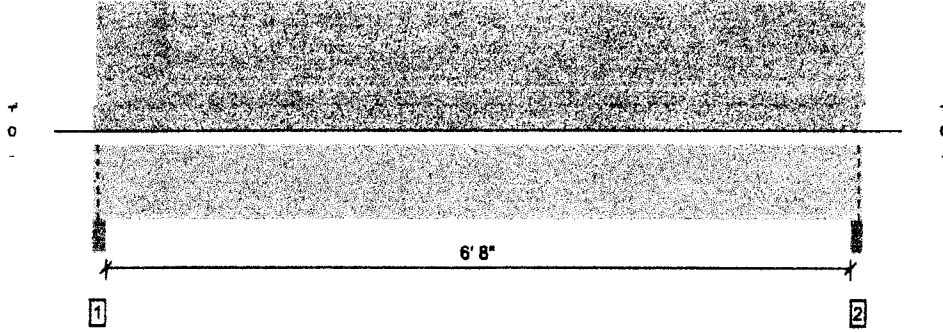

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load Combination (Pattern)
Member Reaction (lbs)	1064 @ 2"	7656 (3.50")	Passed (14%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	844 @ 9"	2310	Passed (37%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	1756 @ 3' 7 1/2"	1720	Passed (102%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.139 @ 3' 7 1/2"	0.231	Passed (L/596)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.195 @ 3' 7 1/2"	0.346	Passed (L/426)	--	1.0 D + 1.0 L (All Spans)

System : Floor
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 6" o/c unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 7' 3" o/c unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	303	761	1064	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	303	761	1064	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary Width	Dead (D, psf)	Floor Live (L, psf)	Comments
0 - Self Weight (PLF)	0 to 7' 3"	N/A	4.9		
1 - Uniform (PSF)	0 to 7' 3" (Front)	5' 3"	15.0	40.0	Residential - Living Areas

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	

Floor Framing, (FB-4) Hdr Bm
1 piece(s) 4 x 10 Douglas Fir-Larch No. 1

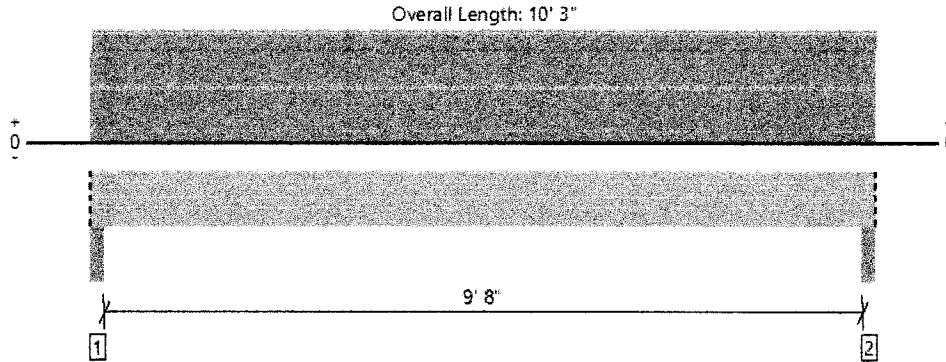

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2430 @ 2"	7656 (3.50")	Passed (32%)	--	1.0 D + 1.0 Lr (All Spans)
Shear (lbs)	1926 @ 1' 3/4"	4856	Passed (40%)	1.25	1.0 D + 1.0 Lr (All Spans)
Moment (Ft-lbs)	5829 @ 5' 1 1/2"	6239	Passed (93%)	1.25	1.0 D + 1.0 Lr (All Spans)
Live Load Defl. (in)	0.097 @ 5' 1 1/2"	0.331	Passed (L/999+)	--	1.0 D + 1.0 Lr (All Spans)
Total Load Defl. (in)	0.263 @ 5' 1 1/2"	0.496	Passed (L/453)	--	1.0 D + 1.0 Lr (All Spans)

System : Floor
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 10' 3" o/c based on loads applied, unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 10' 3" o/c based on loads applied, unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Roof Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	1533	205	897	2635	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	1533	205	897	2635	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Roof Live (non-snow: 1.25)	Comments
0 - Self Weight (PLF)	0 to 10' 3"	N/A	8.2	--	--	
1 - Uniform (PLF)	0 to 10' 3" (Front)	N/A	291.0	40.0	175.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	



Floor Framing, (FB-2) Flr Brm @ Stair
1 piece(s) 6 x 12 Douglas Fir-Larch No. 1

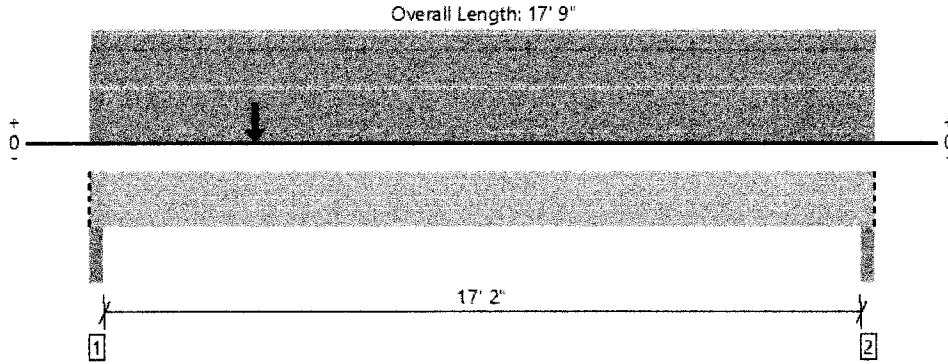

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3533 @ 2"	12031 (3.50")	Passed (29%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	3445 @ 1' 3"	7168	Passed (48%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	12163 @ 3' 9"	13638	Passed (89%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.357 @ 8' 7/16"	0.581	Passed (L/585)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.555 @ 8' 7/8"	0.871	Passed (L/376)	--	1.0 D + 1.0 L (All Spans)

System : Floor
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2015
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Top Edge Bracing (Lu): Top compression edge must be braced at 17' 9" o/c based on loads applied, unless detailed otherwise.
- Bottom Edge Bracing (Lu): Bottom compression edge must be braced at 17' 9" o/c based on loads applied, unless detailed otherwise.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Column - DF	3.50"	3.50"	1.50"	1230	2303	3533	Blocking
2 - Column - DF	3.50"	3.50"	1.50"	523	860	1383	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	0 to 17' 9"	N/A	16.0	--	
1 - Uniform (PLF)	0 to 17' 9" (Front)	N/A	15.0	40.0	Default Load
2 - Point (lb)	3' 9" (Front)	N/A	1202	2453	

Weyerhaeuser Notes
 Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Paul Christenson PCSD Engineering (760) 207-1885 paul.pcsd@gmail.com	





Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

JOB 19-131.1-1
SHEET NO 11 OF
CALCULATED BY PSC DATE 3/24/20
CHECK BY DATE
SCALE

5.0 Lateral Design & Analysis - 1 Bedroom

Wind: $P = \lambda Kzt I ps30$ (ASCE 7 - Equation 6-1)

$\lambda = 1.00$ (fig. 6-3)
 $Kzt = 1.0$ (fig. 6-4)
 $PS30 = 26.6$ psf (fig. 6-3)
 $I = 1.0$ (table 11.5-1)

$P = 16.0$ psf

Seismic: $V = C_s W_{DL}$ (IBC Equation 12.8-1)

$S_s = 1.245$ $S_1 = 0.442$
 $F_a = 1.0$ $F_v = 0.0$
 $R = 6.50$ $I = 1.00$
 $V = 0.091 * W_t * \rho$ (ρ - Redundancy)

Criteria	1st Story	2nd Story
Each Story Resists > 35% Base Shear:	not satisfied	satisfied
Any Shear Wall w/ (h/l) > 1.0 is < 33% Story Force:	satisfied	satisfied
$\rho =$	1	1

Wind Loads

$P = 16.0$ psf x Trib Area

Roof Level

Direction: N/S = 16.0 psf x 324 sq. ft. = 5171 lbs.
Direction: E/W = 16.0 psf x 127 sq. ft. = 2027 lbs.

Roof Weight

Roof Wt. = 15.0 psf x 713 sq. ft. = 10695 lbs.
Exterior Wall Wt = 15.0 psf x 352 sq. ft. = 5280 lbs.
Interior Wall Wt = 8.0 psf x 233 sq. ft. = 1864 lbs.
Ceiling Wt = 6.0 psf x 499 sq. ft. = 2994 lbs.
Total Trib. $W_r = 20833$ lbs.

Total Seismic Dead Load: $W_t = 20833$ lbs.

ASD Base Shear: $V = 0.091 * W_t = \underline{\underline{1904}}$ lbs.




*Paul Christenson San Diego
Engineering*


3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcad@gmail.com

JOB 19-018-1
SHEET NO 12 OF
CALCULATED BY PSC DATE 1/23/19
CHECK BY DATE
SCALE

5.1 Lateral Design & Analysis - 2nd Story Shear Walls

N/S					E/W				
Gridline	Length of Shearwalls	Total	Wall Ht.	Type	Gridline	Length of Shearwalls	Total	Wall Ht.	Type
1	3 3	6.0	9	B	A	4 8.5 11	23.5	9	S
3	3 3	6.0	9	C	C	4 4	8	9	S
4	4 4	8.0		A			0		
		0.0		0			0		
		0.0		0			0		
		0.0		FALSE			0		#DIV/0!
		0.0		FALSE			0		#DIV/0!
		0.0		FALSE			0		#DIV/0!
		0.0		FALSE			0		#DIV/0!
		0.0		FALSE			0		#DIV/0!

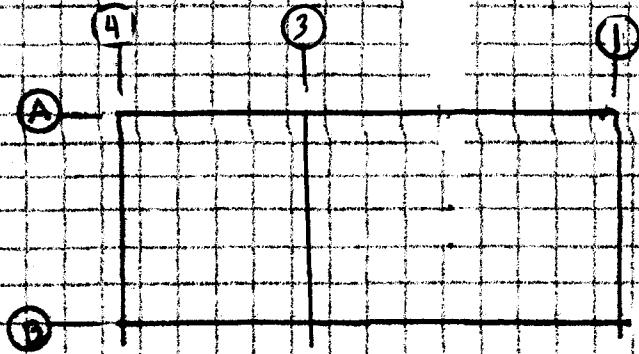



Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com


JOB _____ 19-018-1
SHEET NO 13 OF _____
CALCULATED BY PSC DATE 1/23/19
CHECK BY _____ DATE _____
SCALE _____

5.1 Lateral Design & Analysis (cont.)

Gridline 1 , 35 % (5171 x 0.35 = 1810 #)

$$v = \frac{1810 \text{ lbs.}}{6 \text{ ft.}} = \frac{302}{1.2} \text{ plf} \times \left(\frac{9'}{2.5}\right) = 377 \text{ PF}$$

OTF = 2564 lbs.




HDU2

Gridline 2 50 % (5171 x 0.50 = 2586 #)

$$v = \frac{2586 \text{ lbs}}{6 \text{ ft.}} = \frac{431}{1.2} \text{ plf} \times \left(\frac{2'}{2.5}\right) = 579 \text{ PF}$$

OTF = 3663 lbs.




HDU4

Gridline 3 15 % (5171 x 0.15 = 776 #)

$$v = \frac{776 \text{ lbs}}{8 \text{ ft.}} = 97 \text{ plf} \times \left(\frac{9'}{2.5}\right) = 109 \text{ PF}$$



HDU2



Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

JOB 22-404-1
SHEET NO 14 OF
CALCULATED BY PSC DATE 8/11/22
CHECK BY DATE
SCALE

5.1 Lateral Design & Analysis (cont.)

Gridline (A), 50 % (2817 x 0.50 = 1408 #)

$v = \frac{1408 \text{ lbs.}}{23.5 \text{ ft.}} = 60 \text{ plf} \times \left(\frac{9}{24}\right) = 60 \text{ plf}$

OTF = 539.4 lbs.




HDU2


Gridline (C) 50 % (2817 x 0.50 = 1408 #)

$v = \frac{1408 \text{ lbs.}}{8 \text{ ft.}} = 176 \text{ plf} \times \left(\frac{9}{24}\right) = 176 \text{ plf}$

OTF = 1584 lbs.



HDU2



Paul Christenson San Diego
Engineering

3529 Coastview Ct - Carlsbad, CA 92010
Telephone (760) 207-1885 - Email: paul.pcsd@gmail.com

JOB 19-131.1-1
SHEET NO 15 OF 15
CALCULATED BY PSC DATE 3/24/20
CHECK BY _____ DATE _____
SCALE _____

6.0 FOUNDATION DESIGN

6.1 CONTINUOUS FOOTING


$$w = 1125 \text{ plf}$$

$$\text{ASBP} = 1500 \text{ psf}$$

$$\text{width} = \frac{1125 \text{ plf}}{1500 \text{ psf}} = 0.75 \text{ ft (MIN.)} \Rightarrow 9 \text{ INCHES (MIN.)}$$

USE 12 " WIDE CONTIN. FTG W/
2 - # 4 TOP AND BOTTOM & EMBED.
12 " INTO UNDISTURBED SOIL (MIN.)

6.2 MAX POINT LOAD ON FOOTING

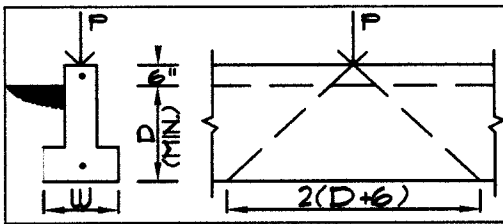

$$P_{\text{all}} = 1500 * \frac{12}{12} * \frac{36}{12}$$

$$P_{\text{all}} = 4500 \text{ lbs}$$

6.3 PAD DESIGN

PAD

SIZE

LOAD

PI

18 " SQUARE x 12 " THK
W/ 2 - # 4 EACH WAY

$$P_{\text{max}} = 1500 * 2^2$$

$$P_{\text{max}} = 3375 \text{ lbs}$$